


Y-STRAINER ON INLET SIDE (RECOMMENDED FOR CLEANING ANY POSSIBLE DEBRIS THAT MAY OCCUR)



NOTES:

1. THE REDUCED PRESSURE ZONE BACKFLOW PREVENTER (RPZ) MUST BE PROVIDED BY THE CONTRACTOR, IN GOOD WORKING ORDER, AND TESTED AS PER CSA B64.10-01 (AS AMENDED) WITH THE EXCEPTION OF REDUCED PRESSURE ZONES INITIALLY TESTED AND THEN RELOCATED WITHIN THE SAME DAY.
2. THE BACKFLOW PREVENTION ASSEMBLY AND THE BACKFLOW PREVENTION VALVE ASSEMBLY SHALL BE PHYSICALLY SEPERATED FROM THE NEW MAIN DURING WATERMAIN PRESSURE TESTS. THE FINAL CONNECTION OF THE WATERMAIN SHALL BE COMPLETED ONLY AFTER AUTHORIZATION BY THE CITY OF BARRIE.
3. THE WATERMAIN SHALL BE DRAINED BY CONTROLLED MEANS, DE-CHLORINATING AS REQUIRED AS PER AWWA, AND TEMPORARY CAPS OR PLUGS INSTALLED AS REQUIRED.
4. THE WATERMAIN SHALL BE CUT BACK TO REMOVE THE TAPPING POINTS OF THE TEMPORARY WATERMAIN BY-PASS ASSEMBLY. ENSURE COMPLETION PIECE IS LESS THAN 5.5m AND DISINFECTED ACCORDING TO AWWA 651 (AS AMENDED).
5. ONLY CITY OF BARRIE WATER OPERATIONS SHALL OPERATE VALVES AND/OR OTHER APPURTENANCES WITHIN THE NEW SYSTEM ONCE COMMISSIONING PROCEDURES ARE INITIATED. FAILURE TO COMPLY WITH THIS REQUIREMENT WILL RESULT IN A CHARGE, AS OUTLINED IN CITY OF BARRIE FEES BY-LAW (AS AMENDED).
6. ALL PIPING AND APPURTENANCES PLACED IN THE CONNECTION SHALL BE NEW MATERIAL DISINFECTED AS PER AWWA C651: DISINFECTING WATERMAIN (AS AMENDED).
7. A PHYSICAL SEPARATION MUST BE MAINTAINED AT ALL CONNECTION POINTS OF NEW WATERMAINS TO THE EXISTING SYSTEM UNTIL BACTERIOLOGICAL SAMPLES CONFIRM SATISFACTORY RESULTS. A SAMPLING TAP MUST BE PROVIDED AT THE END OF EACH BRANCH OR STUB.
8. THE ACTUAL CONFIGURATION USED MUST SATISFY THE INTENT OF THIS DRAWING AND AT THE DISCRETION OF THE CITY REPRESENTATIVE. (THE CITY OF BARRIE WATER OPERATIONS BRANCH MUST BE CONSULTED PRIOR TO ANY CONNECTION TO THE EXISTING DRINKING WATER SYSTEM)
9. WINTER PROTECTION MUST BE PROVIDED WHEN APPLICABLE.
10. ALL TEMPORARY CAPS TO BE RESTRAINED. ALL RESTRAINED JOINTS AS PER PIPE MANUFACTURER'S SPECIFICATION.
11. CITY OF BARRIE WATER OPERATIONS MAINTAINS THE RIGHT TO REQUEST ALTERNATE BY-PASS ASSEMBLY SIZING IN AREAS WHERE PRESSURE AND FLOW RATES MAY BE AN ISSUE.

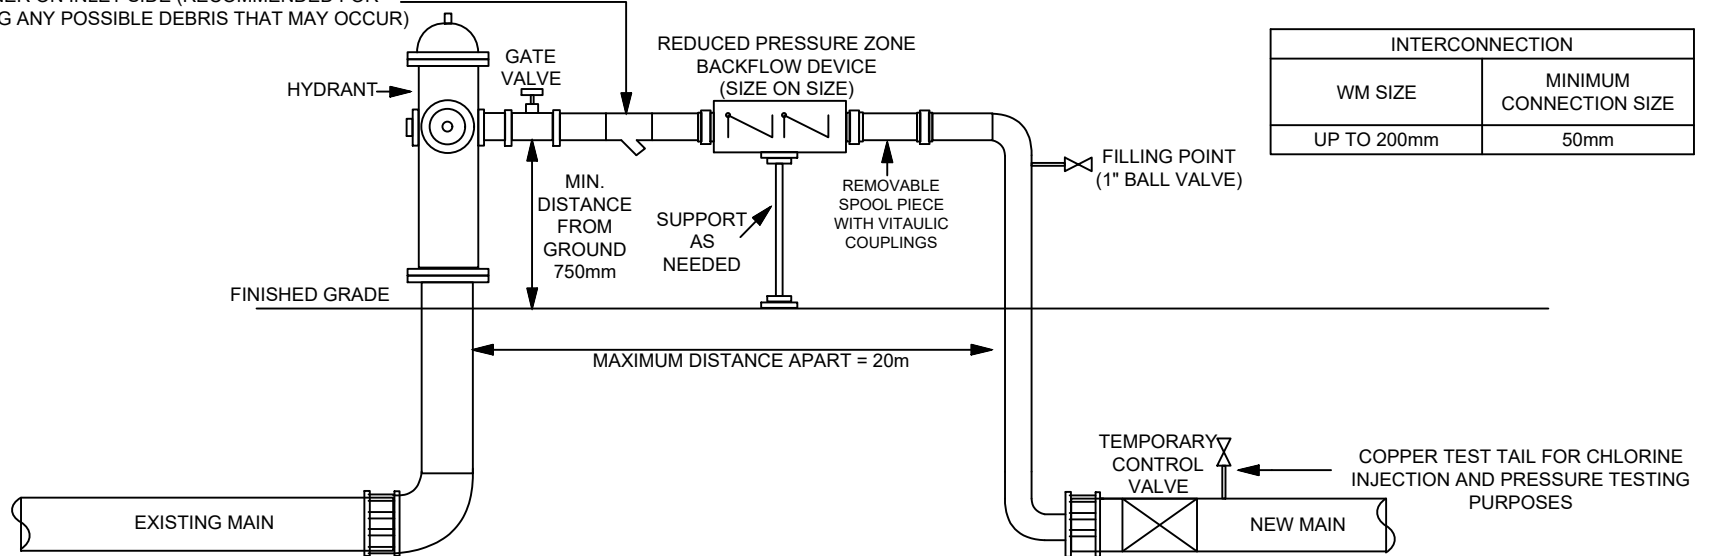

**WATERMAIN CONNECTION FROM
HYDRANT
(FOR WATERMAINS UP TO 200MM)**

REV No.	DATE: NOV 2019
2	SCALE: N.T.S.

BSD-535