


**NOTES:**

1. PIPE SHALL BE 100mm DIA. PVC. MEETING CSA-B182.4-M90, RUBBER GASKET TYPE JOINTS OR EQUIVALENT
2. MIN. SLOPE OF PIPE TO BE 1%.
3. JUNCTION OF SUMP DISCHARGE AND STORM SERVICE MUST BE ABOVE FINISHED GRADE AND IS NOT TO BE SEALED.
4. ALL PLUMBING TO CONFORM TO ONTARIO BUILDING CODE.

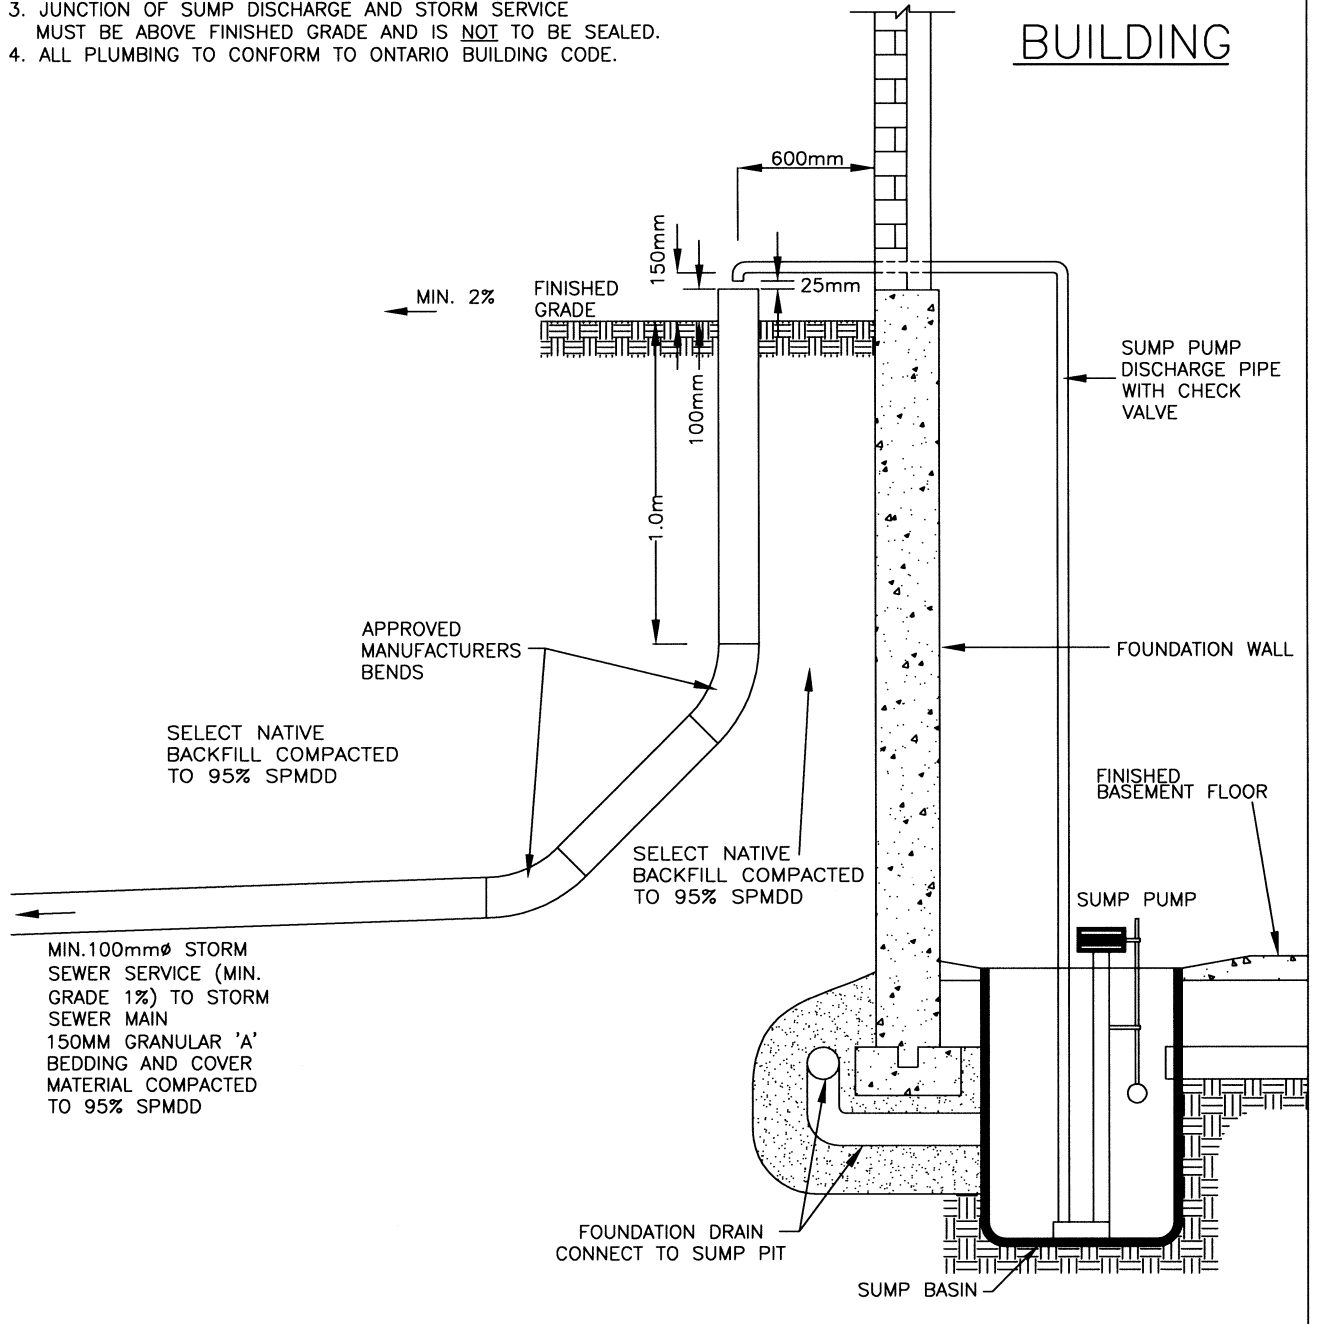

No.	REVISION	APR'D	DATE

CITY OF BARRIE STANDARD  
**FOUNDATION DRAIN OUTLET  
 SUMP PUMP TO STORM SEWER  
 AT SURFACE**

APPROVED  
*R. W. McArthur*  
 DIRECTOR OF ENGINEERING

DATE: 09 11 05  
 SCALE: N.T.S.

**BSD-75A**