


SINGLE OR DOUBLE TAPERED
ELLIPTICAL BRACKET AND LUMINAIRE

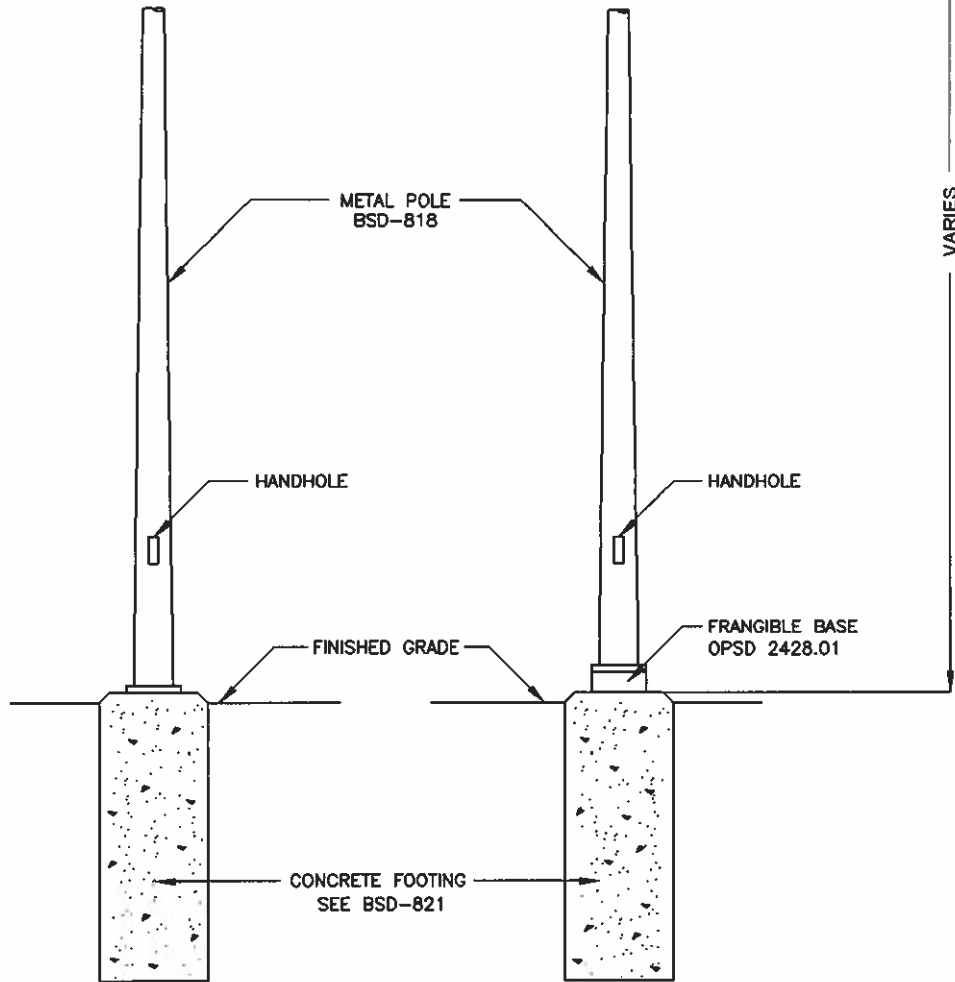

BASE MOUNTED

FRANGIBLE BASE
MOUNTED

APPROVED
DATE: June 4, 2015
[Signature]
DIRECTOR OF ENGINEERING

City of
BARRIE
STANDARD DETAIL

METAL LIGHTING POLE
BASE MOUNTED

REV No. 1
DATE: MAY 2015
SCALE: N.T.S.

BSD-820