


**NOTES:**

1. FOR ANCHORAGE ASSEMBLY SEE BSD-823.
2. REFER TO BSD-822 FOR REINFORCEMENT BAR DIMENSIONS.
3. MINIMUM OF TWO SLEEVES REQUIRED FOR EACH CONCRETE FOOTING. THREE SLEEVES AS SPECIFIED.
4. TOP OF FOOTING SHALL BE INSTALLED FLUSH WITH FINISHED GRADE IN PAVED OR CONCRETE AREAS AND 75mm ±15mm ABOVE FINISHED GRADE IN EARTH OR GRANULAR AREAS.
5. FOR POLE MOUNTING DETAILS SEE BSD-819.
6. ALL POLE BASES SHALL BE CONSTRUCTED IN ACCORDANCE WITH OPSS 616.
7. ANCHOR ASSEMBLY AND CONDUITS ARE TO BE PLACED IN THE CENTRE OF FOOTING.
8. CONCRETE SHALL BE POURED AS ONE MONOLITHIC SLAB AND FORMED, PLACED, VIBRATED, CURED, FINISHED AND PROTECTED IN ACCORDANCE WITH OPSS 904.
9. DIRECTION OF CONDUIT SLEEVE ENTRY TO BE MARKED WITH INDENTATION ON TOP OF FOOTING.
10. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE SHOWN.

**APPROVED**  
 DATE *June 4, 2015*  
  
 DIRECTOR OF ENGINEERING

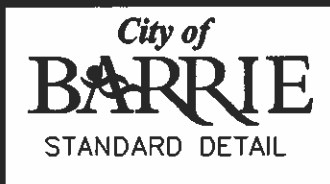

**CONCRETE FOOTING FOR  
 BASE MOUNTED POLE**

REV No.	DATE: MAY 2015
1	SCALE: N.T.S.
<b>BSD-821</b>	