


AERIAL INSTALLATION

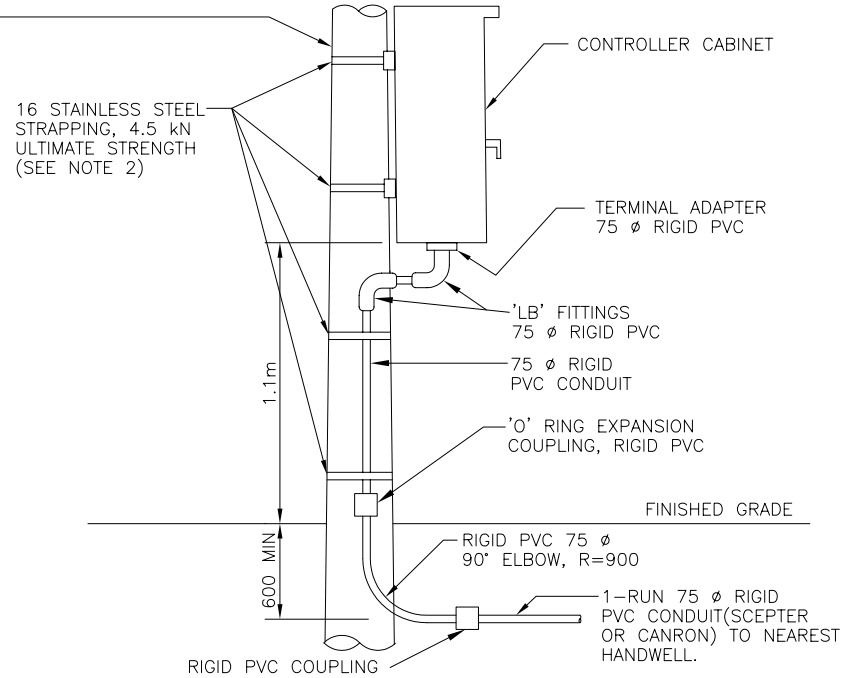

UNDERGROUND INSTALLATION

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE SHOWN.
2. PVC COATED STEEL PIPE STRAPS (SCEPTER OR CANRON) EVERY 1.2m IN LIEU OF STRAPPING ON WOOD POLES.

CITY OF BARRIE STANDARD					APR'D: S.R.A.	DATE: JULY 2002
	MOUNTING DETAILS FOR CONTROLLER CABINET ON WOOD OR CONCRETE POLE				DRAWN: S.ROSE	SCALE: N.T.S.
NO.		REVISION	APR'D	DATE	BSD TS-6	