


# FLOW TEST RESULTS



DATE : APRIL 17, 2019 TIME : 2:15 PM

LOCATION : 263 EDGEHILL DRIVE  
BARRIE  
ONTARIO

TEST BY : VIPOND FIRE PROTECTION AND LOCAL PUC

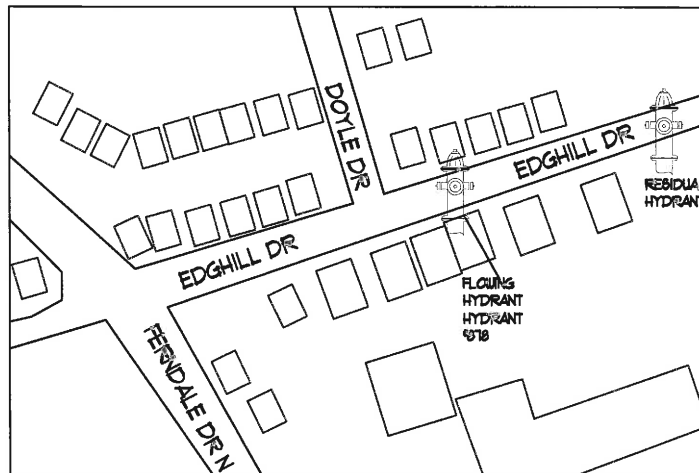

STATIC PRESSURE : 54 PSI UNDERGROUND TYPE & SIZE : 200mm D.I.

TEST NO.	NO. OF NOZZLES	NOZZLE DIAMETER (INCHES)	DISCHARGE CO-EFFICIENT	RESIDUAL PRESSURE (PSI)	PITOT PRESSURE (PSI)	DISCHARGE (U.S.GFM)
1	1	1 3/4"	0.995	51	34	519
2	1	2 1/2"	0.90	49	20	754
3	2	2 1/2"	0.90	46	14	1262



263 EDGEHILL DRIVE

BARRIE

ONTARIO

BY: LEN K

VIPOND OFFICE: BARRIE

TEST BY: VIPOND & PUC

DATE: APRIL 17, 2019

STATIC:	TEST#1	TEST#2	TEST#3	RESIDUAL:	FLOW:
54 PSI	51 PSI	49 PSI	46 PSI	519 GPM	519 GPM
				154 GPM	154 GPM
				1262 GPM	1262 GPM

