


Luminaire Schedule							
Symbol	Qty	Label	Description	Total Lamp Lumens	Lum. Watts	LLF	
	1	PRV-A25-D-UNV-T3-BZ-HSS	PRV-A25-D-UNV-T3-BZ-HSS	N.A.	87	0.940	
	7	PRV-A25-D-UNV-T4-BZ-HSS	PRV-A25-D-UNV-T4-BZ-HSS	N.A.	87	0.940	
	18	XTOR2B-W	XTOR2B-W	N.A.	18.2	0.940	

Calculation Summary							
Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min
CalcPts_1	Illuminance	Fc	1.22	11.9	0.1	12.20	119.00
Property Line Bottom	Illuminance	Fc	0.02	0.1	0.0	N.A.	N.A.
Property Line Left	Illuminance	Fc	0.00	0.0	0.0	N.A.	N.A.
Property Line Right	Illuminance	Fc	0.13	0.4	0.0	N.A.	N.A.
Property Line Top	Illuminance	Fc	0.10	1.8	0.0	N.A.	N.A.

Calculations are based on procedures established by the ILLUMINATING ENGINEERING SOCIETY of NORTH AMERICA, or standard industry practice. AGI32 computes output performance based on input data provided by manufacturers. Lighting U Up nor the undersigned can be held responsible for the variations in actual situations which can effect calculated output.

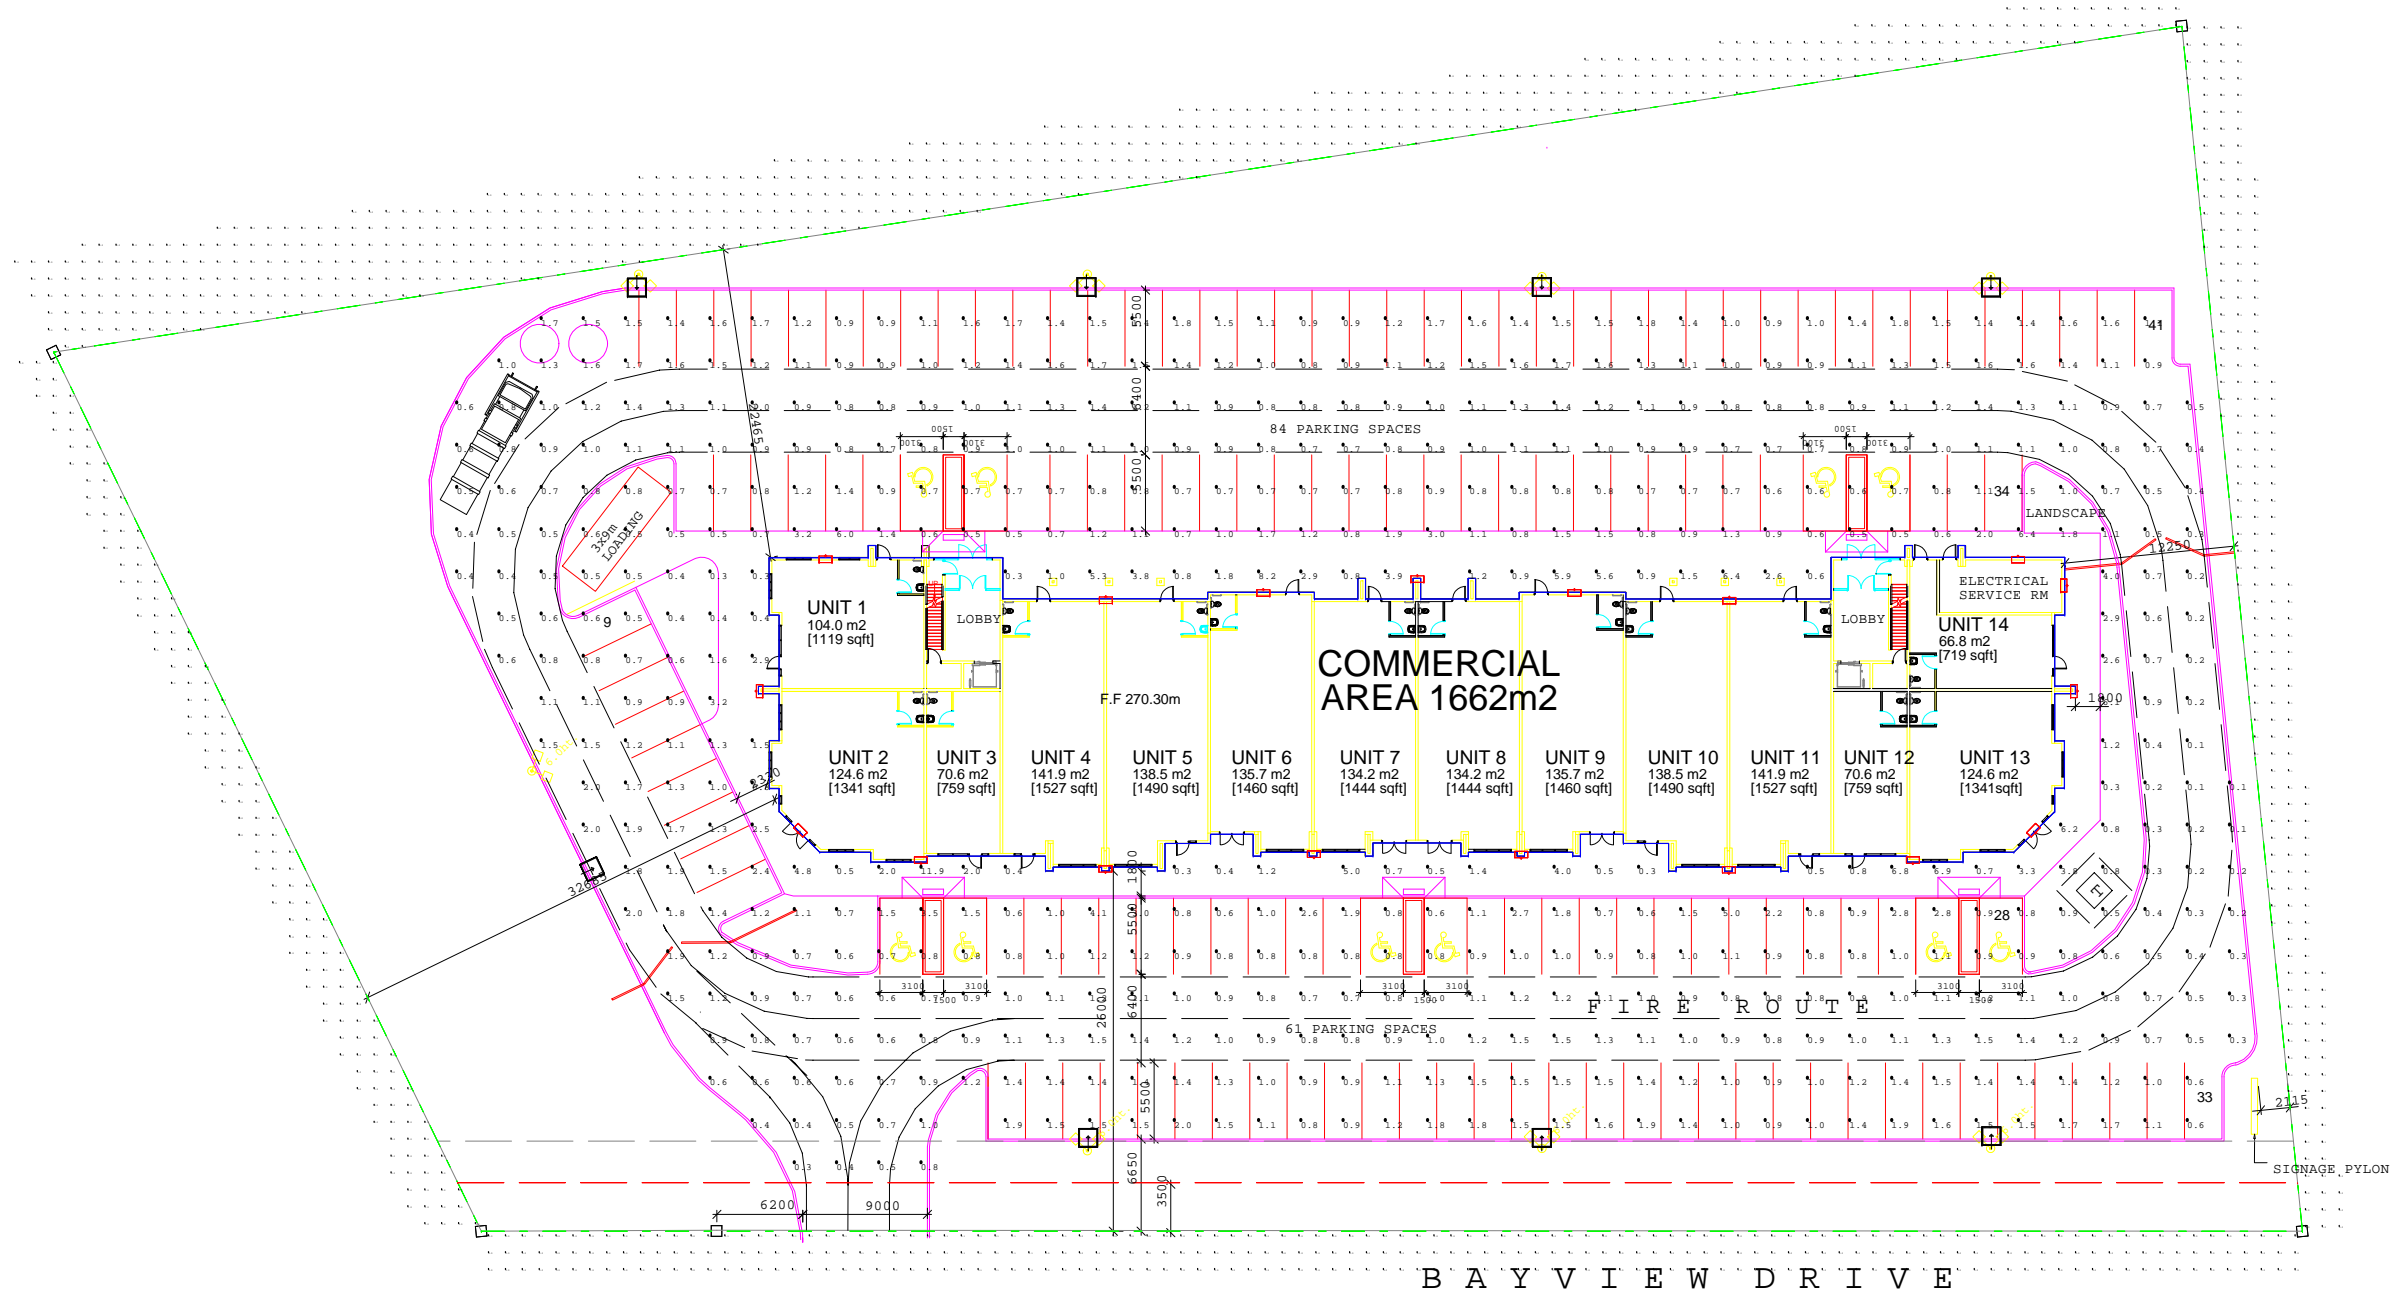

#	Date	Comments

Drawn By: DBM
Checked By:
Date: 9/22/17
Scale:

249 BAYVIEW
BARRIE, ON