


NOTES:

1. PIPE SHALL BE 100mm DIA. PVC. MEETING CSA-B182.4-M90, RUBBER GASKET TYPE JOINTS OR EQUIVALENT
2. MIN. SLOPE OF PIPE TO BE 1%.
3. JUNCTION OF SUMP DISCHARGE AND STORM SERVICE MUST BE ABOVE FINISHED GRADE AND IS NOT TO BE SEALED.
4. ALL PLUMBING TO CONFORM TO ONTARIO BUILDING CODE.

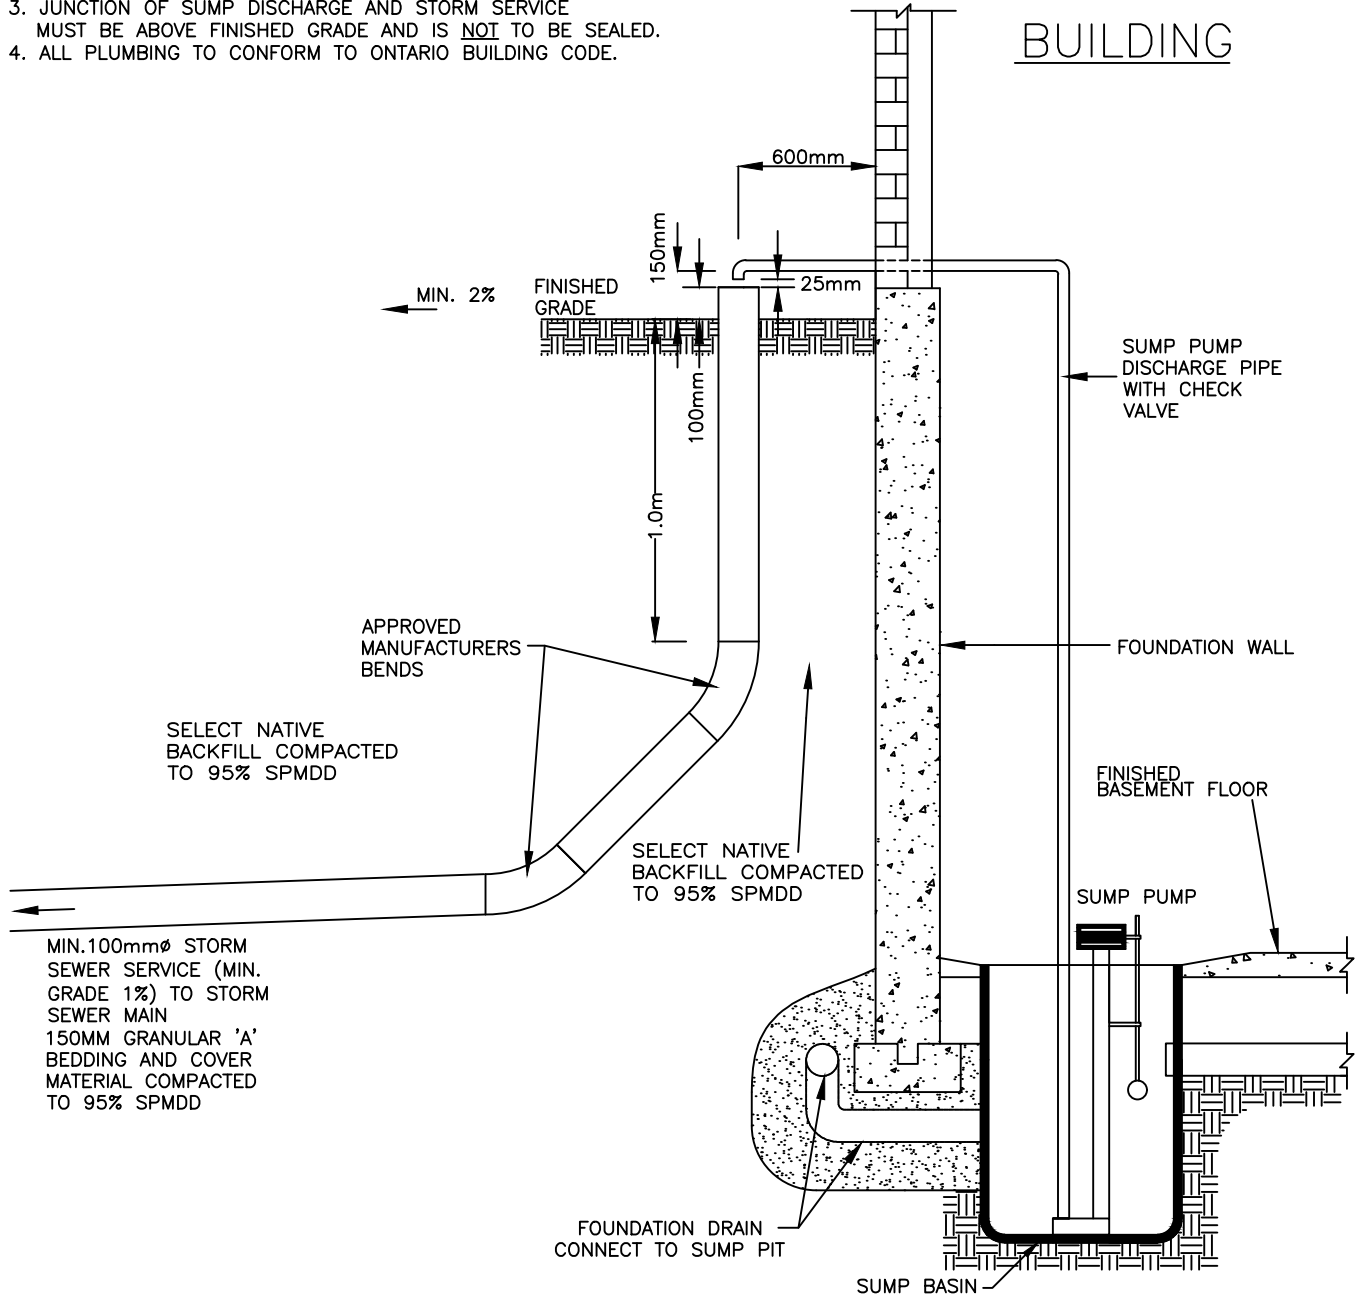

Foundation Drain Layout - Alternate 1

REV No.	DATE: APR 2023
1	SCALE: N.T.S

D774