


REFER BSD-80 FOR WATER LEVEL AND GRADING CRITERIA

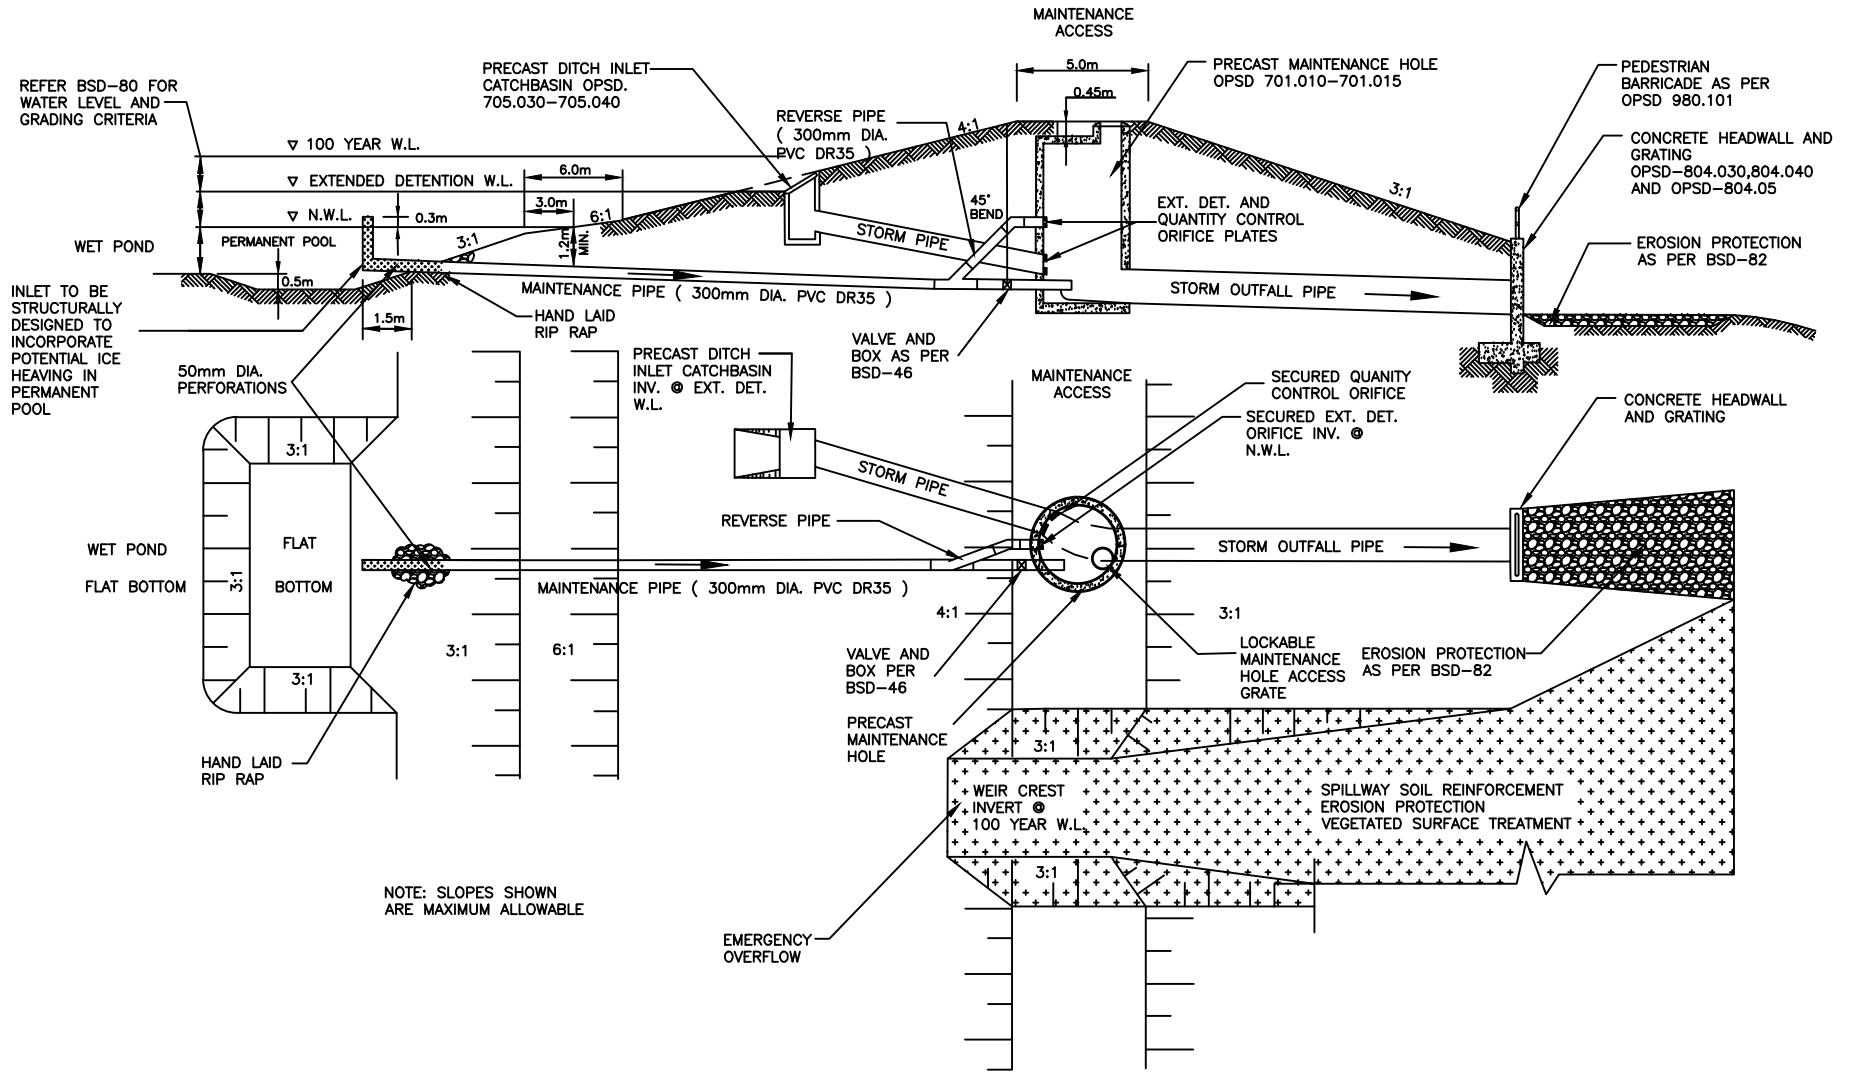

SWM Facility with Maintenance Pipe

REV No. DATE: APR 2023

1

SCALE: N.T.S.

D777