


REFER D780 FOR WATER LEVEL AND GRADING CRITERIA



NOTE: SLOPES SHOWN ARE MAXIMUM ALLOWABLE

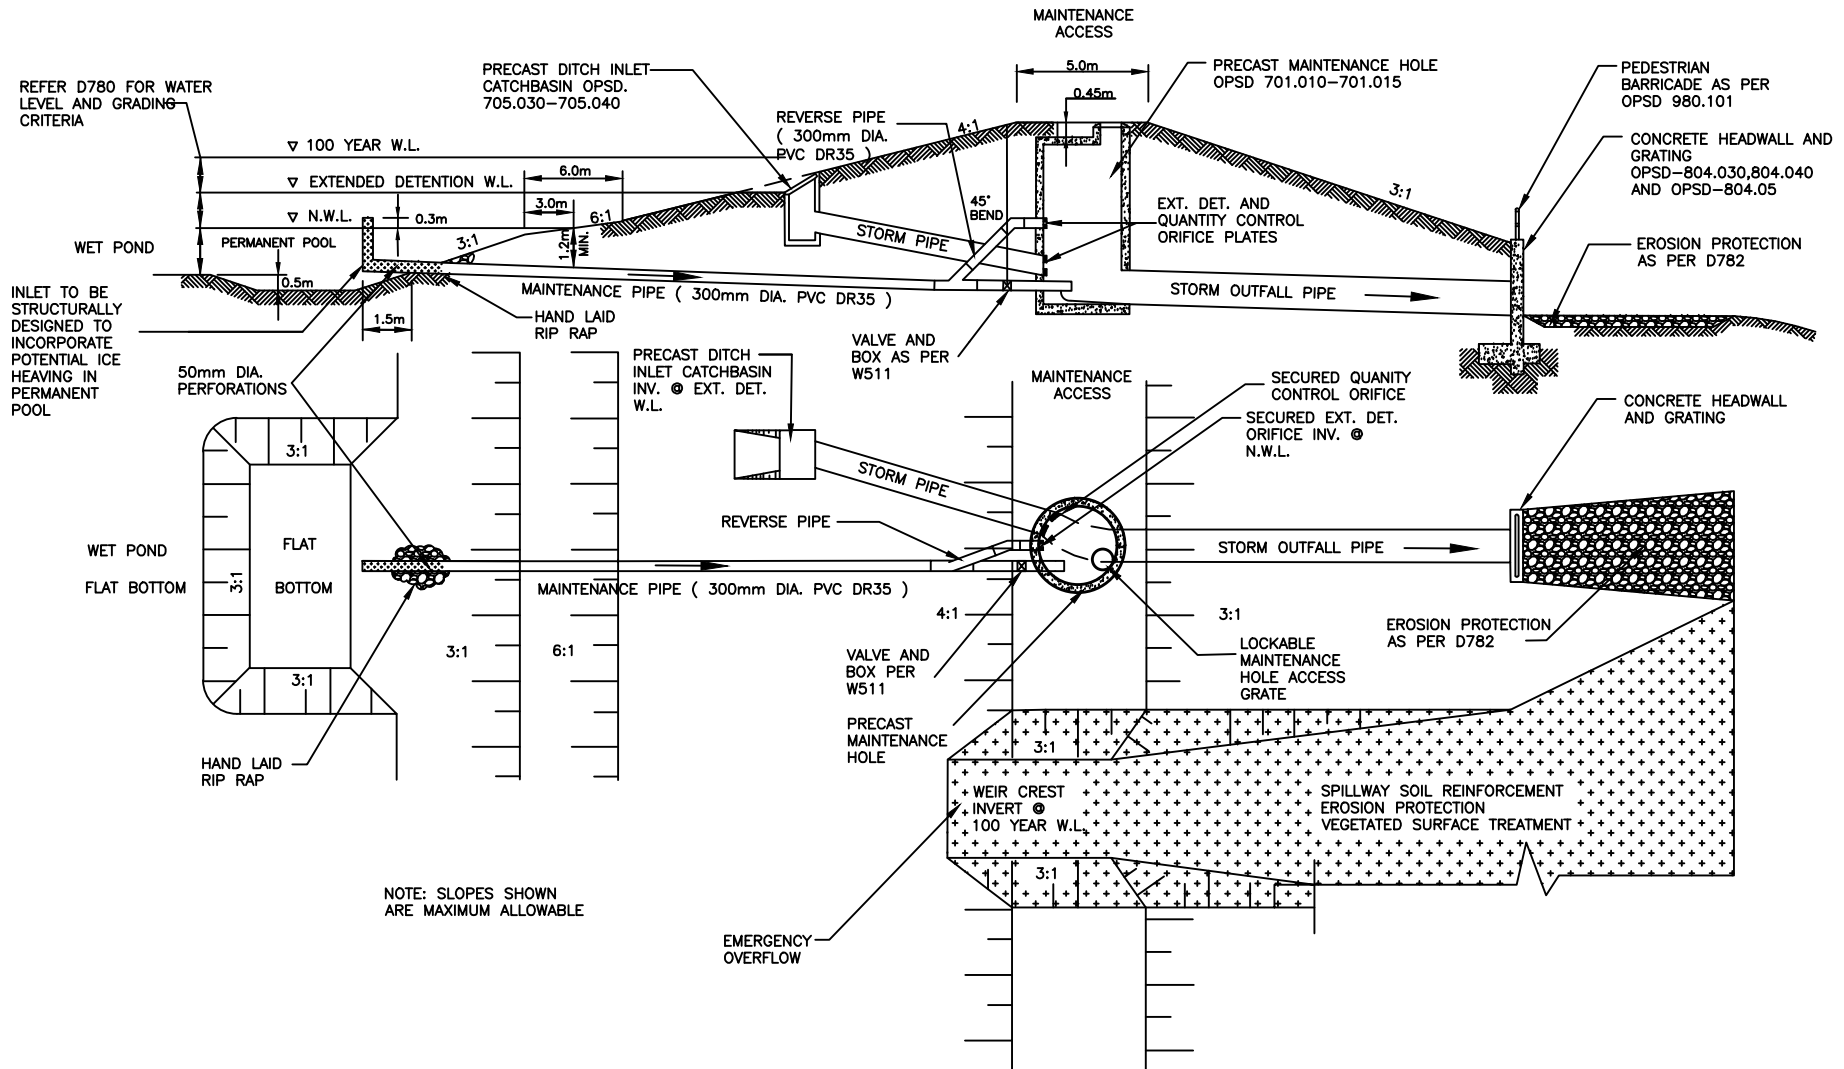

SWM Facility with Maintenance Pipe

REV No.	DATE: MAY 2024
2	SCALE: N.T.S.

D777