




DOUBLE RAMP WITHOUT BOULEVARD

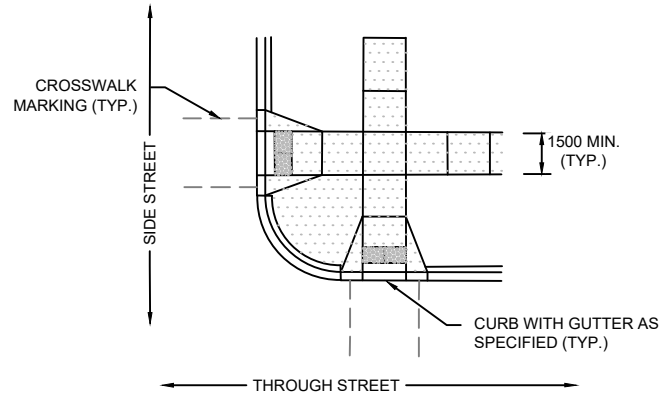


RAMPS WITH BOULEVARD

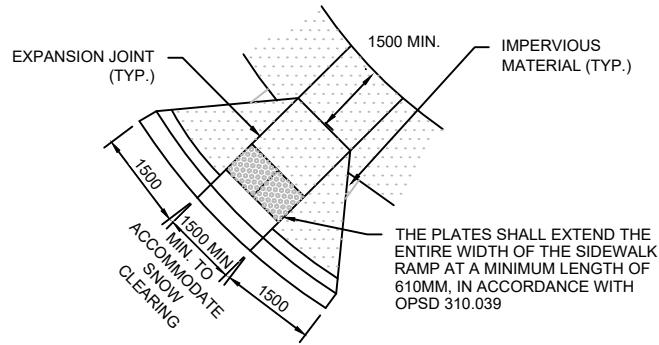

RAMP PLAN

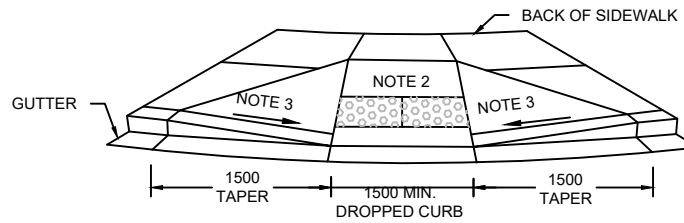

RAMP ELEVATION

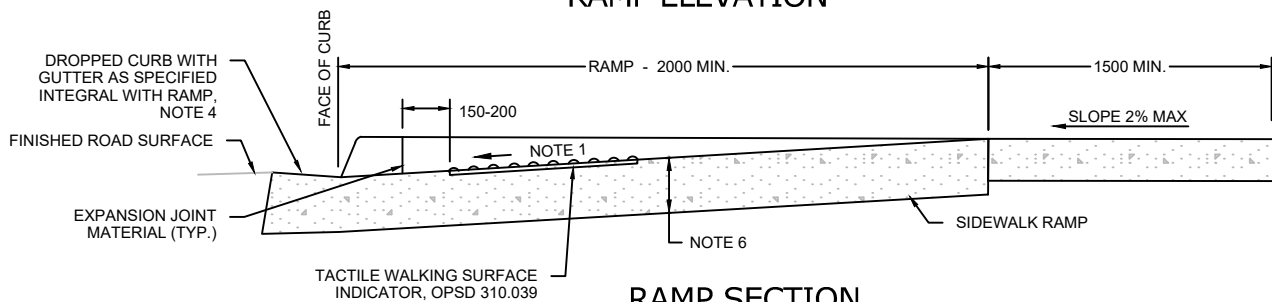

RAMP SECTION

NOTES:

1. SLOPE OF RAMP SHALL NOT EXCEED 8%
2. CROSS SLOPE OF RAMP SHALL NOT EXCEED 2% IN EITHER DIRECTION
3. CROSS SLOPE OF FLARED SIDE OF RAMP SHALL NOT EXCEED 8%
4. DROPPED CURB AT RAMP SHALL BE MODIFIED TO ELIMINATE 10mm STEP AT GUTTER LINE
5. ACCESSIBLE PEDESTRIAN SIGNAL TO HAVE TACTILE WALKING SURFACE INDICATOR THAT ALIGNS WITH DIRECTION OF CROSSWALK
6. MINIMUM THICKNESS OF RAMP IS 200mm. MINIMUM THICKNESS OF SIDEWALK AND FLARED SIDES ADJACENT TO RAMP IS 150mm.
7. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE NOTED
8. FOR CROSSWALK MARKINGS AND SIGNAGE REFER TO OTM BOOK 15



SIDEWALK RAMPS  
UNSIGNALIZED INTERSECTIONS

REV No.

DATE: APR 2023

2

SCALE: N.T.S.

R318