


SINGLE OR DOUBLE TAPERED ELLIPTICAL BRACKET AND LUMINAIRE



NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN.
2. POLES SHALL BE PLACED SO THAT HANDHOLE ORIENTATIONS ARE IN ACCORDANCE WITH OPSD 2220.01.
3. HANDHOLE WIRING CONNECTIONS TO LUMINAIRE SHALL BE MADE IN ACCORDANCE WITH OPSD 2255.020.
4. THE CITY SHALL SUPPLY THE POLE ID PLATE(S) AND THE CONTRACTOR SHALL SUPPLY THE STAINLESS STEEL STRAPPING NECESSARY FOR MOUNTING. THE CONTRACTOR SHALL CO-ORDINATE THE SUPPLY OF THE POLE ID PLATE(S) WITH THE CITY OF BARRIE'S TRAFFIC SERVICES DEPARTMENT. POLE ID PLATE(S) SHALL BE INSTALLED AS PER THE CONTRACT DRAWING AND AS DIRECTED BY THE CONTRACT ADMINISTRATOR IN CONSULTATION WITH TRAFFIC SERVICES.
5. POLE ID PLATE(S) SHALL BE MOUNTED HIGHER IF THE VIEW OF THE PLATE IS OBSTRUCTED.

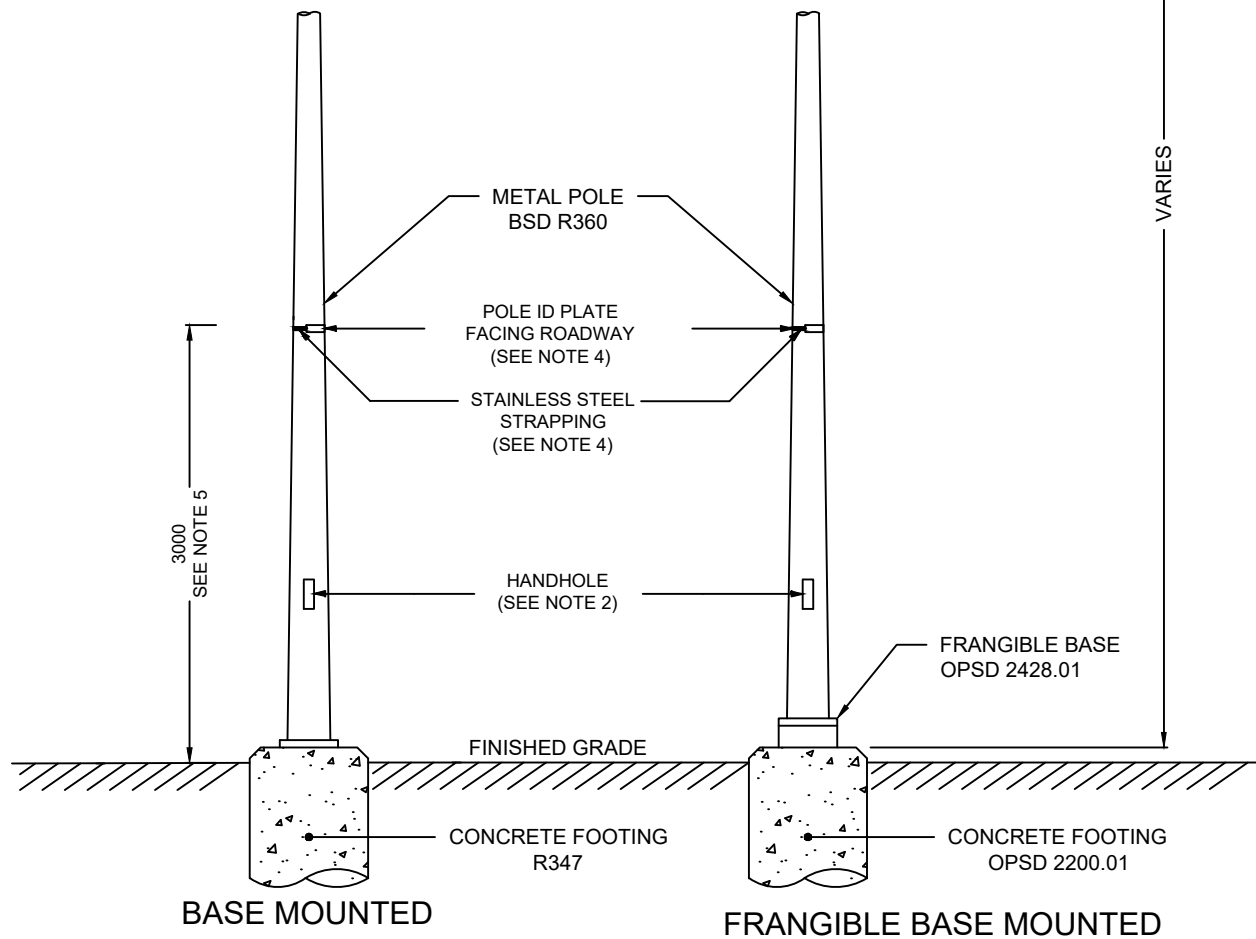

**METAL LIGHTING POLE
BASE MOUNTED**

REV No.	DATE: APR 2024
4	SCALE: N.T.S.

R335