
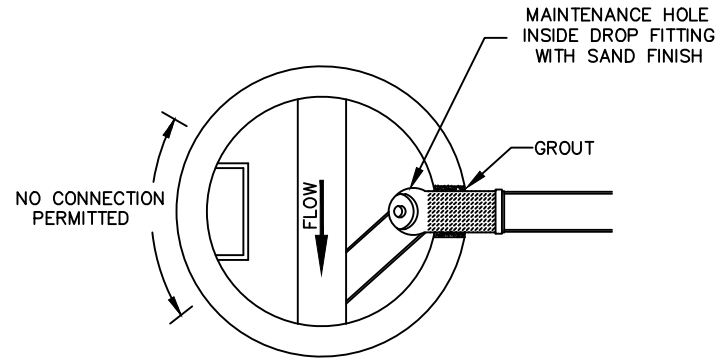


AS SPECIFIED FOR CONVENTIONAL SEWER CONNECTIONS, OWNERS ARE RESPONSIBLE FOR MAINTENANCE OF THE CONNECTION FROM THE SEWER TO THE BUILDING. THIS INCLUDES ALL FITTINGS AND PIPE FROM THE MAINTENANCE HOLE BENCHING TO THE BUILDING.

DRAWINGS SHOW A 150mm CONNECTION

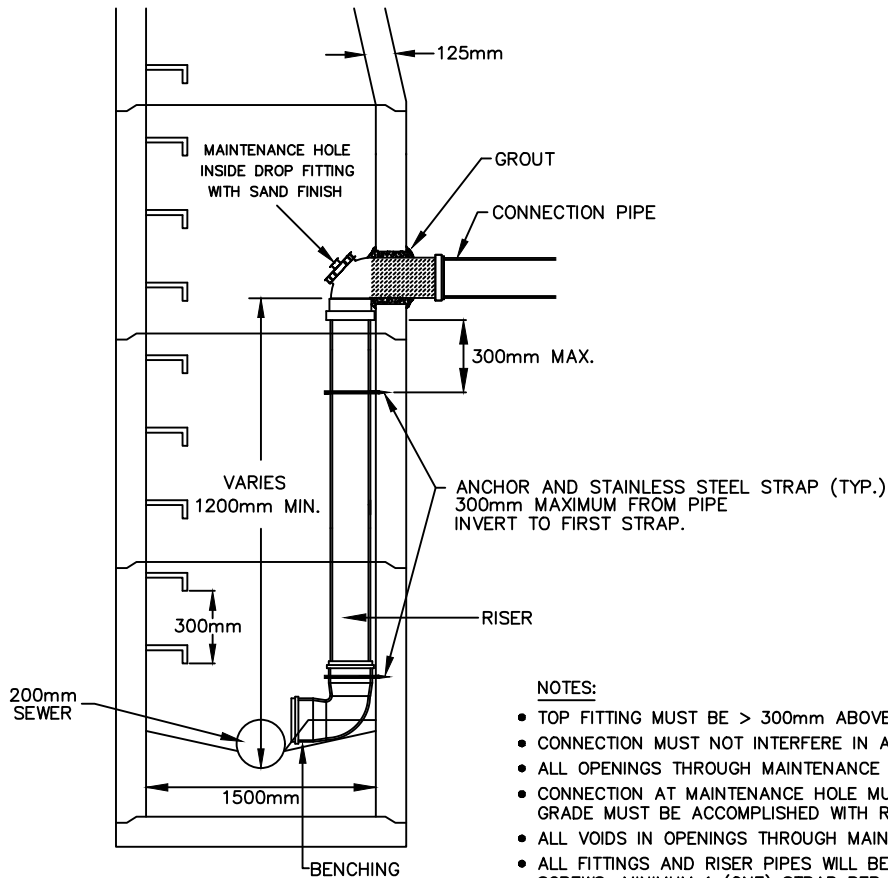

- 1 SERVICE CONNECTIONS ARE TO BE MADE TO SEWERS AS PER CITY POLICIES, UNLESS OTHERWISE APPROVED BY A CITY REPRESENTATIVE.
- 2 ALL APPLICATIONS FOR INSIDE DROP SERVICE CONNECTIONS TO MAINTENANCE HOLES MUST BE ACCOMPANIED BY A PLAN AND PROFILE DRAWING (TO SCALE) SHOWING THE PROPOSED CONNECTION ALIGNMENT, SEWER MAIN, LADDER, SAFETY GRATES AND ANY OTHER CONNECTIONS TO THE MAINTENANCE HOLE. (PROFILE MUST SHOW ENTIRE MAINTENANCE HOLE INCLUDING FRAME).

NOTES:

- TOP FITTING MUST BE > 300mm ABOVE OR BELOW SAFETY GRATES.
- CONNECTION MUST NOT INTERFERE IN ANY WAY WITH ACCESS, LADDERS NOR SAFETY GRATE USE OR OPERATION. (SAFETY GRATE ADJUSTED TO SUIT)
- ALL OPENINGS THROUGH MAINTENANCE HOLE WALLS MUST BE CORE DRILLED.
- CONNECTION AT MAINTENANCE HOLE MUST BE < 4% GRADE, AND WITHIN 30° TO PERPENDICULAR. ANY ADJUSTMENTS TO CONNECTION DIRECTION OR GRADE MUST BE ACCOMPLISHED WITH RADIUS BEND FITTINGS PER OPS.
- ALL VOIDS IN OPENINGS THROUGH MAINTENANCE HOLE WALLS MUST BE GROUTED WITH OPS APPROVED NON-SHRINK MORTAR.
- ALL FITTINGS AND RISER PIPES WILL BE SECURED TO THE MAINTENANCE HOLE WALL WITH STAINLESS STRAPPING AND 1" SCREWS; MINIMUM 1 (ONE) STRAP PER SECTION OF RISER PIPE OR FITTING.
- BENCHING MUST DIRECT FLOW WITH SEWER MAIN FLOW AND BE TO SPRING-LINE OF BOTTOM FITTING.



Maintenance Hole Inside Drop Service Connection

REV No. DATE: APRIL 2024

6

SCALE: N.T.S

S604