



Detail #1

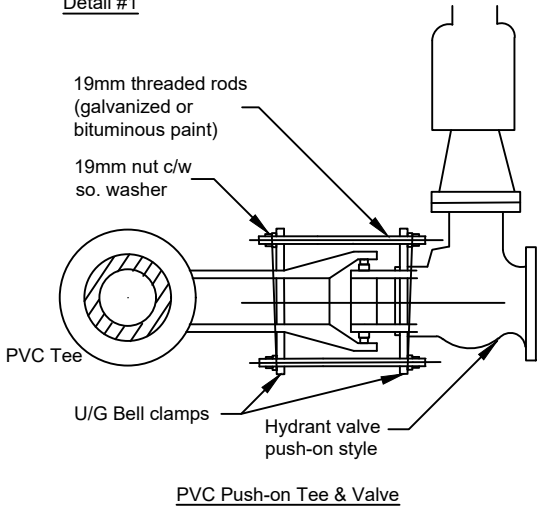

Notes:

1. To be interpreted in conjunction with the current Drinking Water Infrastructure Standard, the Verified Technologies for Drinking Water Systems list and W515 for tracer wire details.
3. See Detail #1 for PVC push-on joint.
4. All concrete thrust blocks to be poured against undisturbed ground.
5. Polyethylene bond breaker to be used between concrete and fittings.
6. Bolts for buried flange connections are to be stainless steel.
7. Hydrant lead shall be restrained from watermain to hydrant boot.

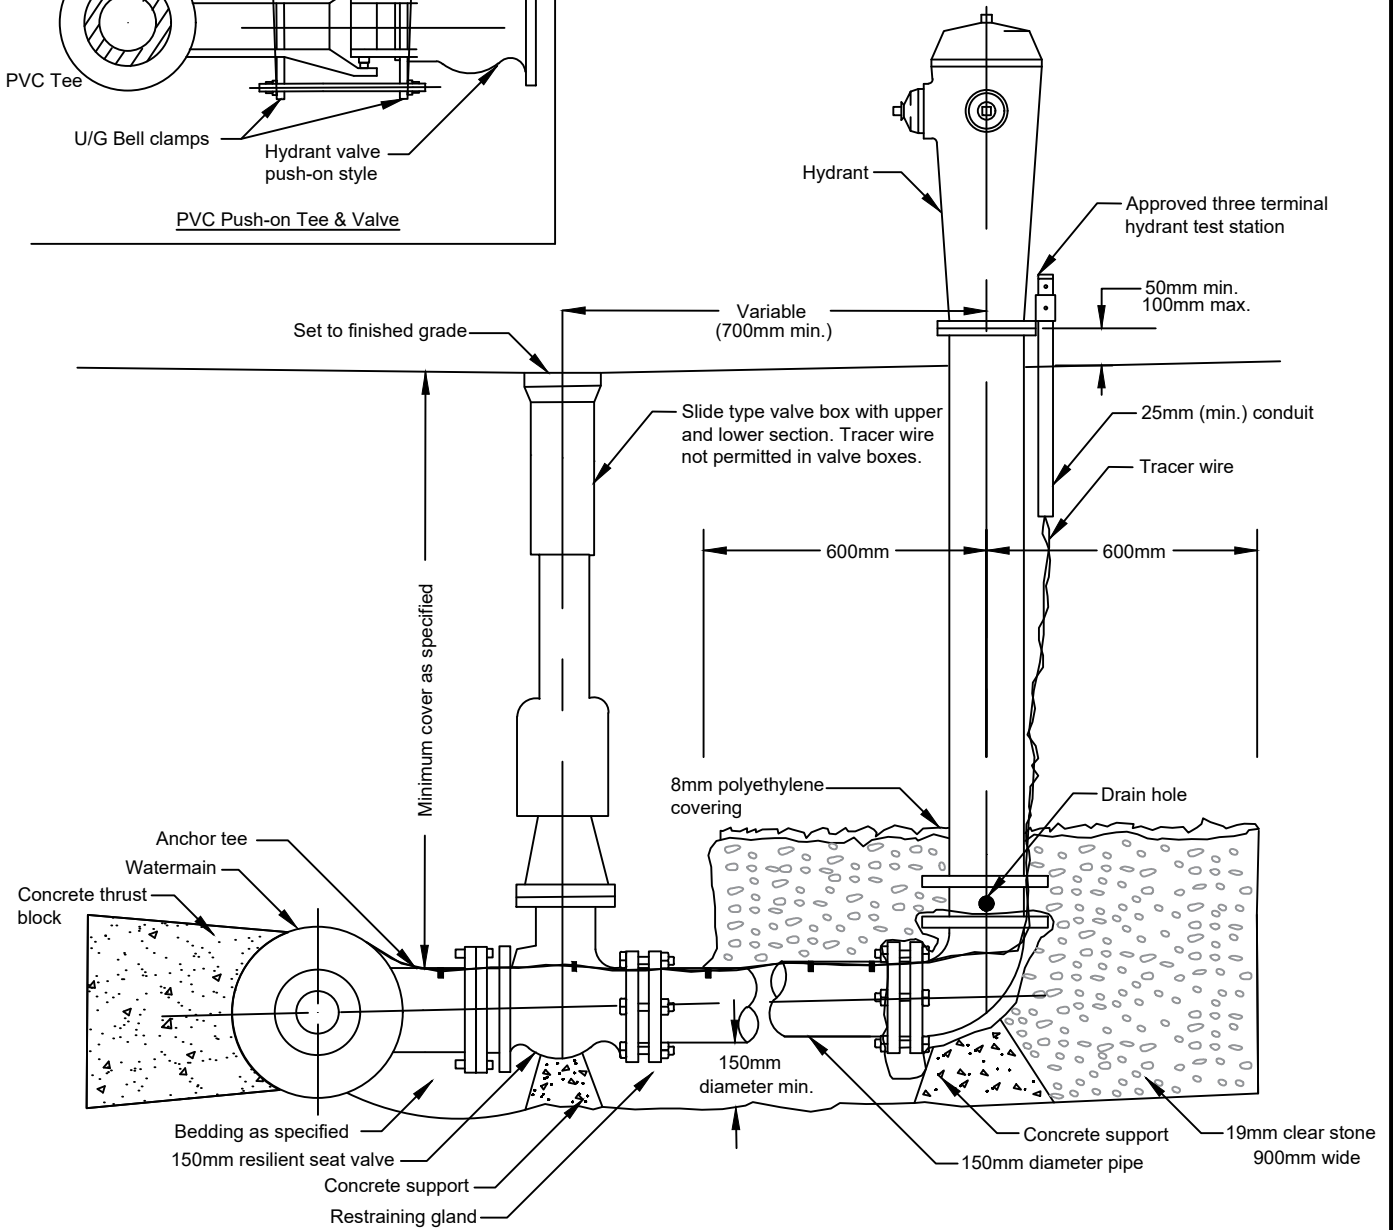

REV No.

4

DATE: APR 2024

SCALE: N.T.S



Hydrant and Valve

W507