



Option A
Service in Boulevard

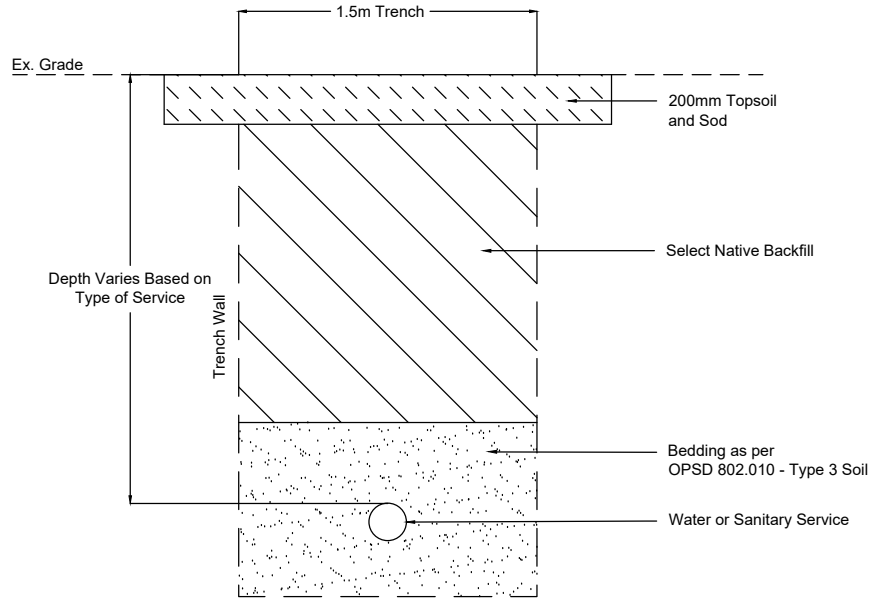

Option B
Shared Trench for Water and Sanitary
Service in Boulevard

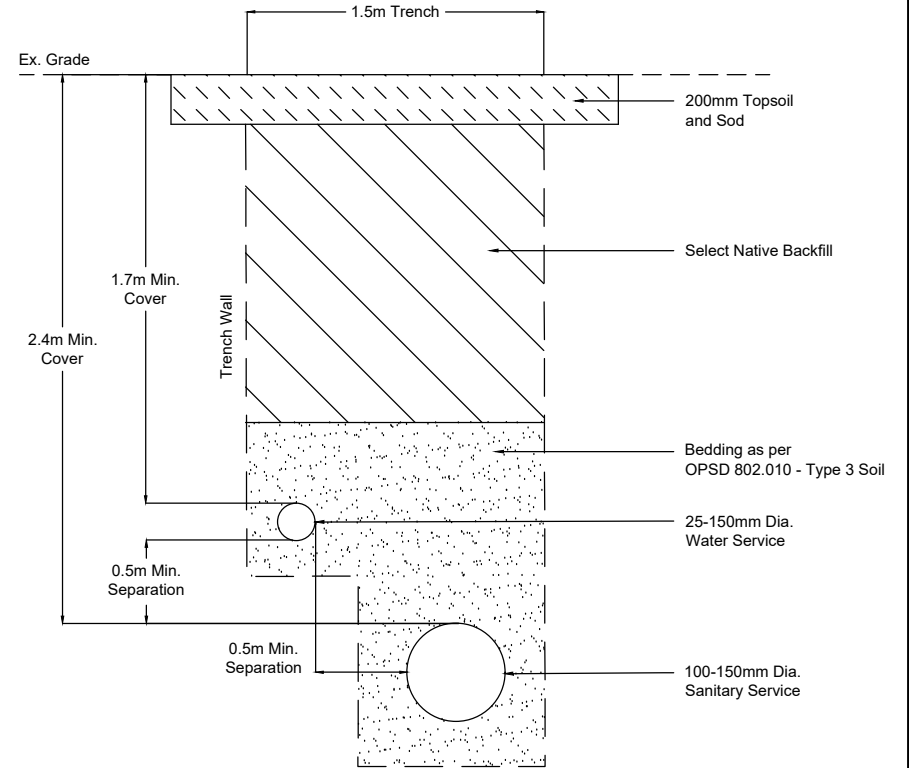

Notes:

Option A:

1. To be used in all servicing applications in conjunction with W537, Option A.
2. Separate trenches shall be used for Sanitary and Water Services with a minimum spacing of 2.5m between services.

Option B:

1. To be used in conjunction with W537, Option B.
2. Sanitary and Water services shall be installed in the same trench, provided that the elevation of the crown of the sewer maintains a minimum separation of 0.5m below the invert of the watermain.
3. The sanitary service shall be constructed of materials and with joints that are equivalent to watermain standards of construction and shall be pressure tested at a pressure of 345 kPa, with no leakage in accordance with Division 701 of the OPSS and Ontario Building Code.



Service Trenching

REV No.

DATE: January 2026

1

SCALE: N.T.S.

W542