

# **Geotechnical Investigation Report - Mapleview South Development Block A (193), Barrie, Ontario**



June 25, 2024

Prepared for:  
Mapleview South (Innisfil) Limited

Cambium Reference:19953-002

CAMBRIUM INC.

866.217.7900

[cambium-inc.com](http://cambium-inc.com)

## Table of Contents

<b>1.0</b>	<b>Introduction.....</b>	<b>1</b>
1.1	Reviewed Documents .....	2
1.2	Standards and Guidelines .....	2
<b>2.0</b>	<b>Site and Project Description .....</b>	<b>3</b>
2.1	Site Description .....	3
2.2	Project Description .....	3
<b>3.0</b>	<b>Methodology .....</b>	<b>4</b>
3.1	Borehole Investigation.....	4
3.2	Site Survey .....	5
3.3	Physical Laboratory Testing .....	5
<b>4.0</b>	<b>Subsurface Conditions .....</b>	<b>6</b>
4.1	Regional Geology.....	6
4.2	Surface Soils .....	6
4.3	Non-Cohesive Native Deposits.....	8
4.4	Bedrock .....	9
4.5	Groundwater.....	9
<b>5.0</b>	<b>Geotechnical Considerations.....</b>	<b>11</b>
5.1	Project Assumptions.....	11
5.2	Site Preparation.....	11
5.3	Frost Penetration.....	12
5.4	Excavations and Shoring.....	12
5.5	Groundwater Control and Dewatering .....	14
5.6	Foundation Design .....	15
5.6.1	Conventional Footings.....	15
5.6.2	Foundations on Engineered Fill.....	18
5.6.3	Subdrainage and Floor Slabs .....	18

5.7	Backfill and Compaction .....	19
5.7.1	Engineered Fill .....	20
5.8	Buried Utilities .....	22
5.9	Lateral Earth Pressure .....	22
5.9.1	Earthquake-Induced Pressures .....	23
5.9.2	Shoring Design .....	24
5.10	Seismic Site Classification .....	25
5.11	Pavement Design .....	25
<b>6.0</b>	<b>Report Limitations .....</b>	<b>27</b>
6.1	Design Review and Inspections .....	27
6.2	Changes in Site and Project Scope .....	27
<b>7.0</b>	<b>Closing .....</b>	<b>28</b>
<b>8.0</b>	<b>Standard Limitations .....</b>	<b>29</b>

## List of Tables

Table 1	Extent of Possible Imported Fill or Disturbed/Reworked Soils .....	8
Table 2	Particle Size Distribution – Non-Cohesive Deposits .....	9
Table 3	Groundwater and Caving Observations During Drilling .....	10
Table 4	Preliminary Bearing Capacities for Foundations on Native Soils .....	16
Table 5	Preliminary Bearing Capacities for Retaining Wall Foundations on Native Soils	17
Table 6	Lateral Earth Pressure Coefficients .....	23
Table 7	Minimum Pavement Structure .....	26

## List of Appended Figures

Figure 1	Site Location Plan
Figure 2	Borehole Location Plan



## **List of Appendices**

Appendix A Borehole Logs

Appendix B Physical Laboratory Testing Results

## 1.0 Introduction

Cambium Inc. (Cambium) was retained by Mapleview South (Innisfil) Limited (Client) to complete a geotechnical investigation in support of the detailed design of a medium density block identified as Block A or Block 193 at 953 Mapleview Drive East in Barrie, Ontario (Site).

The purpose of the field work and testing was to obtain information on the general subsurface soil and groundwater conditions at the Site by means of a limited number of boreholes and laboratory tests. Based on an interpretation of the data available for this Site, this report provides engineering comments, recommendations, and parameters for the geotechnical design aspects of the project, including selected construction considerations which could influence design decisions. It should be noted that this report addresses only the geotechnical (physical) aspects of the subsurface conditions at the Site.

This report provides the results of the geotechnical exploration and testing and should be read in conjunction with the “*Standard Limitations*” in Section 8.0 which forms an integral part of this document. The reader’s attention is specifically drawn to this information, as it is essential for the proper use and interpretation of this report. The data, interpretations and recommendations contained in this report pertain to a specific project as described in the report and are not applicable to any other project or site location. If the project is modified in concept, location, or elevation, or if the project is not initiated within eighteen months of the date of the report, Cambium should be given an opportunity to confirm that the recommendations in this report are still valid.

A previous geotechnical investigation was completed by Cambium in 2018 within the property extents of the entire parcel of 953 Mapleview Drive West to confirm subsurface conditions across the Site with the findings, the recommendations and results from that investigation summarized under a separate cover (Cambium Ref. No.: 7468-001) [1].

## 1.1 Reviewed Documents

The following project documents were received and reviewed during the drafting of this report:

[1] Cambium Inc. – Barrie, Ontario

Geotechnical Investigation Report – Mapleview South Development, Mapleview Drive East, City of Barrie, Ontario, Project Number: 7468-001; December 5, 2018.

[2] Cambium Inc. – Barrie, Ontario

Monthly Groundwater Levels Letter – Mapleview South Development, 953 Mapleview Drive East, Barrie, Ontario, Project Number: 7468-001; April 18, 2019.

[3] Cambium Inc. – Barrie, Ontario

Monitoring Well Installation Summary Letter – Mapleview South Development, 953 Mapleview Drive East, Barrie, Ontario, Project Number: 19953-001; June 12, 2024.

[4] Jones Consulting Group Ltd – Barrie, Ontario

Mapleview South (Innisfil) Ltd., Block 193 Preliminary Grading Plan, Project REI-17055, Drawing No. GP-1, May 2023.

[5] Jones Consulting Group Ltd. – Barrie, Ontario

Mapleview South (Innisfil) Ltd., Block 193 Preliminary Servicing Plan, Project REI-17055, Drawing No. GS-1, May 2023.

[6] S & C Architects Inc. – Ajax, Ontario

Mapleview South (Innisfil) Ltd., 953 Mapleview Drive - Block 193 Site Plan, Project No.: 2023-05; 1:200; Drawing No.: A-101, March 2023.

## 1.2 Standards and Guidelines

Applicable standards, guidelines and other normative documents utilized in preparing geotechnical engineering recommendations for this report are provided below.

[7] Canadian Foundation Engineering Manual – 4<sup>th</sup> Edition; Canadian Geotechnical Society; 2006.

[8] National Building Code of Canada – Natural Resources Canada; 2015

## 2.0 Site and Project Description

### 2.1 Site Description

The Site within Block A consists of an undeveloped area which has undergone grading and earthworks within the parcel footprint relatively recently. The parcel has an area of approximately 0.63 hectares and is bound by Mapleview Drive East to the north and undeveloped lands in all other directions.

A Site Location Plan is provided as Figure 1 of this report for reference.

### 2.2 Project Description

As per information provided by the Client [4], [5], [6], Block A will consist of a single five-storey building containing 100 units, one level of underground parking, surface parking, a stormwater infiltration gallery and a structural retaining wall. The development will be accessed from the southwest corner of the Site.

## 3.0 Methodology

### 3.1 Borehole Investigation

Four boreholes were advanced throughout the Site on May 8, 2024, at predetermined locations confirmed with the Client to assess the subsurface conditions. The boreholes were designated as BH401-24 to BH404-24 and were terminated at depths ranging from 5.1 m below ground surface (mbgs) to 8.2 mbgs.

A Borehole Location Plan is provided as Figure 2 of this report for reference.

Drilling and sampling were completed using a track-mounted drill rig operating under the supervision of a Cambium technician. The boreholes were advanced to the sampling depths by means of continuous flight solid stem augers using conventional 38-millimetre (mm) internal diameter split spoon sampling equipment driven by an automatic hammer in accordance with the SPT procedures outlined in ASTM International standard D1586: "Standard Test Method for Standard Penetration Test (SPT) and Split-Barrel Sampling of Soils". SPT "N"-values were recorded for the sampled intervals as the number of blows required to drive a split spoon sampler 305 mm into the soil, using a 63.5 kg drop hammer falling 750 mm, as per ASTM D1586 procedures. The split-spoon samplers used in the investigation limit the maximum particle size that can be sampled and tested to about 40 mm. Therefore, particles or objects that may exist within the soils that are larger than this dimension were not sampled and are not represented in the grain size distributions contained herein. The results of the field tests (i.e., SPT "N" -values) as presented on the Record of Borehole sheets and in subsequent sections of this report are the values measured directly in the field and are unfactored.

The SPT N values are used in this report to assess consistency of cohesive soils and relative density of non-cohesive soils. Soil samples were collected at approximately 0.75 m intervals up to a depth of 3.0 mbgs and at 1.5 m intervals thereafter.

Groundwater and caving conditions were noted in the open boreholes during and upon completion of drilling. All boreholes were backfilled and sealed in accordance with Ontario

Regulation (O.Reg.) 903, as amended, and the property was reinstated to pre-existing conditions.

The field work for this investigation was observed by members of Cambium's technical staff, who located the boreholes in the field, arranged for the clearance of underground utilities, observed the borehole drilling, sampling and in situ testing operations, logged the boreholes as well as examined and took custody of the recovered soil samples. The samples were identified in the field, placed in appropriate containers, labelled, and transported to our geotechnical laboratory for further visual examination by the project engineer and for laboratory testing.

The prepared borehole logs are provided in Appendix A. Site soil and groundwater conditions and our geotechnical recommendations are presented in the following sections of this report.

### **3.2 Site Survey**

The elevations and coordinates for all boreholes were obtained using a GNSS receiver during a survey following the completion of drilling. A topographic survey was provided by the Client and the benchmark utilized for this survey was the fire hydrant flange located on the north side of Mapleview Drive East with a geodetic elevation of 260.96 metres above sea level (mASL).

### **3.3 Physical Laboratory Testing**

Physical laboratory testing, including three particle size distribution analyses (LS-702, 705), was completed on selected soil samples to confirm textural classification and to assess geotechnical parameters. Natural moisture content testing (LS-701) was completed on all retrieved soil samples. The physical laboratory testing results are presented in Appendix B and are discussed in Section 4.0.

## 4.0 Subsurface Conditions

The stratigraphy encountered in the boreholes is indicated on the attached borehole logs in Appendix A. It is noted that the conditions indicated on the borehole logs are for specific locations only and can vary between and beyond the borehole locations. The soil boundaries indicated on the borehole logs are inferred from non-continuous sampling and observations during drilling. These boundaries are intended to reflect approximate transition zones and should not be interpreted as exact planes of geological change. In addition, the descriptions provided in the borehole logs are inferred from a variety of factors, including visual observations of the soil samples retrieved, laboratory testing, measurements prior to and after drilling, and the drilling process itself (drilling speed, shaking/grinding of the augers, etc.).

In general, the encountered subsurface conditions consist of either surficial engineered fill or reworked native deposits which transitioned to undisturbed native deposits. The native deposits at the Site generally consisted of non-cohesive silty sand to sand soils interbedded. Bedrock was not encountered during this investigation.

### 4.1 Regional Geology

Ontario Geological Survey (OGS) quaternary geologic mapping indicates that the Site is projected to fall within the Newmarket till formation, which includes sandy silt to silt matrix, moderate to high matrix carbonate content and clast content moderate to high. This mapping indicates that the material expected to be encountered at the site should be relatively consistent, and the main difference between any materials at site would be the mechanism for which they were deposited.

Physiographic mapping (Chapman, L.J. & Putnam, D.F., 2007) shows the Site within the till plains (drumlinized) formation.

### 4.2 Surface Soils

A surficial layer of reworked native or engineered fill was encountered in all boreholes advanced at the Site. The Site has undergone grade alterations throughout since the 2018

geotechnical investigation conducted by Cambium. The earthworks generally consisted of the import and placement of engineered fill throughout the Site. Cambium conducted full time inspection and compaction testing during the placement of engineered fill in 2019 and 2020 (Cambium reference number: 7468-002). The inspection reports, fill placement locations, and compaction testing results were provided to the Client at the time of the inspections. Within the areas of where the boreholes were advanced in, there is no record of engineered fill being placed and inspected by Cambium. However, based on visual observations, the existing ground conditions were disturbed and had evidence of being disturbed by construction equipment. Therefore, with the constant movement of the existing native material or imported fill materials, encountering disturbed or reworked native soils within the first few metres of each borehole advanced at the Site is a possibility. The composition of the non-cohesive imported fill or disturbed/reworked native materials ranged from a silty sand to sandy silt material in all boreholes advanced at the Site. The soils were predominantly brown to grey in colour and were generally moist during the investigation.

SPT N values within disturbed/reworked native deposits generally ranged between 6 and 9, indicating loose relative density. Organics were noted within the imported fill or disturbed/reworked native soils of BH401-24 to BH403-24; which are mostly present from the caved material due to the drilling method (i.e., use of solid stem augers).

Natural moisture contents in the non-cohesive deposits ranged between 8.3% and 15.9% based on laboratory testing.

A summary of the composition, relative density, and extent of the reworked or disturbed deposits encountered within each of the boreholes is provided below in Table 1.

**Table 1 Extent of Possible Imported Fill or Disturbed/Reworked Soils**

Borehole ID	Soil Composition	Relative Density or Consistency	Encountered Disturbed or Reworked Layer(s) mbgs / mASL1	Approximate Thickness of Disturbed or Reworked Layer(s) (m)
BH401-24	Sandy Silt	Loose	Surface / 260.6	0.8
BH402-24	Silty Sand	Compact	Surface / 259.9	1.5
BH403-24	Sandy Silt	Loose	Surface / 260.5	0.8
BH404-24	Silty Sand	Loose	Surface / 257.5	1.5

<sup>1</sup>Approximate depth/elevation inferred from non-continuous sampling.

#### 4.3 Non-Cohesive Native Deposits

Deposits of undisturbed non-cohesive native soils were encountered beneath the upper disturbed layers within all the boreholes advanced at the Site. The non-cohesive native deposits varied in composition from a sand to a silty sand material with varying amounts of gravel and clay and extended to the termination depths ranging from 5.1 mbgs to 8.2 mbgs.

The non-cohesive deposits were generally brown to grey in colour and noted as moist to wet at the time of the investigation with natural moisture contents ranging from 7% to 15%.

The SPT N values recorded within non-cohesive native deposits ranged from 15 to 90 blows, indicating a compact to very dense relative density.

Laboratory particle size distribution analyses were completed for three samples in the non-cohesive soils layer to assess the soil composition. The testing results are provided in Appendix B and are summarized in Table 2 based on the USCS.

**Table 2 Particle Size Distribution – Non-Cohesive Deposits**

Sample ID	Depth (mbgs)	Description	% Gravel	% Sand	% Silt	% Clay	% Moisture Content
BH401-24 SS7	6.1 – 6.7	Sand some Gravel some Silt some Clay	15	59	15	11	9.3
BH403-24 SS6	4.6 – 5.2	Silty Sand some Clay trace Gravel	5	45	32	18	8.0
BH403-24 SS4	2.3 – 2.9	Silty Sand some Clay trace Gravel	7	47	30	16	9.1

#### 4.4 Bedrock

Bedrock was not confirmed in any of the boreholes advanced by Cambium at the Site. The boreholes were terminated depths ranging from 5.1 mbgs to 8.2 mbgs, corresponding to absolute elevations between 251.76 mASL and 253.93 mASL.

#### 4.5 Groundwater

The encountered soils were predominantly described as being moist to wet throughout the borehole investigation. No saturated soils (by visual observation) were noted.

Groundwater (free water) was observed in all boreholes upon completion of drilling, at depths ranging from 4.6 mbgs to 6.6 mbgs. Caving (sloughing) was observed in BH401-24, BH403-24 and BH404-24 boreholes at depths ranging from 5.8 mbgs to 7.6 mbgs. The groundwater level observations in the boreholes are not representative of the stabilized groundwater conditions and as such, the groundwater table elevation will vary. The groundwater and caving observations are summarized below in Table 3

**Table 3 Groundwater and Caving Observations During Drilling**

Date	Borehole	Borehole Elevation (mASL)	Groundwater in Borehole upon Completion (mbgs)	Elevation of Groundwater in Borehole upon Completion (mASL)	Caving Depth (mbgs)
May 8, 2024	BH401-24	260.55	5.0	255.55	5.8
	BH402-24	259.96	5.0	254.96	- <sup>1</sup>
	BH403-24	260.53	6.6	253.93	6.9
	BH404-24	259.02	4.6	254.42	7.6

<sup>1</sup> – caving not observed upon completion of drilling

It is noted that the encountered groundwater levels reflect the groundwater conditions in the boreholes at the time of the borehole investigation. Groundwater levels at the Site may be anticipated to vary between and beyond the borehole locations and to fluctuate with seasonal variations in precipitation and snowmelt.

## 5.0 Geotechnical Considerations

This section of the report provides engineering information on, and recommendations for, the geotechnical design aspects of the project based on our interpretation of the borehole information, the laboratory test data, and our understanding of the project requirements. The information in this portion of the report is provided for planning and design purposes for the guidance of the design engineers and architects. Where comments are made on construction, they are provided only to highlight aspects of construction which could affect the design of the project. Contractors bidding on or undertaking any work at the Site should examine the factual results of the investigation, satisfy themselves as to the adequacy of the information for construction and make their own independent interpretation of the factual data as it affects their proposed construction techniques, schedule, equipment capabilities, costs, sequencing, and the like. Cambium will not assume any responsibility for construction-related decisions made by contractors based on this report.

### 5.1 Project Assumptions

Based on information provided by the Client, [4], [5], [6], it is understood that development within Block A will consist of a single five-storey building containing 100 units, one storey of underground parking, surface parking, a stormwater infiltration gallery and a structural retaining wall. The finished floor elevation of the parking structure is 258.47 mASL with the finished floor elevation of the ground level to be 262.91 mASL. The retaining wall structure height ranges from 0.2 m to 3.9 m depending on the existing topography throughout the Site.

### 5.2 Site Preparation

Existing topsoil and organic material, any loose reworked/disturbed native materials, and any deleterious material (i.e., imported fill material, construction debris, fibrous material, asphalt, brick fragments, etc.) encountered should be excavated and removed beneath proposed development areas prior to construction. Additionally, this material should be excavated and removed to a minimum distance of 3 m around the building footprint. Any topsoil and materials with significant quantities of organics and deleterious materials are not appropriate for use as

fill. As earthworks are being conducted at the site, most topsoil has been removed from the site and the minor amounts of organic material remaining at surface can be removed during foundation preparation excavations.

The exposed subgrade should be proof-rolled and inspected by a qualified geotechnical engineer prior to placement of any granular fill or foundations. Any loose/soft soils identified at the time of the proof-rolling that are unable to uniformly be compacted should be sub-excavated and removed.

The excavations created through the removal of these materials should be backfilled with approved engineered fill consistent with the recommendations provided below.

The near surface soils can become unstable if wet or saturated. Such conditions are common in the spring and late fall. Under these conditions, temporary use of granular fill, and possible separating/reinforcing geotextiles, may be required to prevent severe rutting on construction access routes.

### **5.3 Frost Penetration**

Based on climate data and design charts, the maximum frost penetration depth below the surface at the Site is estimated at 1.5 mbgs. Exterior footings for the proposed structure should be situated at or below this depth for frost penetration or should be appropriately protected. Any services should be located below this depth or be sufficiently insulated.

### **5.4 Excavations and Shoring**

Based on the information provided by the Client, the proposed development will have one level of underground parking. At the time of drafting this report, the finished floor elevation (FFE) of the parking structure is 258.47 mASL. With the existing grade at the time of the investigation at the Site ranging from 261.0 mASL to 260.5 mASL, a minimum excavation depth of at least 2.5 mbgs should be assumed for the construction of foundations. If alterations to the proposed development are made, Cambium should be contacted to revise the following recommendations.

Based on [2], and the information provided by the Client, the high groundwater table is within the proposed footprint is approximately 257.72 mASL within the proposed residential structure footprint and with only one level of underground parking being proposed, impermeable shoring for the proposed structure is likely not required. It should also be noted that the groundwater level in the southern portion of the Site is approximately 255.70 mASL.

If a shoring design is conducted for the proposed parking garage, the lateral earth pressures found in Section 5.9 should be considered in the design. The shoring must be designed prior to construction by a qualified geotechnical engineer considering loading conditions based on the subsoil stratigraphy described above, and Cambium should be retained to conduct a plan review and make any necessary changes. It is common practice for a specialist contractor to design and install the excavation support system.

Alternatively, given the proposed excavation depths within the building footprint and the proposed building's proximity to nearby infrastructure and property lines, consideration should be given to conducting unsupported excavations carried out in accordance with the latest edition of the Occupational Health and Safety (OHSA) may be used.

Unsupported dry excavations according to OHSA should not exceed 3 m in depth. For any unsupported excavations with a depth greater than 3 m, slope stability analysis and whether other measures (benching, support/shoring, etc.) are necessary. In addition, the crest of unsupported excavation slopes should not be subjected to loading (i.e., due to stockpiling). If excavation slopes are to be developed in close proximity to property lines (such as along the northern property line), a geotechnical engineer should be retained to conduct slope stability analysis and confirm any additional requirements.

In the areas of the Site where unsupported excavations to the required depths are deemed feasible, the excavations must be carried out in accordance with the latest edition of OHSA and Ontario Regulation 213/91 (as amended). For practical purposes, the overburden soils at the Site above the groundwater table and within continually dewatered depths can be considered Type 3 soils, as such, excavation side slopes should be no steeper than 1H:1V.

Soils below the groundwater table should be treated as Type 4 soils and therefore excavation unsupported side slopes should be decreased to 3H:1V in these areas.

Excavation slopes should be protected during construction from precipitation, runoff, or snow/ice melt and should be inspected regularly for signs of instability. If localized instability is noted during excavation or if wet conditions are encountered, the side slopes should be flattened as required to maintain safe working conditions or the excavation sidewalls must be fully supported (shored).

## 5.5 Groundwater Control and Dewatering

Groundwater (free water) were observed in the boreholes advanced throughout the Site upon completion of drilling at depths as high as 4.6 mbgs. During the water level monitoring events conducted from May 2018 to April 2019 which are summarized in [2], the groundwater elevation measured in the monitoring wells within or adjacent to Block A were recorded at elevations ranging from 255.7 to 257.7 mASL. As such, excavations are not expected to encounter significant groundwater seepage.

It is unlikely that excavations to the provided foundation elevations will encounter significant groundwater seepage. It can be anticipated that the groundwater seepage, if encountered, should be controllable with filtered sumps and pumps.

If deeper excavations are planned for the site, Cambium should be notified as it is likely that excavations extending below approximately 257.7 mASL (within the northern section) and 255.7 mASL (southern section of the Site) will encounter groundwater and will require more extensive dewatering. Dewatering methods must ensure that the water table is drawn down to at least 1 m below the base of the excavation, prior to the excavations reaching the base level, to reduce the potential for loosening of the excavation base due to seepage pressures.

Further, care should be taken to direct surface water away from the open excavations.

Excavations extending below the groundwater table through, or in, saturated non-cohesive deposits will require the use of positive dewatering in the form of perimeter trenching with sumps and pumps, and/or well points, and/or eductors. The dewatering system is the

Contractor's responsibility and the rate and volume required for dewatering is dependent on the construction methods and staging chosen by the contractor.

Water takings in excess of 50 m<sup>3</sup>/day are regulated by the (Ministry of the Environment, Conservation and Parks (MECP). Certain takings of groundwater and storm water for construction site dewatering purposes with a combined total less than 400 m<sup>3</sup>/day qualify for self-registration on the MECP's Environmental Activity and Sector Registry ("EASR"). Registry on the EASR replaces the need to obtain a PTTW and a Section 53 approval. A Category 3 PTTW is required where the proposed water taking is greater than 400 m<sup>3</sup>/day.

It is noted that the elevation of the groundwater table will vary due to seasonal conditions and in response to heavy precipitation events and should be expected to be notably higher in the spring (i.e., March to June). To minimize predictable water issues and costs, it is recommended that the excavation and in ground construction be performed in drier seasons.

## 5.6 Foundation Design

It is understood that the proposed development at the Site will consist of a five-storey residential building with one level of underground parking. The elevations of the finished floors were provided in Section 5.1. It is assumed that the building will be constructed on shallow footings. Cambium should be contacted if alternative design recommendations are required. All exterior foundations must be provided with a minimum of 1.5 m of earth cover for frost protection or alternative equivalent insulation.

### 5.6.1 Conventional Footings

From a geotechnical perspective, conventional shallow footings placed on competent native soils may be used to transfer loads from the proposed structures to the soils below. In general, the compact to very dense non-cohesive soils encountered below a depth of 1.5 mbgs throughout the Site are considered competent to directly support loads from shallow footings.

Design and construction recommendations for potential foundation systems are outlined below. Foundations for such structures at this site may consist of shallow spread or strip footings founded directly on native, undisturbed soils. It is understood that the Site may be

regraded, and our foundation recommendations may change depending upon the final grades. Cambium should be contacted to review the final grading plan and provide any necessary changes to the foundation recommendations outlined below.

From a geotechnical perspective, the proposed structures can be supported on standard strip and/or spread footings founded on competent native soils (sand to silty sand, compact to very dense relative density). Table 4 gives design geotechnical bearing capacities for serviceability limit state (SLS) and ultimate limit state (ULS) based on geotechnical principles outlined in Section [7] for shallow foundations bearing on native soils. The bearing capacities provided below are within the native dense to very dense soil stratigraphy in which the footings are to be placed.

**Table 4 Preliminary Bearing Capacities for Foundations on Native Soils**

Borehole	Soil Description	Depth (mbgs)	Elevation (mASL)	Maximum Geotechnical Reaction SLS (kPa)	Maximum Geotechnical Reaction ULS (kPa)
BH401-24	Silty Sand to Sand	Below 2.3	Below 258.3	175	225
BH402-24	Silty Sand to Sand	Below 2.0	Below 258.0	175	225
BH403-24	Sand to Silty Sand	Below 2.5	Below 258.0	175	225

*Note: assumes all foundations provided with at least 1.5 m of adjacent earth cover*

As the actual soil bearing resistances are related to the actual footing sizes and founding depths, the foundation recommendations must be reviewed by Cambium once the building details are finalized and, as such, the recommendation provided above should be considered preliminary.

Total and differential settlements are expected to be less than 25 mm and 10 mm, respectively. All footings should be stepped along an imaginary line of 7 vertical to 10 horizontal (7V:10H) or flatter where variable founding levels take place.

For the retaining wall, the proposed structure can be supported on shallow foundations on competent native soils (sand to silty sand, compact to very dense relative density). Table 5

gives design geotechnical bearing capacities for serviceability limit state (SLS) and ultimate limit state (ULS) based on geotechnical principles outlined in Section [7] for shallow foundations bearing on native soils.

**Table 5 Preliminary Bearing Capacities for Retaining Wall Foundations on Native Soils**

Borehole	Soil Description	Depth (mbgs)	Elevation (mASL)	Maximum Geotechnical Reaction SLS (kPa)	Maximum Geotechnical Reaction ULS (kPa)
BH404-24	Sand to Silty Sand	1.5 – 3.0	249.9 – 256.0	125	150
		Below 3.0	Below 256	175	225

Prior to placing foundation concrete, the foundation subgrade should be cleaned of all deleterious materials such as boulders, organics, rubble, unsuitable fill, softened, disturbed or caved materials as well as any standing water. If construction proceeds during freezing weather conditions, adequate temporary frost protection for the founding subgrade and placed concrete must be provided.

All foundation components must be evaluated by a qualified geotechnical engineer to ensure that founding soils exposed in the base of the excavation are consistent with the recommended design bearing pressure intended by the geotechnical engineer.

If stepped spread footings are constructed at different founding levels, the difference in elevation between individual footings should not be greater than one half the clear distance between the footings (2H:1V or gentler). Should this not be possible, Cambium should be consulted to provide field inspection to ensure that the footings exceeding the above requirement are stable and the bearing and lateral support for the upper footing is not compromised. In addition, the lower footings should be constructed first so that if it is necessary to construct the lower footings at a greater depth than anticipated, the elevations of the upper footings can be adjusted accordingly. Stepped strip footings, if required, should be constructed in accordance with the latest edition of the Ontario Building Code (2015 OBC) [8], Section 9.15.3.9.

Cambium should be contacted to review final site grading plans and foundation dimensions and elevations, to confirm the bearing capacities provided in this report. A qualified geotechnical engineer should be retained to confirm bearing capacities onsite, following excavation to the proposed footing subgrade elevations, or to develop further recommendations such as the required depth of engineered fill pads.

### **5.6.2 Foundations on Engineered Fill**

Alternatively, in areas where the proposed founding levels are above the level of competent native soil, or where sub excavation is required, footings made to bear directly on a pad of engineered fill extending down to dense native soils and constructed per the recommendations in Section 5.7.1. From a preliminary perspective, footings placed on approved engineered fill and appropriately protected from frost may be designed for a preliminary allowable bearing capacity of 150 kPa at SLS and 200 kPa at ULS. Cambium should be retained to review the final grading plan, as the preliminary engineered fill bearing capacity values will change depending on grade raises, engineered fill thickness, material and the native subgrade soil the engineered fill pad is constructed on.

Settlement potential at the above-noted SLS loadings is less than 25 mm and differential settlement should be less than 20 mm.

If higher bearing capacities are required, Cambium should be consulted to provide further foundation recommendations (i.e., ground improvement, deep foundations, etc.). In addition, compact to dense soils were observed at varying depths and higher design bearing capacity values may be possible depending on footing elevations and location.

### **5.6.3 Subdrainage and Floor Slabs**

The guidelines below are based on the assumptions that a “drained” foundation system will be provided. These guidelines should be revisited if it is decided that the construction of the underground parking structure would be water-tight.

To prevent hydrostatic pressure from building up beneath the floor and potential groundwater infiltration, if required, it is suggested that the granular base for the floor be drained. Provision

should be made for at least 300 mm to 600 mm of geotextile (Terrafix 270R or equivalent) wrapped 19 mm diameter crushed clear stone to underlie the floor. A vapour barrier beneath the slab should be provided. Perimeter and under floor slab drainage systems would be also required for the proposed building. The perforated pipes should discharge to a positive outlet such as a storm water sewer or a sump from which the water is pumped. Basement floor slabs, elevator pits and foundation walls should also be waterproofed.

## 5.7 Backfill and Compaction

Engineered fill, if required for foundations, should consist of free-draining granular material meeting the specifications of OPSS 1010 Granular B or an approved equivalent and should be placed in maximum 200 mm thick lifts compacted to 100% of SPMDD, as confirmed by nuclear densometer testing.

Imported material for engineered fill should consist of clean, no-organic, soils, free of chemical contamination or deleterious material. The moisture content of the engineered fill will need to be close enough to optimum at the time of placement to allow for adequate compaction.

Foundation wall, retaining wall and any buried utility backfill material should consist of free draining imported granular material. Excavated silty clay to silt and clay materials, may not be suitable for re-use as backfill for foundation walls and for grading purposes. Geotechnical testing of the material will be required to confirm suitability and compaction parameters (i.e., Proctor testing to confirm optimum moisture content). The fines (silt and clay) content of materials utilized as backfill for foundation walls/grading should not exceed 35%, which will need to be confirmed by sampling from stockpiled material and conducting confirmatory grain size analyses.

Typically, backfill should be placed in maximum 300 mm thick lifts and should be compacted to a minimum of 98% of SPMDD. Backfill adjacent to the structural elements (i.e., foundation walls) should be compacted to 95% of SPMDD taking care not to damage the adjacent structures. The backfill material in the upper 300 mm below the pavement subgrade elevation should be compacted to 100% of SPMDD in all areas.

All existing vegetation, topsoil, organic and non-organic fills, and any loose soils shall be removed down to a competent base. Backfill areas must be approved by a qualified geotechnical engineer prior to placement of any new fill, to ensure the suitability of subgrade conditions.

### **5.7.1 Engineered Fill**

Where the existing fill is treated as an engineered fill to support structural elements such as foundations and/or floor slabs the following is recommended for the construction of engineered fill:

- I. Remove any and all existing vegetation, surficial topsoil / organics, organic fills or fills and any loose soils to a competent subgrade for a suitable envelope.
- II. The area of the engineered fill should extend horizontally 1 m beyond the outside edge of the foundations then extend downward at an imaginary 1H:1V slope to the competent approved native soil. The exposed edges of the engineered fill should be sloped at a maximum of 3H:1V to avoid weakening of the engineered fill edges due to slope movement. If fill is required adjacent to sloped banks (i.e., slope steeper than 3H:1V), the fill shall be placed in stepped planes to avoid a plane weakness.
- III. The subgrade or base of the engineered fill area must be approved by Cambium prior to placement of any new fill, to ensure that suitability of subgrade condition. The area(s) should then be proof-rolled in conjunction with an inspection by Cambium to confirm that the exposed soils are native, undisturbed, and competent, and have been adequately cleaned of ponded water and all disturbed, loosened, softened, organic and other deleterious material. Some of the localized near-surface loose/soft soils will also likely need to be removed prior to placement of engineered fill as directed by Cambium during proof-rolling.
- IV. Materials for reuse as engineered fill must be approved by Cambium prior to placement. In this regard, approved disturbed native or the native soil which are near their optimum water contents and do not contain topsoil or organics or any other deleterious materials

can be reused on site as engineered fill. The materials for use as engineered fill must be maintained within about 2% of optimum water content for compaction. Based on the measured natural water contents, most of the native sandy soils are generally moist to wet and may require drying during engineered fill construction. Their actual water content will need to be assessed in comparison to the laboratory optimum water contents for compaction at the time of construction. If native soils from the site are not used as engineered fill, imported material for engineered fill should consist of clean, non-organic soils, free of chemical contamination or deleterious material that meet OPSS 1010.MUNI SSM or Granular B Type I material or approved equivalent. The approved material should be placed in maximum 300 mm thick loose lifts, compacted to 100% of SPMDD. Any frost penetration into the fill material must be removed prior to placement of subsequent lifts of fill and reviewed by Cambium.

- V. The engineered fill should be placed at least 600 mm above the elevation of the proposed underside of footing.
- VI. Due to the potential negative effects of differential settlement between the engineered fill and the native soils, it is generally not recommended that individual footings be supported on both engineered fill and on native soils. In addition, differential settlement may occur between different footings if some of the footings are on native soils, and some are on engineered fill.
- VII. Reinforcing steel bars should be included and placed within the footings and the top of the foundation walls. All tie reinforcing steel bars should be included and placed within the top of the foundation walls. All tie reinforcing steel bars should have at least 600 mm of overlap. The actual steel reinforcement design should be confirmed / designed by the project structural engineer.
- VIII. Full time testing and inspection of the engineered fill will be required for it to be used as a founding material, as outlined in Section 4.2.2.2 of the Ontario Building Code.
- IX. The final surface of the engineered fill should be protected as necessary from construction traffic, ponded water and freezing, and should be sloped to provide positive

drainage for surface water during and following the construction period. During periods of freezing weather, additional soil cover should be placed above final subgrade to provide frost protection.

## 5.8 Buried Utilities

Bedding and cover material for any buried utilities should consist of OPSS 1010 Granular A or B Type II, placed in accordance with pertinent Ontario Provincial Standard Drawings (OPSD 802.013). The bedding and cover material shall be placed in maximum 200 mm thick lifts and should be compacted to at least 98% of SPMDD. The cover material shall be a minimum of 300 mm over the top of the pipe and compacted to 98% of SPMDD, taking care not to damage the utility pipes during compaction.

If wet or saturated conditions exist within any utility excavation, consideration should be given to using 19 mm diameter crushed clear stone wrapped in a geotextile filter fabric as pipe bedding.

## 5.9 Lateral Earth Pressure

Lateral earth pressure coefficients (K) are shown in Table 6 and may be used for the preliminary design of temporary and permanent structures at the Site. It is assumed that potential lateral loads will result from cohesion less, frictional materials, such as granular backfill and the encountered near surface native sand.

**Table 6 Lateral Earth Pressure Coefficients**

Stratum/Parameter	$\gamma / \gamma'$ [kN/m <sup>3</sup> ]	$\phi$ [°]	c [kN/m <sup>2</sup> ]	$K_o$ [-]	$K_a$ [-]	$K_p$ [-]
Compacted Granular A and Granular B Type II	22 / 12	34	0	0.44	0.28	3.54
Sand, Silty Sand, Silt and Sand <i>Compact to very dense</i>	20 / 11	32	0	0.47	0.31	3.25
Engineered Fill (per recommendations provided above)	20.5 / 11.5	32	0	0.47	0.31	3.25

Where:

$\gamma$  = bulk unit weight of soil (kN/m<sup>3</sup>)  
 $\gamma'$  = submerged (effective) unit weight of soil (kN/m<sup>3</sup>)  
 $\phi$  = internal angle of friction (degrees)  
 $c$  = soil cohesion (kN/m<sup>2</sup>)  
 $K_a$  = Rankine active earth pressure coefficient (dimensionless)  
 $K_o$  = Rankine at-rest earth pressure coefficient (dimensionless)  
 $K_p$  = Rankine passive earth pressure coefficient (dimensionless)

The coefficients provided in Table 6 assume that the surface of the granular backfill is horizontal against any proposed retaining wall, and the wall is vertical and smooth. Cambium should be contacted to provide updated lateral earth pressure coefficients should the assumptions differ to those noted.

### 5.9.1 Earthquake-Induced Pressures

Earthquakes will induce additional pressures on retaining structures.

For active earth pressure loads:

$$P_{ae} = \frac{1}{2} \gamma H^2 (1 - k_v) K_{ae}$$

Where

$P_{ae}$  = resultant active lateral earth load inducing static and dynamic loads;

$\gamma$  = unit weight of the soil behind the wall;

$k_v$  = vertical component of the earthquake acceleration (as a decimal fraction of the acceleration due to gravity);

$k_h$  = horizontal component of the earthquake acceleration (as a decimal fraction of the acceleration due to gravity); and

$K_{ae}$  = horizontal component of active earth pressure coefficient including effects of earthquake loading;

And

$$K_{ae} = \frac{\cos(\delta + \alpha \cos^2(\phi' - \varphi - i))}{\cos^2 i \cos \delta \cos(\delta + i + \varphi) (1 + X_a^{1/2})^2}$$

$$X_a = \frac{\sin(\delta + \varphi') \sin(\phi' - \varphi - \beta)}{\cos(\delta + i + \varphi) \cos(\beta - i)}$$

$$\varphi = \tan^{-1}[k_h/(1 - k_v)]$$

$$i = 90 - \alpha$$

For the site,  $\gamma$  is as above for either native soils or compacted granular fill,  $\alpha=90^\circ$ ,  $i=0$ , and  $\delta=14^\circ$ .

For temporary shoring,  $K_h=0.057$  and  $K_v=0.038$ , while for permanent structures  $K_h=0.134$  and  $K_v=0.09$ .

### 5.9.2 Shoring Design

It is likely that extensive shoring design and construction will be required where the property line runs adjacent to Mapleview Drive East if the proposed parking garage is to be constructed directly adjacent to the property line. If a shoring design is conducted for the proposed parking garage, the lateral earth pressures found herein should be applied to the design and Cambium should be retained to conduct a plan review and make necessary changes.

## 5.10 Seismic Site Classification

The Ontario Building Code (OBC) specifies that the structures should be designed to withstand forces due to earthquakes. For the purpose of earthquake design, geotechnical information shall be used to determine the “Site Class”. The parameters for determination of Site Classification for Seismic Site Response are set out in Table 4.1.8.4A of the OBC (2012). The classification is based on the determination of the average shear wave velocity in the top 30 metres of the site stratigraphy, where shear wave velocity ( $v_s$ ) measurements have been taken. Alternatively, the classification is estimated on the basis of rational analysis of undrained shear strength ( $s_u$ ) or penetration resistances ( $N_{60}$  values).

The boreholes advanced on site were maximum of about 8.2 mbgs. Therefore, the site classification recommendation would be based on the available information as well as our interpretation of conditions below the boreholes based on our knowledge of the soil conditions in the area. It is assumed that the soils encountered in the samples retrieved remain continuous to a minimum depth of 30 m below the bottom of any foundations. In addition, average ‘ $N_{60}$ ’ values for soils were assumed for the site. Based on the explored soil properties and in accordance with Table 4.1.8.4.A, it is recommended that Site Class “D” (stiff soil) be applied for structural design at the Site.

Consideration could be given to carrying out shear wave velocity testing (“MASW”) to evaluate whether an improved seismic site class can be obtained. Further details regarding shear wave velocity testing could be provided upon request.

## 5.11 Pavement Design

The performance of pavement is dependent on proper subgrade preparation. All topsoil and organic materials should be removed and backfilled with approved engineered fill or native material (if tested and approved for use by a qualified geotechnical/pavement engineer), compacted to 98% of SPMDD. The subgrade should be proof rolled and inspected by a geotechnical engineer. Any areas where boulders, rutting, or appreciable deflection is noted

should be sub-excavated and replaced with suitable fill. The fill should be compacted to at least 100% of SPMDD.

The recommended pavement structure provided is referenced from the City of Barrie's "Right-of-Way Infrastructure Standards, Appendix C", as a minimum, consist of the pavement layers identified in Table 7. Cambium recommends the parking structure for the Site adhere to the minimum pavement structure provided and is sufficient for the Site.

**Table 7 Minimum Pavement Structure**

Pavement Layer	Compaction Requirements	Minimum Thickness and Material Requirements
Surface Course Asphalt	92% - 96.5% MRD (OPSS 310)	40 mm HL3
Binder Course Asphalt	92% - 96.5% MRD (OPSS 310)	70 mm HL4 or HL8
Granular Base	100% SPMDD (ASTM-D698)	150 mm OPSS 1010 Granular A
Granular Subbase	100% SPMDD (ASTM-D698)	450 mm OPSS 1010 Granular B Type I

Final material and thickness requirements, and any material/thickness substitutions must be approved by the Design Engineer.

The thickness of the subbase layer could be increased at the discretion of the Engineer, to accommodate site conditions at the time of construction, including any soft or weak subgrade soil replacement.

Compaction of the subgrade should be verified by the Engineer prior to placing the granular fill. Granular layers should be placed in 200 mm maximum loose lifts and compacted to at least 100% of SPMDD. The granular materials specified should conform to OPSS standards, as confirmed by appropriate materials testing. Asphalt materials should be rolled and compacted as per OPSS 310.

The final asphalt surface should be sloped at a minimum of 0.5% to shed runoff. Abutting pavements should be saw cut to provide clean vertical joints with new pavement areas.

## 6.0 Report Limitations

### 6.1 Design Review and Inspections

Cambium should be contacted to review and approve design drawings, prior to tendering or commencing construction, to ensure that all pertinent geotechnical-related factors have been addressed. It is important that onsite geotechnical supervision be provided at this site for excavation and backfill procedures, deleterious soil removal, subgrade inspections and compaction testing.

### 6.2 Changes in Site and Project Scope

This geotechnical engineering report is intended for planning and design purposes only.

Subsurface conditions can be altered by the passage of sufficient time, natural occurrences, and human intervention. Consideration should be given to contractual responsibilities as they relate to control of groundwater seepage, disturbance of soils, and frost protection.

The design parameters provided, and the engineering advice offered in this report are intended for use by the owner and its retained design consultants. If there are changes to the project scope and development features, these interpretations made of the subsurface information, for geotechnical design parameters, advice, and comments relating to constructability issues and quality control may not be complete for the project. Cambium should be retained to conduct further review to interpret the implications of such changes with respect to this report.



## 7.0 Closing

We trust that the information contained in this report meets your current requirements. If you have questions or comments regarding this document, please do not hesitate to contact the undersigned at (705) 719-0700.

Respectfully submitted,

**Cambium Inc.**

DocuSigned by:

E70D3B9336AE4BD...

Chris Malliaros, P.Eng.

Project Coordinator - Geotechnical

DocuSigned by:

0B68D45279A94B7...

Stuart Baird, M.Eng., P.Eng.

Director – Geotechnical, CQV, Building Sciences

SEB/cm

P:\19900 to 19999\19953-002 Mapleview S (Innisfil) Ltd co Briarwood - GEO - MVS Dev Med Density Blocks\Deliverables\Report – GEO\Block A (193)\Final\2024-06-25 RPT - GEO - MVS Block 193.docx

## 8.0 Standard Limitations

### Limited Warranty

In performing work on behalf of a client, Cambium relies on its client to provide instructions on the scope of its retainer, and, on that basis, Cambium determines the precise nature of the work to be performed. Cambium undertakes all work in accordance with applicable accepted industry practices and standards. Unless required under local laws, other than as expressly stated herein, no other warranties or conditions, either expressed or implied, are made regarding the services, work or reports provided.

### Reliance on Materials and Information

The findings and results presented in reports prepared by Cambium are based on the materials and information provided by the client to Cambium and on the facts, conditions and circumstances encountered by Cambium during the performance of the work requested by the client. In formulating its findings and results into a report, Cambium assumes that the information and materials provided by the client or obtained by Cambium from the client or otherwise are factual, accurate and represent a true depiction of the circumstances that exist. Cambium relies on its client to inform Cambium if there are changes to any such information and materials. Cambium does not review, analyze, or attempt to verify the accuracy or completeness of the information or materials provided, or circumstances encountered, other than in accordance with applicable accepted industry practice. Cambium will not be responsible for matters arising from incomplete, incorrect, or misleading information or from facts or circumstances that are not fully disclosed to or that are concealed from Cambium during the provision of services, work or reports.

Facts, conditions, information, and circumstances may vary with time and locations and Cambium's work is based on a review of such matters as they existed at the particular time and location indicated in its reports. No assurance is made by Cambium that the facts, conditions, information, circumstances, or any underlying assumptions made by Cambium in connection with the work performed will not change after the work is completed and a report is submitted. If any such changes occur or additional information is obtained, Cambium should be advised and requested to consider if the changes or additional information affect its findings or results.

When preparing reports, Cambium considers applicable legislation, regulations, governmental guidelines, and policies to the extent they are within its knowledge, but Cambium is not qualified to advise with respect to legal matters. The presentation of information regarding applicable legislation, regulations, governmental guidelines, and policies is for information only and is not intended to and should not be interpreted as constituting a legal opinion concerning the work completed or conditions outlined in a report. All legal matters should be reviewed and considered by an appropriately qualified legal practitioner.

### Site Assessments

A site assessment is created using data and information collected during the investigation of a site and based on conditions encountered at the time and particular locations at which fieldwork is conducted. The information, sample results and data collected represent the conditions only at the specific times at which and at those specific locations from which the information, samples and data were obtained and the information, sample results and data may vary at other locations and times. To the extent that Cambium's work or report considers any locations or times other than those from which information, sample results and data was specifically received, the work or report is based on a reasonable extrapolation from such information, sample results and data but the actual conditions encountered may vary from those extrapolations.

Only conditions at the site and locations chosen for study by the client are evaluated; no adjacent or other properties are evaluated unless specifically requested by the client. Any physical or other aspects of the site chosen for study by the client, or any other matter not specifically addressed in a report prepared by Cambium, are beyond the scope of the work performed by Cambium and such matters have not been investigated or addressed.

### Reliance

Cambium's services, work and reports may be relied on by the client and its corporate directors and officers, employees, and professional advisors. Cambium is not responsible for the use of its work or reports by any other party, or for the reliance on, or for any decision which is made by any party using the services or work performed by or a report prepared by Cambium without Cambium's express written consent. Any party that relies on services or work performed by Cambium or a report prepared by Cambium without Cambium's express written consent, does so at its own risk. No report of Cambium may be disclosed or referred to in any public document without Cambium's express prior written consent. Cambium specifically disclaims any liability or responsibility to any such party for any loss, damage, expense, fine, penalty or other such thing which may arise or result from the use of any information, recommendation or other matter arising from the services, work or reports provided by Cambium.

### Limitation of Liability

Potential liability to the client arising out of the report is limited to the amount of Cambium's professional liability insurance coverage. Cambium shall only be liable for direct damages to the extent caused by Cambium's negligence and/or breach of contract. Cambium shall not be liable for consequential damages.

### Personal Liability

The client expressly agrees that Cambium employees shall have no personal liability to the client with respect to a claim, whether in contract, tort and/or other cause of action in law. Furthermore, the client agrees that it will bring no proceedings nor take any action in any court of law against Cambium employees in their personal capacity.



---

## Appended Figures

---


**GEOTECHNICAL  
INVESTIGATION**  
MAPLEVIEW SOUTH  
(INNISFIL) LIMITED  
953 Mapleview Drive East  
Barrie, Ontario

**LEGEND**

- Highway
- Major Road
- Minor Road
- Railway
- Watercourse
- Water Area
- First Nations Reserve
- Wooded Area
- Built Up Area

Lake Simcoe

CHIPPEWAS OF  
GEORGINA ISLAND  
FIRST NATION

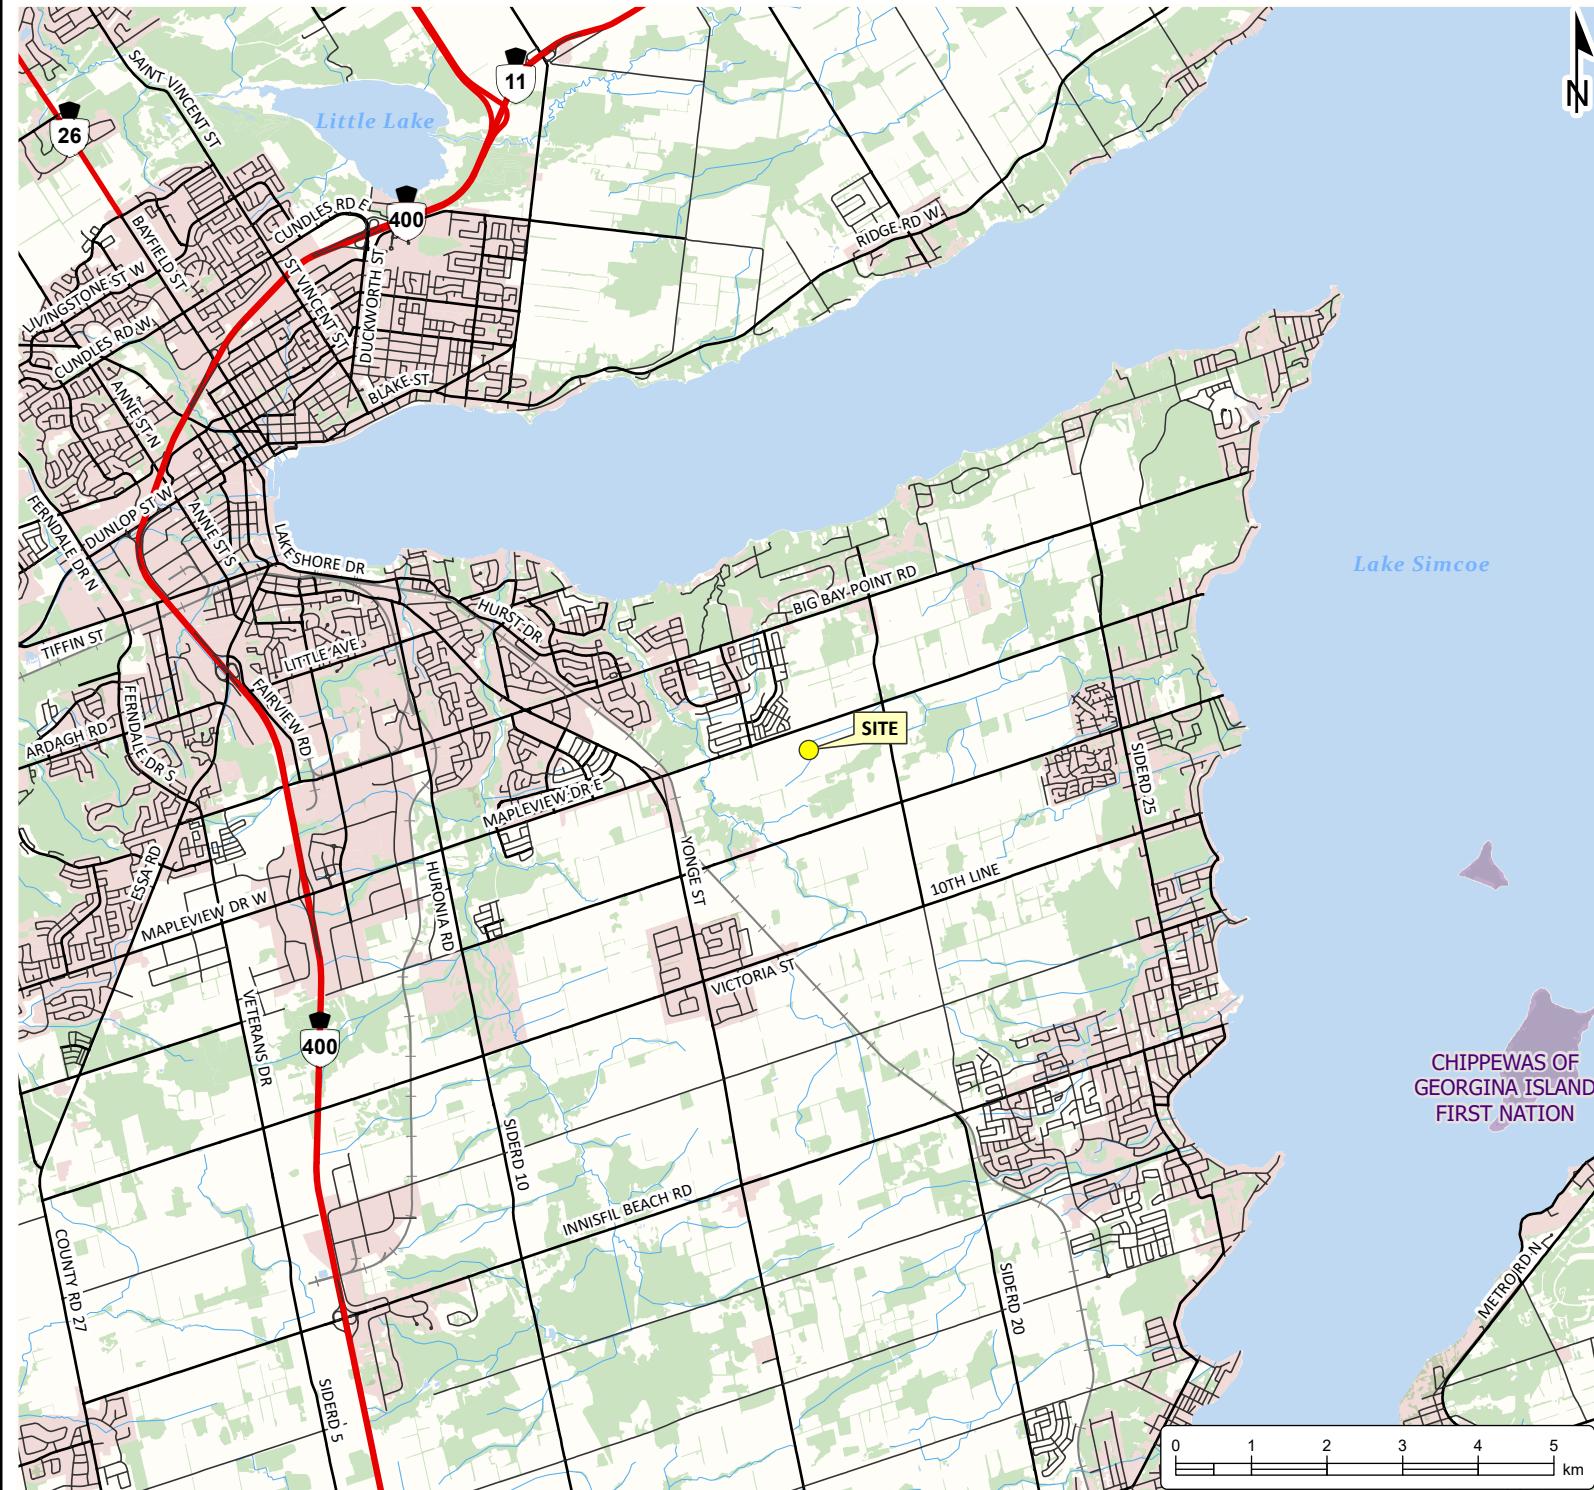

Notes:

- This document contains information licensed under the Open Government License - Ontario.
- Distances on this plan are in metres and can be converted to feet by dividing by 3.281.
- Cambium Inc. makes every effort to ensure this map is free from errors but cannot be held responsible for any damages due to error or omissions. This map should not be used for navigation or legal purposes. It is intended for general reference use only.



194 Sophia Street  
Peterborough, Ontario, K9H 1E5  
Tel: (705) 742.7900 Fax: (705) 742.7907  
[www.cambium-inc.com](http://www.cambium-inc.com)


**SITE LOCATION PLAN**

Project No.:	19953-002	Date:	May 2024
Rev.:		Projection:	NAD 1983 UTM Zone 17N
Scale:	1:100,000		
Created by:	TLC	Checked by:	MG
Figure:	1		

**GEOTECHNICAL  
INVESTIGATION**  
MAPLEVIEW SOUTH  
(INNISFIL) LIMITED  
953 Mapleview Drive East  
Barrie, Ontario

**LEGEND**

-  Benchmark
-  Borehole

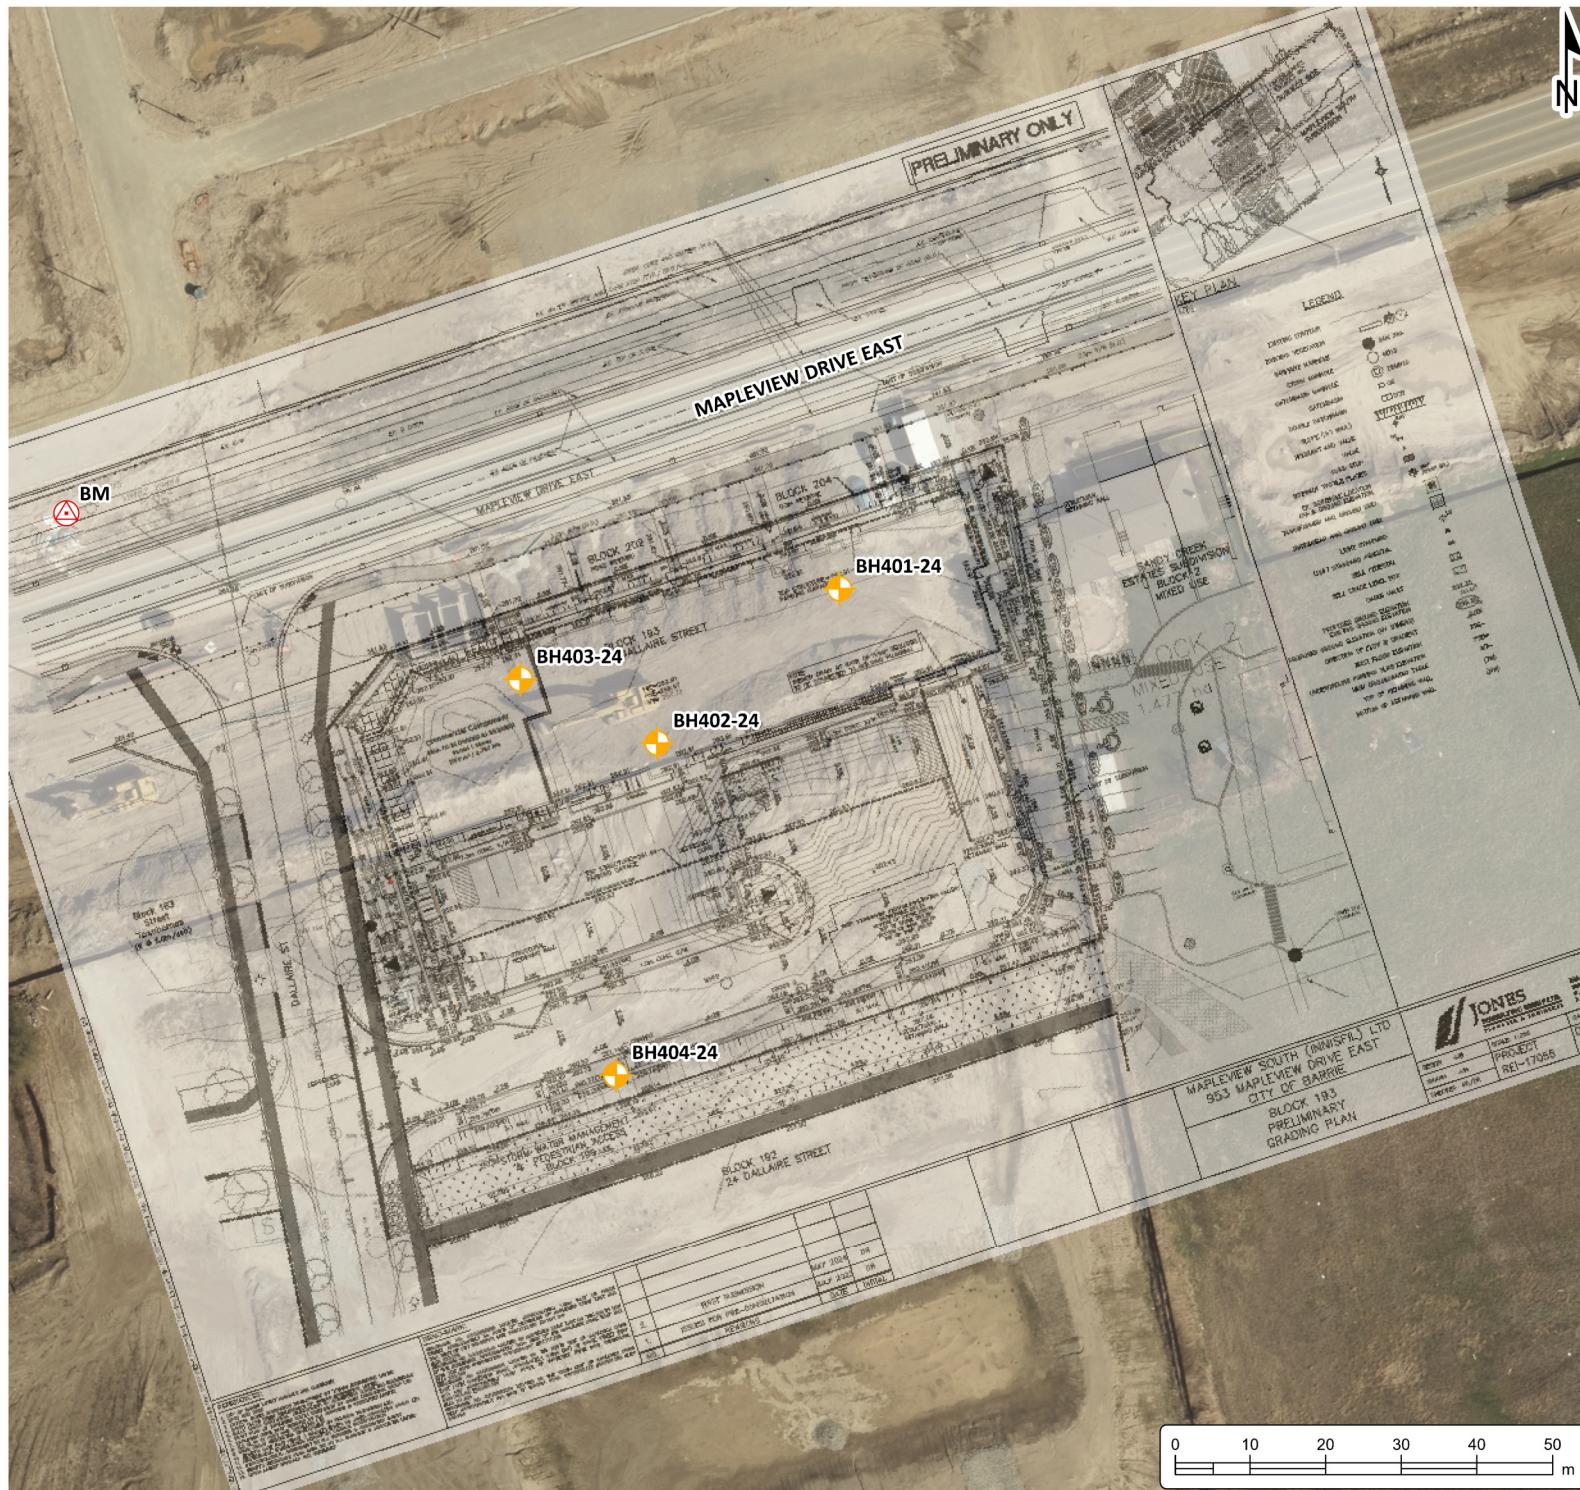



---

## **Appendix A**

### **Borehole Logs**

---



Mapleview South  
(Innisfil) Limited c/o  
Briarwood Development

Client: Group

Contractor: Ontario Soil Drilling Inc.

Project No.: 19953-002

Location: 953 Mapleview Drive  
East, Barrie ON

Project Name: MVS Dev Med Density Blocks

Method: Track Mounted Solid Stem Auger

Elevation: 260.55 mASL

UTM: 17T N: 4912191 E: 611561

Log of Borehole:


BH401-24

Page:

1 of 2

Date Completed:

May 8, 2024

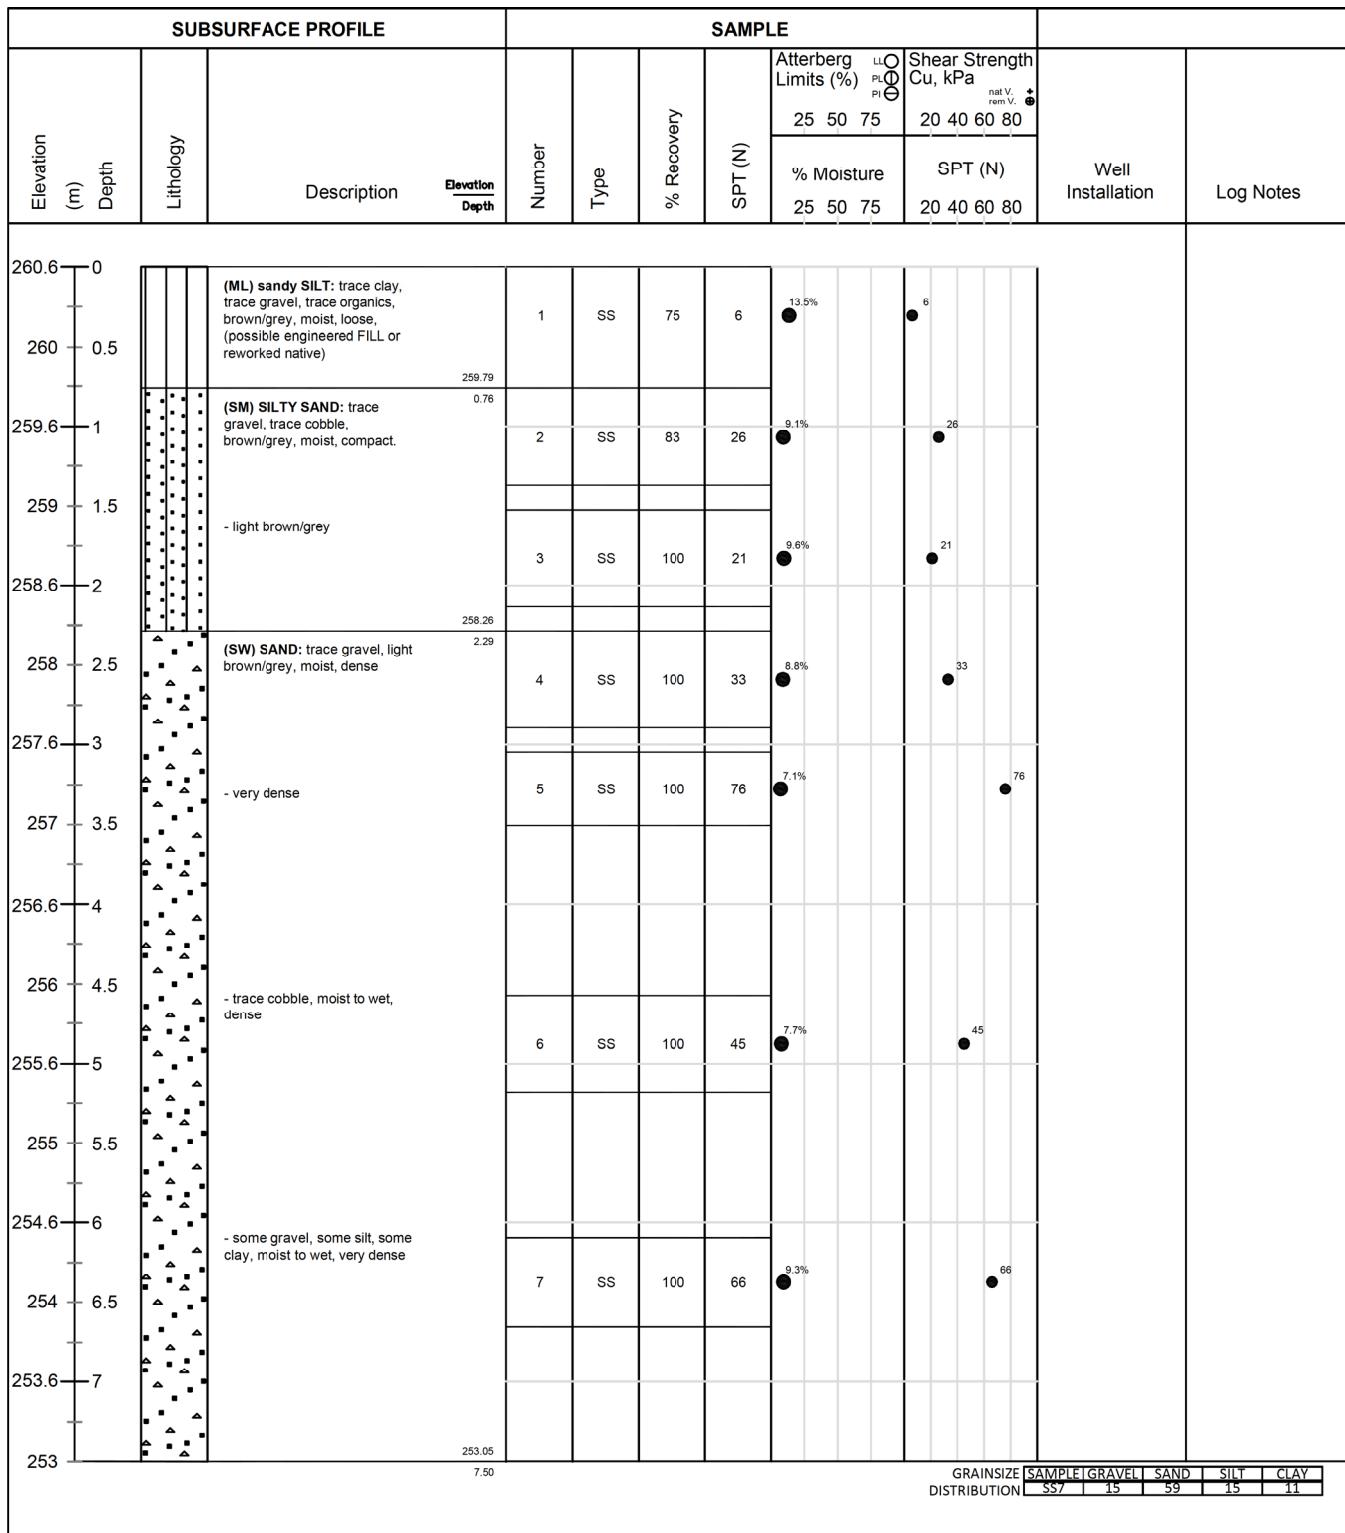

Logged By: AM

Input By: MH

Peterborough, Barrie, Whitby, Kingston, Ottawa



Mapleview South  
(Innisfil) Limited c/o  
Briarwood Development

Client: Group

Contractor: Ontario Soil Drilling Inc.

Project No.: 19953-002

Location: 953 Mapleview Drive  
East, Barrie ON

Project Name: MVS Dev Med Density Blocks

Method: Track Mounted Solid Stem Auger

Elevation: 260.55 mASL

UTM: 17T N: 4912191 E: 611561

Log of Borehole:

BH401-24

Page:

2 of 2

Date Completed:

May 8, 2024

SUBSURFACE PROFILE			SAMPLE									
Elevation (m)	Depth	Lithology	Description	Elevation Depth	Number	Type	% Recovery	SPT (N)	Atterberg Limits (%) PL PI	Shear Strength Cu, kPa nat V. rem V.	Well Installation	Log Notes
253	7.5		(SW) SAND: trace gravel, light brown/grey, moist, dense	252.66	8	SS	75	66	14.2%	20 40 60 80		
252.6	8		Borehole terminated @ 7.9 mbgs due to target depth achieved.	7.89								
252	8.5											
251.6	9											
251	9.5											
250.6	10											
250	10.5											
249.6	11											
249	11.5											
248.6	12											
248	12.5											
247.6	13											
247	13.5											
246.6	14											
246	14.5											
245.6												

Logged By: AM

Input By: MH

Peterborough, Barrie, Whitby, Kingston, Ottawa

GRAINSIZE  
DISTRIBUTION SAMPLE GRAVEL SAND SILT CLAY  
SS7 15 39 15 11



Mapleview South  
(Innisfil) Limited c/o  
Briarwood Development

**Client:** Group

**Contractor:** Ontario Soil Drilling Inc.

**Project No.:** 19953-002

**Location:** 953 Mapleview Drive  
East, Barrie ON

**Project Name:** MVS Dev Med Density Blocks

**Method:** Track Mounted Solid Stem Auger

**Elevation:** 259.96 mASL

UTM: 17T N: 4912172 E: 611531

## Log of Borehole:

BH402-24

Page:

1 of 2

**Date Completed:**

May 8, 2024

SUBSURFACE PROFILE				SAMPLE										
Elevation (m)	Depth	Lithology	Description	Elevation Depth	Number	Type	% Recovery	SPT (N)	Atterberg Limits (%) 25 50 75	LL PL PI	Shear Strength Cu, kPa 20 40 60 80	nat V. rem V.	Well Installation	Log Notes
									% Moisture 25 50 75			SPT (N) 20 40 60 80		
260	0				1	SS	83	11	9.6%			11		
259.5	0.5				2	SS	100	14	8.6%			14		
259	1		(SM) SILTY SAND: trace gravel, trace organics, brown/grey, moist, compact, (possible engineered FILL or reworked native) - trace cobble, less organics	258.44	3	SS	100	36	7.9%			36		
258.5	1.5			1.52	4	SS	100	48	7.7%			48		
258	2		(SM) SILTY SAND: trace gravel, trace cobble, light brown/grey, moist to wet, dense		5	SS	100	46	9%			46		
257.5	2.5				6	SS	100	61	7%			61		
257	3				7	SS	83	90	7.1%			90		
256	4													
255.5	4.5													
255	5		very dense											
254.5	5.5													
254	6													
253.5	6.5													
253	7													
252.5				252.46										
GRAINSIZE DISTRIBUTION														
SAMPLE		GRAVEL		SAND		SILT		CLAY						

Logged By: AM

**Input By:** MH

### **Peterborough, Barrie, Whitby, Kingston, Ottawa**



Mapleview South  
(Innisfil) Limited c/o  
Briarwood Development

Client: Group

Contractor: Ontario Soil Drilling Inc.

Project No.: 19953-002

Location: 953 Mapleview Drive  
East, Barrie ON

Project Name: MVS Dev Med Density Blocks

Method: Track Mounted Solid Stem Auger

Elevation: 259.96 mASL

UTM: 17T N: 4912172 E: 611531

Log of Borehole:

BH402-24

Page:

2 of 2

Date Completed:

May 8, 2024

SUBSURFACE PROFILE			SAMPLE									
Elevation (m)	Depth	Lithology	Description	Elevation Depth	Number	Type	% Recovery	SPT (N)	Atterberg Limits (%) PL PI 25 50 75	Shear Strength Cu, kPa nat. V. rem. V. 20 40 60 80	Well Installation	Log Notes
252.5	7.5											
252	8											
251.5	8.5											
251	9											
250.5	9.5											
250	10											
249.5	10.5											
249	11											
248.5	11.5											
248	12											
247.5	12.5											
247	13											
246.5	13.5											
246	14											
245.5	14.5											
245												
252.5	7.5											
252	8											
251.5	8.5											
251	9											
250.5	9.5											
250	10											
249.5	10.5											
249	11											
248.5	11.5											
248	12											
247.5	12.5											
247	13											
246.5	13.5											
246	14											
245.5	14.5											
245												
252.5	7.5											
252	8											
251.5	8.5											
251	9											
250.5	9.5											
250	10											
249.5	10.5											
249	11											
248.5	11.5											
248	12											
247.5	12.5											
247	13											
246.5	13.5											
246	14											
245.5	14.5											
245												
252.5	7.5											
252	8											
251.5	8.5											
251	9											
250.5	9.5											
250	10											
249.5	10.5											
249	11											
248.5	11.5											
248	12											
247.5	12.5											
247	13											
246.5	13.5											
246	14											
245.5	14.5											
245												
252.5	7.5											
252	8											
251.5	8.5											
251	9											
250.5	9.5											
250	10											
249.5	10.5											
249	11											
248.5	11.5											
248	12											
247.5	12.5											
247	13											
246.5	13.5											
246	14											
245.5	14.5											
245												
252.5	7.5											
252	8											
251.5	8.5											
251	9											
250.5	9.5											
250	10											
249.5	10.5											
249	11											
248.5	11.5											
248	12											
247.5	12.5											
247	13											
246.5	13.5											
246	14											
245.5	14.5											
245												

Logged By: AM

Input By: MH

Peterborough, Barrie, Whitby, Kingston, Ottawa



Mapleview South  
(Innisfil) Limited c/o  
Briarwood Development

**Client:** Group

**Contractor:** Ontario Soil Drilling Inc.

**Project No.:** 19953-002

**Location:** 953 Mapleview Drive  
East, Barrie ON

**Project Name:** MVS Dev Med Density Blocks

**Method:** Track Mounted Solid Stem Auger

**Elevation:** 260.53 mASL

UTM: 17T N: 4912178 E: 611489

## Log of Borehole:

BH403-24

Page:

1 of 2

**Date Completed:**

May 8, 2024

SUBSURFACE PROFILE				SAMPLE																						
Elevation (m)	Depth	Lithology	Description	Elevation Depth	Number	Type	% Recovery	SPT (N)	Atterberg Limits (%)	LL	Shear Strength Cu, kPa	Well Installation	Log Notes													
									25	50	75			20	40	60	80	nat. V.	rem. V.							
260.5	0		(ML) sandy SILT: trace clay, trace gravel, trace organics, brown/grey, moist, loose, (possible engineered FILL or reworked native).	259.77	1	SS	75	4	15.9%																	
260	0.5				2	SS	100	15	16.6%																	
259.5	1		(SM) SILTY SAND: trace gravel, trace cobble, light brown/grey, moist, compact.	0.76	3	SS	100	18	19%																	
259	1.5				4	SS	100	34	8.4%																	
258.5	2				5	SS	100	34	9.8%																	
258	2.5				6	SS	100	47	8%																	
257.5	3				7	SS	75	81	9.9%																	
257	3.5																									
256.5	4																									
256	4.5																									
255.5	5																									
255	5.5																									
254.5	6																									
254	6.5																									
253.5	7																									
253	7.50			253.03																						
<table border="1"> <tr> <td colspan="2">GRAINSIZE DISTRIBUTION</td> <td>SAMPLE</td> <td>GRAVEL</td> <td>SAND</td> <td>SILT</td> <td>CLAY</td> </tr> <tr> <td colspan="2"></td> <td>SS6</td> <td>5</td> <td>45</td> <td>32</td> <td>18</td> </tr> </table>													GRAINSIZE DISTRIBUTION		SAMPLE	GRAVEL	SAND	SILT	CLAY			SS6	5	45	32	18
GRAINSIZE DISTRIBUTION		SAMPLE	GRAVEL	SAND	SILT	CLAY																				
		SS6	5	45	32	18																				

Logged By: AM

**Input By:** MH

**Peterborough, Barrie, Whitby, Kingston, Ottawa**



Mapleview South  
(Innisfil) Limited c/o  
Briarwood Development

**Client:** Group

**Contractor:** Ontario Soil Drilling Inc.

**Project No.:** 19953-002

**Location:** 953 Mapleview Drive  
East, Barrie ON

**Project Name:** MVS Dev Med Density Blocks

**Method:** Track Mounted Solid Stem Auger

**Elevation:** 260.53 mASL

UTM: 17T N: 4912178 E: 611489

## Log of Borehole:

BH403-24

Page:

2 of 2

**Date Completed:**

May 8, 2024

Logged By: AM

**Input By:** MH

**Peterborough, Barrie, Whitby, Kingston, Ottawa**



Mapleview South  
(Innisfil) Limited c/o  
Briarwood Development

**Client:** Group

**Contractor:** Ontario Soil Drilling Inc.

**Project No.:** 19953-002

**Location:** 953 Mapleview Drive  
East, Barrie ON

**Project Name:** MVS Dev Med Density Blocks

**Method:** Track Mounted Solid Stem Auger

**Elevation:** 259.02 mASL

UTM: 17T N: 4912127 E: 611531

## Log of Borehole:

BH404-24

Page:

1 of 1

**Date Completed:**

May 8, 2024

SUBSURFACE PROFILE				SAMPLE																							
Elevation (m)	Depth (m)	Lithology	Description	Elevation Depth	Number	Type	% Recovery	SPT (N)	Atterberg Limits (%) LL PL PI	Cu, kPa 20 40 60 80 nat. V. rem. V.	Shear Strength Cu, kPa 20 40 60 80	Well Installation	Log Notes														
							% Moisture 25 50 75	SPT (N) 20 40 60 80																			
259	0		(SM) SILTY SAND: trace gravel, brown, moist, loose, (possible engineered FILL or reworked native)		1	SS	100	7	8.3%	7																	
258.5	0.5				2	SS	100	9	11.5%	9																	
258	1			257.50	3	SS	100	22	8.4%	22																	
257.5	1.5		(SM) SILTY SAND: trace clay, trace gravel, trace cobble, brown/grey, moist to wet, compact	1.52	4	SS	100	18	9.1%	18																	
257	2				5	SS	83	72	8.4%	72																	
256.5	2.5		- some clay, trace gravel, moist to wet		6	SS	100	65	9.8%	65																	
256	3		- very dense																								
255.5	3.5																										
255	4																										
254.5	4.5																										
254	5			253.91																							
253.5	5.5		Borehole terminated @ 5.1 mbgs due to target depth achieved.	5.11																							
253	6																										
252.5	6.5																										
252	7																										
251.5																											
<table border="1" style="margin-left: auto; margin-right: 0;"> <tr> <td colspan="2">GRAINSIZE DISTRIBUTION</td> <td>SAMPLE</td> <td>GRAVEL</td> <td>SAND</td> <td>SILT</td> <td>CLAY</td> </tr> <tr> <td colspan="2"></td> <td>SS4</td> <td>7</td> <td>47</td> <td>30</td> <td>16</td> </tr> </table>														GRAINSIZE DISTRIBUTION		SAMPLE	GRAVEL	SAND	SILT	CLAY			SS4	7	47	30	16
GRAINSIZE DISTRIBUTION		SAMPLE	GRAVEL	SAND	SILT	CLAY																					
		SS4	7	47	30	16																					

Logged By: AM

**Input By:** MH

### **Peterborough, Barrie, Whitby, Kingston, Ottawa**



---

## **Appendix B**

### **Physical Laboratory Testing Results**

---



## Grain Size Distribution Chart

CAMBIVUM

Project Number: 19953-002 Client: Mapleview South (Innisfil) Limited c/o Briarwood Developn

Project Name: MVS Dev Med Density Blocks

Sample Date: May 8, 2024


Sampled By: Abigail Mackie - Cambium Inc.

Location: BH 401-24 SS 7

Depth: 6.1 m to 6.7 m

Lab Sample No: S-24-0915

UNIFIED SOIL CLASSIFICATION SYSTEM					
CLAY & SILT (<0.075 mm)	SAND (<4.75 mm to 0.075 mm)			GRAVEL (>4.75 mm)	
	FINE	MEDIUM	COARSE	FINE	COARSE

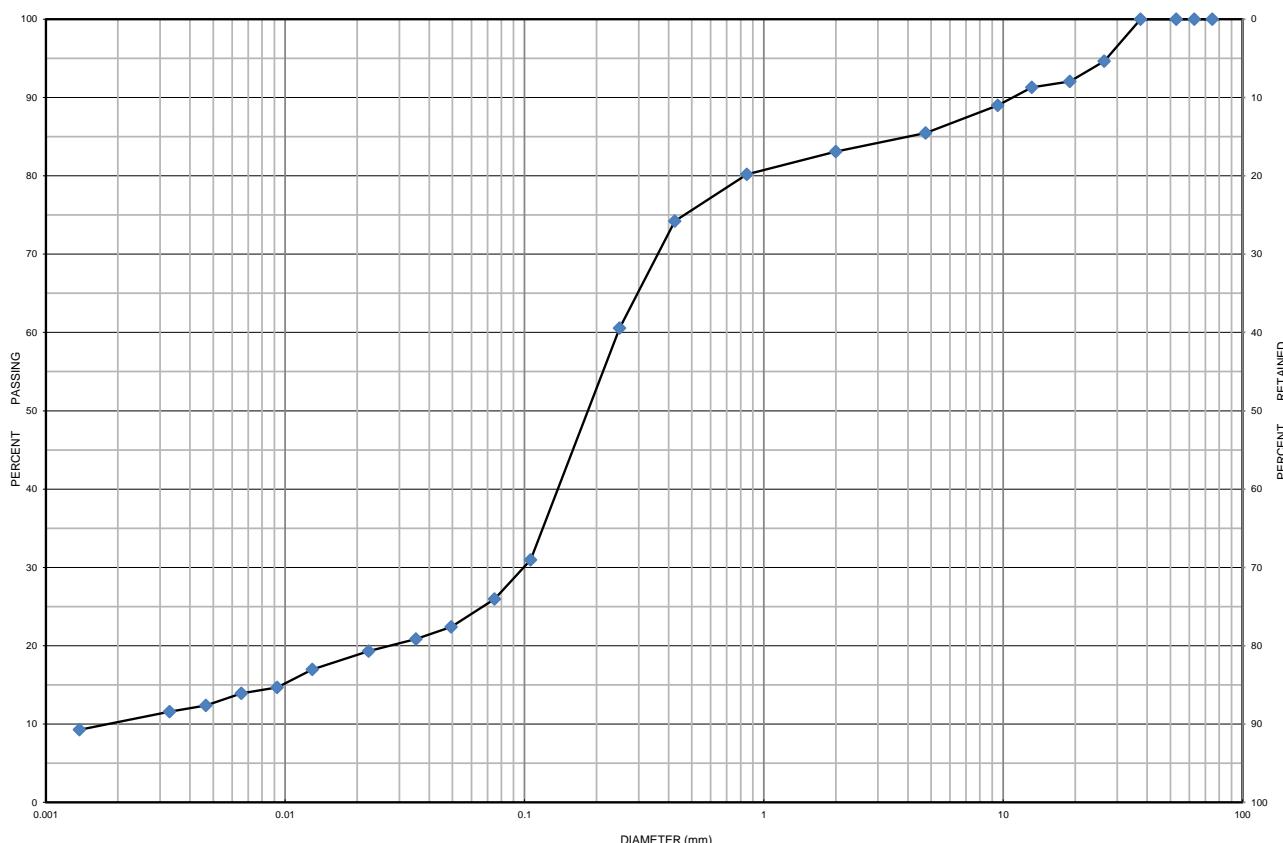

MIT SOIL CLASSIFICATION SYSTEM								
CLAY	SILT	FINE	MEDIUM	COARSE	FINE	MEDIUM	COARSE	BOULDERS
		SAND			GRAVEL			

Borehole No.	Sample No.	Depth	Gravel	Sand	Silt	Clay	Moisture
BH 401-24	SS 7	6.1 m to 6.7 m	15	59	15	11	9.3
Description	Classification	D <sub>60</sub>	D <sub>30</sub>	D <sub>10</sub>	C <sub>u</sub>	C <sub>c</sub>	
Sand some Gravel some Silt some Clay	SM	0.2500	0.1000	0.0018	138.89	22.22	

Additional information available upon request

Issued By:

(Senior Project Manager)

Date Issued:

May 24, 2024



## Grain Size Distribution Chart

CAMBIVUM

Project Number: 19953-002 Client: Mapleview South (Innisfil) Limited c/o Briarwood Developn

Project Name: MVS Dev Med Density Blocks

Sample Date: May 8, 2024


Sampled By: Abigail Mackie - Cambium Inc.

Location: BH 403-24 SS 6

Depth: 4.6 m to 5.2 m

Lab Sample No: S-24-0916

UNIFIED SOIL CLASSIFICATION SYSTEM					
CLAY & SILT (<0.075 mm)	SAND (<4.75 mm to 0.075 mm)			GRAVEL (>4.75 mm)	
	FINE	MEDIUM	COARSE	FINE	COARSE

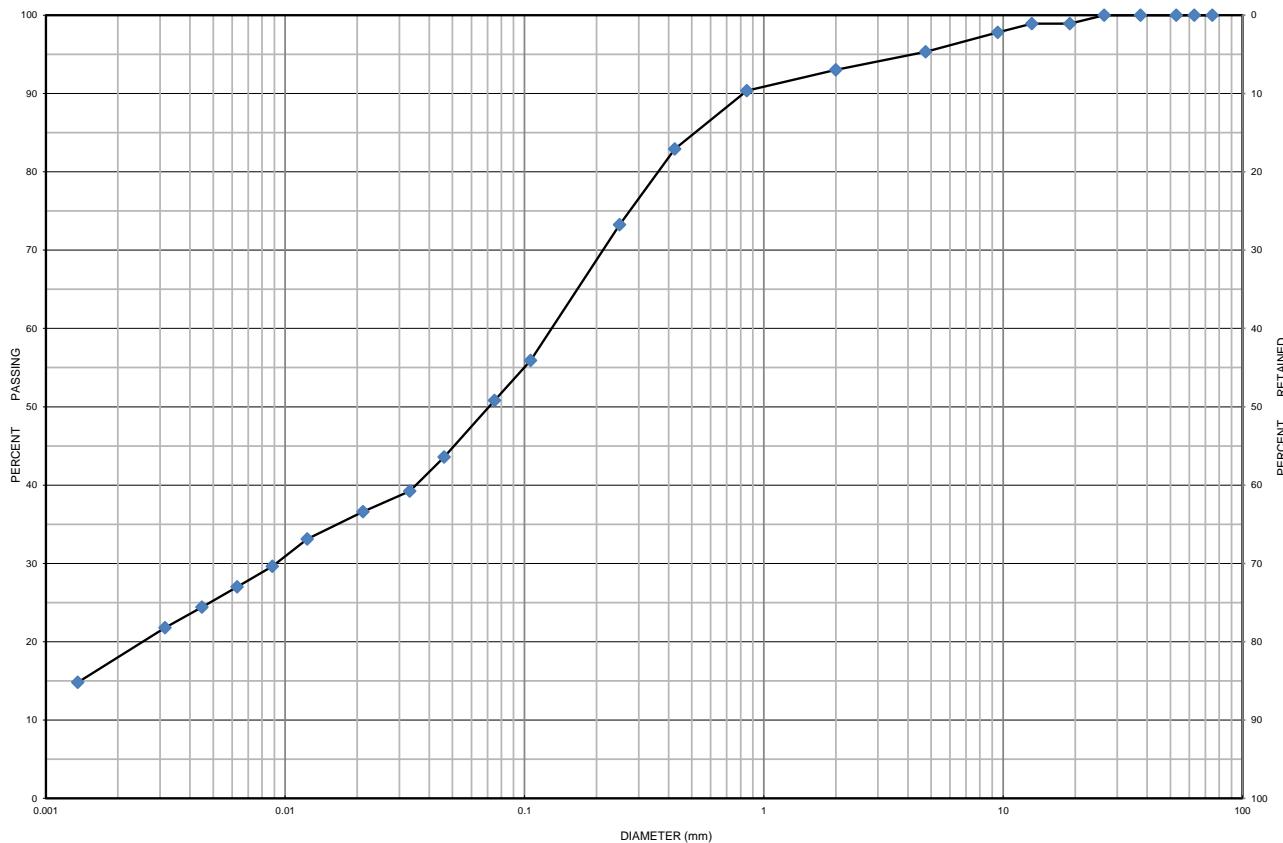

MIT SOIL CLASSIFICATION SYSTEM								
CLAY	SILT	FINE	MEDIUM	COARSE	FINE	MEDIUM	COARSE	BOULDERS
		SAND			GRAVEL			

Borehole No.	Sample No.	Depth	Gravel	Sand	Silt	Clay	Moisture
BH 403-24	SS 6	4.6 m to 5.2 m	5	45	32	18	8.0
Description	Classification	D <sub>60</sub>	D <sub>30</sub>	D <sub>10</sub>	C <sub>u</sub>	C <sub>c</sub>	
Silty Sand some Clay trace Gravel	ML	0.1400	0.0092	-	-	-	

Additional information available upon request

Issued By: \_\_\_\_\_

(Senior Project Manager)

Date Issued: \_\_\_\_\_

May 24, 2024



## Grain Size Distribution Chart

CAMBIVUM

Project Number: 19953-002 Client: Mapleview South (Innisfil) Limited c/o Briarwood Developn

Project Name: MVS Dev Med Density Blocks

Sample Date: May 8, 2024


Sampled By: Abigail Mackie - Cambium Inc.

Location: BH 404-24 SS 4

Depth: 2.3 m to 2.9 m

Lab Sample No: S-24-0917

UNIFIED SOIL CLASSIFICATION SYSTEM					
CLAY & SILT (<0.075 mm)	SAND (<4.75 mm to 0.075 mm)			GRAVEL (>4.75 mm)	
	FINE	MEDIUM	COARSE	FINE	COARSE

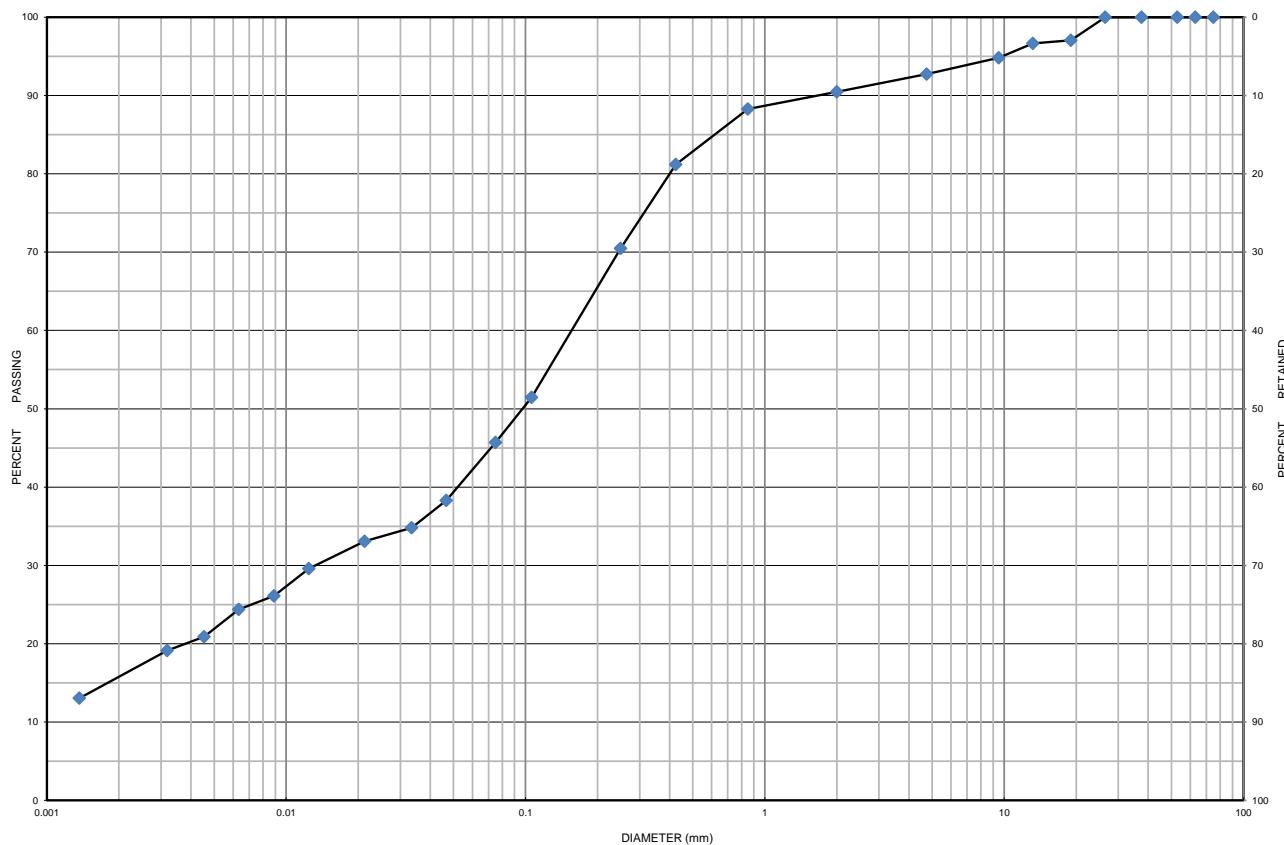

MIT SOIL CLASSIFICATION SYSTEM								
CLAY	SILT	FINE			MEDIUM			COARSE
		SAND			GRAVEL			

Borehole No.	Sample No.	Depth	Gravel	Sand	Silt	Clay	Moisture
BH 404-24	SS 4	2.3 m to 2.9 m	7	47	30	16	9.1
Description	Classification	D <sub>60</sub>	D <sub>30</sub>	D <sub>10</sub>	C <sub>u</sub>	C <sub>c</sub>	
Silty Sand some Clay trace Gravel	SM	0.160	0.014	-	-	-	

Additional information available upon request

Issued By:

(Senior Project Manager)

Date Issued:

May 24, 2024



## Moisture Content



**Project Number:** 19953-002  
**Project Name:** MVS Dev Med Density Blocks  
**Client:** 'Maplevue South (Innisfil) Limited c/o Briarwood Development Group  
**Date Taken:** 2024-05-08

**Lab Number:** S-24-0914  
**Date Tested:** 2024-05-13  
**Tested By:** R. McCabe

Borehole Number	Sample Number	Sample Depth (m)	Water Weight (g)	Water Content (%)	Additional Observations
401	1	0.00-0.61	35.9	13.5	
401	2	0.76-1.37	28.7	9.1	
401	3	1.52-2.13	34.8	9.6	
401	4	2.29-2.90	28.5	8.8	
401	5	3.05-3.66	21.8	7.1	
401	6	4.57-5.18	22.7	7.7	
401	7	6.10-6.65	116.7	9.3	NR
401	8	7.62-7.90	44.2	14.2	
402	1	0.00-0.61	24.7	9.6	
402	2	0.76-1.37	28.1	8.6	
402	3	1.52-2.13	24.4	7.9	
402	4	2.29-2.90	25.7	7.7	
402	5	3.05-3.66	27.3	9.0	
402	6	4.57-5.18	24.3	7.0	
402	7	6.10-6.55	18.7	7.1	
402	8	7.62-8.23	52.6	15.0	
403	1	0.00-0.61	46.8	15.9	
403	2	0.76-1.37	44.8	16.6	
403	3	1.52-2.13	46.2	19.0	
403	4	2.29-2.90	24.2	8.4	
403	5	3.05-3.66	29.7	9.8	
403	6	4.57-5.18	84.4	8.0	NR
403	7	6.10-6.55	32.3	9.9	
403	8	7.62-8.23	29.5	13.0	
404	1	0.00-0.61	23.5	8.3	
404	2	0.76-1.37	35.3	11.5	

- 1 – Contains organics
- 2 – Contains rubble
- 3 – Hydrocarbon Odour
- 4 – Unknown Chemical Odour
- 5 – Saturated – free water visible

- 6 – Very moist – near optimum moisture content
- 7 – Moist – below optimum moisture
- 8 – Dry – dry texture – powdery
- 9 – Very small – caution may not be representative
- 10 – Hold sample for gradation analysis



## Moisture Content

**Project Number:** 19953-002  
**Project Name:** MVS Dev Med Density Blocks  
**Client:** 'Mapleview South (Innisfil) Limited c/o Briarwood Development Group  
**Date Taken:** 2024-05-08

**Lab Number:** S-24-0914  
**Date Tested:** 2024-05-13  
**Tested By:** R. McCabe



Borehole Number	Sample Number	Sample Depth (m)	Water Weight (g)	Water Content (%)	Additional Observations
404	3	1.52-2.13	27.1	8.4	
404	4	2.29-2.90	85.0	9.1	NR
404	5	3.05-3.51	25.3	8.4	
404	6	4.57-5.11	35.2	9.8	

- 1 – Contains organics
- 2 – Contains rubble
- 3 – Hydrocarbon Odour
- 4 – Unknown Chemical Odour
- 5 – Saturated – free water visible

- 6 – Very moist – near optimum moisture content
- 7 – Moist – below optimum moisture
- 8 – Dry – dry texture – powdery
- 9 – Very small – caution may not be representative
- 10 – Hold sample for gradation analysis