

CONSTRUCTION NOTES AND SPECIFICATIONS

1. GENERAL

- 1.1. THESE PLANS ARE NOT FOR CONSTRUCTION UNTIL SIGNED AND SEALED BY ENGINEER AND APPROVED BY THE LOCAL MUNICIPALITY.
- 1.2. THESE PLANS ARE TO BE USED FOR SERVING AND GRADING ONLY. ANY OTHER INFORMATION SHOWN IS FOR ILLUSTRATION PURPOSES ONLY. THESE PLANS MUST NOT BE USED TO SITE THE PROPOSED BUILDING.
- 1.3. NO CHANGES ARE TO BE MADE WITHOUT THE APPROVAL OF THE DESIGN ENGINEER.
- 1.4. THESE PLANS ARE NOT TO BE REPRODUCED IN WHOLE OR IN PART WITHOUT THE PERMISSION OF MTE CONSULTANTS INC.
- 1.5. PRIOR TO CONSTRUCTION, THE CONTRACTOR MUST:
 - 1.5.1. CHECK AND VERIFY ALL EXISTING CONDITIONS, LOCATIONS AND ELEVATIONS WHICH INCLUDES BUT IS NOT LIMITED TO THE BENCHMARK ELEVATIONS, EXISTING SERVICE CONNECTIONS AND EXISTING INVERTS, REPORT ALL DISCREPANCIES TO THE ENGINEER PRIOR TO PROCEEDING.
 - 1.5.2. OBTAIN ALL UTILITY LOCATES AND REQUIRED PERMITS AND LICENSES.
 - 1.5.3. VERIFY THAT THE FINISHED FLOOR ELEVATIONS AND BASEMENT FLOOR ELEVATIONS (WHICH MAY APPEAR ON THIS PLAN) COMPLY WITH THE FINAL ARCHITECTURAL DRAWINGS.
 - 1.5.4. CONFIRM ALL DRAWINGS USED FOR CONSTRUCTION ARE OF THE MOST RECENT REVISION.

- 1.6. THE CONTRACTOR SHALL ASSUME ALL LIABILITY FOR ANY DAMAGE TO EXISTING WORKS. THE CONTRACTOR IS RESPONSIBLE FOR RESTORATION OF ALL DAMAGED AND/OR DISTURBED PROPERTY WITHIN THE MUNICIPAL RIGHT-OF-WAY TO LOCAL MUNICIPALITY STANDARDS
- 1.7. ALL WORKS ON A MUNICIPAL RIGHT-OF-WAY WITH THE EXCEPTION OF WATERMAIN TAPPING, TO BE INSTALLED BY THE OWNER'S CONTRACTOR AT OWNER'S EXPENSE IN ACCORDANCE WITH THE LOCAL MUNICIPALITY'S "PROCEDURE FOR OFF-SITE WORKS BY PRIVATE CONTRACTOR". THE OWNER AND CONTRACTOR ARE TO ENSURE OFF-SITE WORK PERMIT IS IN PLACE PRIOR TO CONSTRUCTION. THE CONTRACTOR IS RESPONSIBLE FOR RESTORATION OF ALL AFFECTED PROPERTY TO ORIGINAL CONDITION. ALL BOULEVARD AREAS SHALL BE RESTORED WITH 150mm TOPSOIL AND SOD.
- 1.8. ALL UNDERGROUND SERVICES ARE TO BE CONSTRUCTED IN FULL CONFORMANCE WITH THE ONTARIO PROVINCIAL BUILDING CODE (PART 7, PLUMBING), THE ONTARIO PROVINCIAL STANDARD SPECIFICATIONS (OPSS) AND THE REQUIREMENTS OF THE LOCAL MUNICIPALITY, WHICH CODES AND REGULATIONS SHALL SUPERSEDE ALL OTHERS.
- 1.9. **CONTRACTOR IS RESPONSIBLE FOR CONTACTING ENGINEER 48 HRS. PRIOR TO COMMENCING WORK TO ARRANGE FOR INSPECTION. ENGINEER TO DETERMINE DEGREE OF INSPECTION AND TESTING REQUIRED FOR CERTIFICATION OF UNDERGROUND SERVICE INSTALLATION AS MANDATED BY ONTARIO BUILDING CODE, DIVISION C, PART 1, SECTION 1.2.2, GENERAL REVIEW. FAILURE TO NOTIFY ENGINEER WILL RESULT IN EXPENSIVE POST CONSTRUCTION INSPECTION AT CONTRACTORS EXPENSE.**

- 1.10. SANITARY AND STORM SEWERS AND SERVICES TO HAVE A MINIMUM 1.4m COVER TO TOP OF PIPE, WHERE COVER TO TOP OF PIPE IS DEFICIENT, CONTRACTOR SHALL INSTALL SHALLOW BURIED PIPE IN ACCORDANCE WITH APPLICABLE "SEWER PIPE INSULATION DETAIL" INDICATED IN DRAWING DETAILS. CONTRACTOR SHALL SUPERSEDE ALL OTHERS.
- 1.11. PLAN TO BE READ IN CONJUNCTION WITH SWM REPORT AND DRAWING C1.1, C2.1, C2.2, C2.3, C2.4 PREPARED BY MTE CONSULTANTS INC. AND LANDSCAPE PLAN.
- 1.12. SITE PLAN INFORMATION TAKEN FROM PLAN PREPARED BY MATJAU ARCHITECTS DATED APRIL 20, 2020.
- 1.13. LEGAL INFORMATION TAKEN FROM PLAN PREPARED BY EPLETT & WOROBEC SURVEYING LTD., DATED OCTOBER 23, 1995 AND MAY 2, 2019.
- 1.14. EXISTING TOPOGRAPHIC INFORMATION TAKEN FROM PLAN PREPARED BY MTE CONSULTANTS INC., DATED JANUARY 24, 2019.

- 1.15. CONTRACTOR TO OBTAIN WRITTEN PERMISSION FROM ADJACENT PROPERTY OWNER PRIOR TO ENTERING UPON NEIGHBOURING LANDS TO UNDERTAKE ANY WORK. COPIES OF THESE LETTERS OF CONSENT SHALL BE SUBMITTED TO THE DEPARTMENT OF PUBLIC WORKS FOR APPROVAL PRIOR TO ANY WORK BEING PERFORMED. FAILURE TO COMPLY WITH THE ABOVE IS AT CONTRACTOR'S OWN RISK.
- 1.16. SITE SERVICING CONTRACTOR TO TERMINATE ALL SERVICES 1 METRE FROM FOUNDATION WALL.

- 1.17. FILTER FABRIC TO BE TERRAFIX 200R OR APPROVED EQAL.
- 1.18. MAXIMUM GRASSED SLOPE TO BE 3:1. SLOPES GREATER THAN 3:1 TO BE LANDSCAPED WITH LOW MAINTENANCE GROUND COVER.
- 1.19. SIDE SLOPES OF ALL STOCKPILES OR EXTRACTION FACES TO BE MAINTAINED AT 70 DEGREES OR LESS BETWEEN EARLY APRIL AND LATE AUGUST TO DETER BANK SWALLONS FROM NESTING.
- 1.20. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL TRAFFIC AND SAFETY MEASURES DURING THE CONSTRUCTION PERIOD INCLUDING THE SUPPLY, INSTALLATION AND REMOVAL OF ALL NECESSARY SIGNALS, DELINEATORS, MARKERS, AND BARRIERS. ALL SIGNS, ETC. SHALL CONFORM TO THE STANDARDS OF THE LOCAL MUNICIPALITY AND THE MTO MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES.
- 1.21. THE POSITION OF POLE LINES, CONDUITS, WATERMAINS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND, WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, THE CONTRACTOR SHALL INFORM HIMSELF OF THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND SHALL ASSUME ALL LIABILITY FOR DAMAGE TO THEM.
- 1.22. CONTRACTOR TO MAINTAIN A "CONFINED TRENCH CONDITION" IN ALL SEWER AND SERVICE TRENCHES.

1.23. FOLLOWING COMPLETION OF PROPOSED WORKS AND PRIOR TO OCCUPANCY INSPECTION, ALL STORM AND SANITARY SEWERS ARE TO BE FLUSHED, AND ALL CATCHBASIN AND CATCHBASIN MANHOLE SUMPS ARE TO BE CLEANED OF DEBRIS AND SILT.

2. STORM SEWERS

- 2.1. PIPE BEDDING FOR RIGID PIPE TO BE CLASS "B" AS PER OPSS 802.030, 802.031, OR 802.032. PIPE BEDDING FOR FLEXIBLE PIPE TO BE AS PER OPSS 802.010, BEDDING MATERIAL AND COVER MATERIAL TO BE GRANULAR "A". TRENCH BACKFILL TO BE NATIVE MATERIAL REPLACED IN 300mm LIFTS AND COMPACTED TO 95% STANDARD PROCTOR DENSITY.
- 2.2. STORM SEWERS 200mmØ TO 375mmØ SHALL BE POLYVINYL CHLORIDE (PVC) PIPE DR35 ASTM-D3034 OR RIBBED PVC SEWER PIPE CSA B182-A-M90 ASTM-F794 WITH INTEGRAL BELL AND SPIGOT UTILIZING FLEXIBLE ELASTOMERIC SEALS. RIBBED PVC NOT TO BE USED WITHIN RIGHT-OF-WAY.
- 2.3. STORM SEWERS, 450mmØ AND LARGER, SHALL BE CONCRETE PIPE, CSA-A257.2 65-D WITH RUBBER GASKET JOINT OR RIBBED PVC SEWER PIPE CSA B182-A-M90 ASTM-F794 WITH INTEGRAL BELL AND SPIGOT UTILIZING FLEXIBLE ELASTOMERIC RIBBED PVC NOT TO BE USED WITHIN RIGHT-OF-WAY.
- 2.4. MANHOLES AND MANHOLE CATCHBASINS TO BE 1200mmØ PRECAST WITH ALUMINUM STEPS AT 300mm CENTRES AS PER OPSS 701.010 UNLESS OTHERWISE SPECIFIED.
- 2.5. CATCHBASINS TO BE 600mm SQUARE PRECAST AS PER OPSS 705.010.
- 2.6. CATCHBASIN MANHOLES AND CATCHBASINS TO HAVE A MINIMUM 600mm DEEP SUMP WHEN THE STRUCTURE INCLUDES THE INSTALLATION OF A SNOOT (OR APPROVED EQUIVALENT) THE SUMP DEPTH TO BE MIN 2.5 TIMES THE OUTLET PIPE DIAMETER SIZE.
- 2.7. MANHOLE AND CATCHBASIN, FRAMES, GRATES, CASTINGS AND LIDS TO BE QUALITY GREY IRON ASTM A48 CLASS 30B.
- 2.8. STORM MANHOLE LIDS TO BE PER OPSS 401.010 - TYPE "B" CATCHBASIN WITH 300mm ALUMINUM STEPS. LIDS TO BE PER OPSS 400.100. DITCH INLET CATCHBASIN GRATES TO BE PER OPSS 403.010.
- 2.9. STORM STRUCTURES TO HAVE A MAXIMUM OF THREE ADJUSTMENT UNITS (300mm MAXIMUM TOTAL) AND A MINIMUM OF ONE RISER.
- 2.10. STORM SEWERS AND SERVICES TO HAVE MINIMUM 1.4m COVER TO TOP OF PIPE, WHERE COVER TO TOP OF PIPE IS DEFICIENT, CONTRACTOR SHALL INSTALL SHALLOW BURIED SEWER PIPE IN ACCORDANCE WITH APPLICABLE "SEWER PIPE INSULATION DETAIL" INDICATED IN DRAWING DETAILS. INSULATION SHALL BE RIGID EXTRUDED POLYSTYRENE (EPS) BOARD, WITH A THICKNESS SUFFICIENT TO PROVIDE AN RSI-1.76 (R10) INSULATING FACTOR (TYPICALLY 50-65mm). INSULATION BOARD WIDTH SHALL BE 1.8m FOR UP TO 200mm NOMINAL PIPE DIAMETER, 2.4m FOR 201mm-800mm DIAMETER AND 3.0m FOR 801mm-1400mm. ALL JOINTS SHALL BE TIGHTLY BUTTED TOGETHER (TAPE OR OTHERWISE SECURE JOINTS TO RESIST MOVEMENT DURING BACKFILL PLACEMENT). RIGID EPS BOARD SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 140kPa (20psi), AND A MAXIMUM WATER ABSORPTION RATE OF 2.0% BY VOLUME. ACCEPTABLE PRODUCTS ARE DOW STYROFOAM-SM OR -HI (FULL LINE), OWENS CORNING FOAMULAR (200, 250, OR HIGHER), PLASTISPAN HD-M28 OR OTHER ENGINEER-APPROVED EQUIVALENT.
- 2.11. UNDER NO CIRCUMSTANCES SHALL THE BUILDING FOUNDATION DRAINS BE CONNECTED DIRECTLY TO THE STORM SEWER SYSTEM.
- 2.12. ALL WEEPING TILE DRAINAGE TO BE PUMPED TO THE STORM SEWER SYSTEM.
- 2.13. FLOW CONTROL ROOF DRAINS TO BE ZURN MODEL Z105 - SINGLE NOTCH (8.95 lpm/cm of head) OR APPROVED EQUIVALENT.

3. SANITARY SEWERS

- 3.1. PIPE BEDDING FOR RIGID PIPE TO BE CLASS "B" AS PER OPSS 802.030, PIPE BEDDING FOR FLEXIBLE PIPE TO BE AS PER OPSS 802.010, BEDDING MATERIAL AND COVER MATERIAL TO BE GRANULAR "A". TRENCH BACKFILL TO BE NATIVE MATERIAL REPLACED IN 300mm LIFTS AND COMPACTED TO 95% STANDARD PROCTOR DENSITY.
- 3.2. SANITARY SEWERS 200mmØ TO 600mmØ INCLUSIVE SHALL BE POLYVINYL CHLORIDE (PVC) PIPE DR35 ASTM-D3034 WITH INTEGRAL BELL AND SPIGOT UTILIZING FLEXIBLE ELASTOMERIC SEALS.
- 3.3. MANHOLES TO BE 1200mmØ PRECAST WITH ALUMINUM STEPS AT 300mm CENTRES AS PER OPSS 701.010 UNLESS OTHERWISE SPECIFIED.
- 3.4. MANHOLES TO BE BENCHED PER OPSS 701.021.
- 3.5. SANITARY MANHOLE LIDS TO BE PER OPSS 401.010 - TYPE "A".
- 3.6. MANHOLE FRAMES, CASTINGS AND LIDS TO BE QUALITY GREY IRON ASTM A48 CLASS 30B.
- 3.7. SANITARY STRUCTURES TO HAVE A MAXIMUM OF THREE ADJUSTMENT UNITS (300mm MAXIMUM TOTAL) AND A MINIMUM OF ONE RISER.
- 3.8. SANITARY SEWERS AND SERVICES TO HAVE MINIMUM 1.4m COVER ON TOP OF PIPE, WHERE COVER TO TOP OF PIPE IS DEFICIENT, CONTRACTOR SHALL INSTALL SHALLOW BURIED PIPE IN ACCORDANCE WITH APPLICABLE "SEWER PIPE INSULATION DETAIL" INDICATED IN DRAWING DETAILS. INSULATION SHALL BE RIGID EXTRUDED POLYSTYRENE (EPS) BOARD, WITH A THICKNESS SUFFICIENT TO PROVIDE AN RSI-1.76 (R10) INSULATING FACTOR (TYPICALLY 50-65mm). INSULATION BOARD WIDTH SHALL BE 1.8m FOR UP TO 200mm NOMINAL PIPE DIAMETER, 2.4m FOR 201mm-800mm DIAMETER AND 3.0m FOR 801mm-1400mm. ALL JOINTS SHALL BE TIGHTLY BUTTED TOGETHER (TAPE OR OTHERWISE SECURE JOINTS TO RESIST MOVEMENT DURING BACKFILL PLACEMENT). RIGID EPS BOARD SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 140kPa (20psi), AND A MAXIMUM WATER ABSORPTION RATE OF 2.0% BY VOLUME. ACCEPTABLE PRODUCTS ARE DOW STYROFOAM-SM OR -HI (FULL LINE), OWENS CORNING FOAMULAR (200, 250, OR HIGHER), PLASTISPAN HD-M28 OR OTHER ENGINEER-APPROVED EQUIVALENT.
- 3.9. CONTRACTOR RESPONSIBLE FOR TESTING OF SANITARY SEWERS IN ACCORDANCE WITH OPSS 410.

4. WATERMAINS

- 4.1. PIPE BEDDING FOR RIGID PIPE TO BE CLASS "B" AS PER OPSS 802.030, PIPE BEDDING FOR FLEXIBLE PIPE TO BE AS PER OPSS 802.010, BEDDING MATERIAL AND COVER MATERIAL TO BE GRANULAR "A". TRENCH BACKFILL TO BE NATIVE MATERIAL REPLACED IN 300mm LIFTS AND COMPACTED TO 95% STANDARD PROCTOR DENSITY.
- 4.2. WATERMAINS 100mmØ AND LARGER SHALL BE PVC C900 CLASS 150 INSTALLED WITH MINIMUM 2.0 METRES OF COVER. FITTINGS 100mmØ AND LARGER SHALL BE PVC CLASS 150 (DR18) CSA B137.3.
- 4.3. WATERMAIN FITTINGS TO BE SUPPLIED WITH MECHANICAL JOINT RESTRAINTS. FOR WATERMAIN PIPE SIZES 150mmØ OR LESS ALL PIPE JOINTS TO BE RESTRAINED WITHIN 5.0m FROM ALL FITTINGS, IN EACH DIRECTION, UNLESS SHOWN OTHERWISE ON THE CONTRACT DRAWINGS. FOR WATERMAIN PIPE SIZES GREATER THAN 150mmØ ALL PIPE JOINTS TO BE RESTRAINED WITHIN 10.0m FROM ALL FITTINGS, IN EACH DIRECTION, UNLESS SHOWN OTHERWISE ON THE CONTRACT DRAWINGS. ALL TEES TO HAVE MINIMUM 2.0m SOLID PIPE LENGTH ON EACH RUN OF THE TEE, OR PROVIDE A THRUST BLOCK PER OPSS 1103.010.
- 4.4. ALL METALLIC FITTINGS (EXCLUDING CURB/MAIN STOP AND BRASS FITTINGS) AND APPURTENANCES INCLUDING SADDLES, VALVES, TEES, BENDS ETC ARE TO BE WRAPPED WITH AN APPROVED PETROLATUM SYSTEM CONSISTING OF PASTE, MASTIC AND TAPE. PARTICULAR ATTENTION SHALL BE PAID TO ANODE INSTALLATION. CONTRACTOR TO REFER TO THE MOST RECENT EDITION OF THE LOCAL MUNICIPALITY AND AREA MUNICIPALITIES DESIGN GUIDELINES AND SUPPLEMENTAL SPECIFICATIONS FOR MUNICIPAL SERVICES.
- 4.5. WATERMAIN VALVES 100mmØ AND LARGER SHALL BE AS PER AWWA C509 - MUELLER A2360-23 OR APPROVED EQUIVALENT (OPEN LEFT) INCLUDING VALVE BOX AND 2.3kg ANODE INCLUDING ANODE PROTECTION INSTALLED PER LOCAL MUNICIPALITY STANDARDS.

- 4.6. PVC WATERMAIN SHALL HAVE TWO STRANDED COPPER, AWG#8 CATHODIC PROTECTION ANODES PER 100m OF PIPE. ANODE TRACER WIRE SHALL BE BROUGHT TO THE SURFACE AT ALL HYDRANTS AND CAD WELDED TO THE LOWER FLANGE OF THE HYDRANT.
- 4.7. HYDRANTS SHALL BE CANADA VALVE "CENTURY" OR APPROVED EQUIVALENT WITH 2-64mm HOSE CONNECTIONS INCLUDING 5.5kg ANODE.
- 4.8. MAIN STOPS, CURB STOPS AND COUPLINGS SHALL BE AWWA C-601 OR APPROVED EQUIVALENT. MAIN STOPS TO BE INSTALLED IN ACCORDANCE WITH AWWA C-601-99 INCLUDING COLORATION, BACKFLOW PREVENTOR AND 24 HOUR DUPLICATE SAMPLING. ALL TESTING AND DISINFECTION TO BE COMPLETED UNDER THE SUPERVISION OF THE ENGINEER. (CONTRACTOR TO SUBMIT WATER COMMISSIONING PLAN. THIS PLAN MUST BE APPROVED BY THE LOCAL MUNICIPALITY PRIOR TO ANY WATERMAIN WORK).
- 4.9. SERVICE BOXES TO BE FERGUSON EQUIPUE TYPE FIGURE 222 TYPE NO. 10 OR APPROVED EQUIVALENT COMPLETE WITH ROD AND PLUG.
- 4.10. WATER CONNECTIONS MAY BE PLACED IN THE SAME TRENCH WITH A STORM OR SANITARY CONNECTION ONLY IF A MINIMUM VERTICAL SEPARATION OF 500mm IS MAINTAINED BETWEEN THE STORM AND SANITARY CONNECTIONS. INSULATION WITH SECTION 7.3.5.7.(2)(a)(i) OF THE ONTARIO BUILDING CODE.

- 4.11. ALL WATERMAINS AND SERVICES TO HAVE MINIMUM 2.0m COVER ON TOP OF PIPE, WHERE COVER TO TOP OF PIPE IS DEFICIENT, CONTRACTOR SHALL INSTALL SHALLOW BURIED PIPE IN ACCORDANCE WITH APPLICABLE "WATER PIPE INSULATION DETAIL" INDICATED IN DRAWING DETAILS. INSULATION SHALL BE RIGID EXTRUDED POLYSTYRENE (EPS) BOARD, WITH A THICKNESS SUFFICIENT TO PROVIDE AN RSI-3.52 (R20) INSULATING FACTOR (TYPICALLY 100-130mm). INSULATION BOARD WIDTH SHALL BE 2.4m FOR UP TO 200mm NOMINAL PIPE DIAMETER, 3.0m FOR 201mm-305mm DIAMETER. INSULATION BOARD SHALL BE INSTALLED WITH MINIMUM-LAYERS OVERLAPPED MINIMUM 300mm AT ALL JOINTS. ALL JOINTS SHALL BE TIGHTLY BUTTED TOGETHER (TAPE OR OTHERWISE SECURE JOINTS TO RESIST MOVEMENT DURING BACKFILL PLACEMENT). RIGID EPS BOARD SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 140kPa (20psi), AND A MAXIMUM WATER ABSORPTION RATE OF 2.0% BY VOLUME. ACCEPTABLE PRODUCTS ARE DOW STYROFOAM-SM OR -HI (FULL LINE), OWENS CORNING FOAMULAR (200, 250, OR HIGHER), PLASTISPAN HD-M28 OR OTHER ENGINEER-APPROVED EQUIVALENT.

- 4.12. ALL WATERMAIN TO BE PRESSURE TESTED IN ACCORDANCE WITH OPSS 441. DISINFECT ALL WATERMAIN IN ACCORDANCE WITH AWWA C 651-99 INCLUDING COLORATION, BACKFLOW PREVENTOR AND 24 HOUR DUPLICATE SAMPLING. ALL TESTING AND DISINFECTION TO BE COMPLETED UNDER THE SUPERVISION OF THE ENGINEER. (CONTRACTOR TO SUBMIT WATER COMMISSIONING PLAN. THIS PLAN MUST BE APPROVED BY THE LOCAL MUNICIPALITY PRIOR TO ANY WATERMAIN WORK).

- 4.13. PRIOR TO OCCUPANCY, CONTRACTOR MUST COMMISSION FIRE FLOW TEST FOR PRIVATE ON-SITE HYDRANT, PROVIDE RESULT TO DESIGN ENGINEER.

5. EROSION AND SEDIMENT CONTROL

- 5.1. CONTRACTOR TO INSTALL EROSION CONTROL MEASURES AS SHOWN PRIOR TO CONSTRUCTION AND MAINTAIN IN GOOD CONDITION UNTIL CONSTRUCTION IS COMPLETED AND ALL DISTURBED GROUND SURFACES HAVE BEEN RESTABILIZED EITHER BY PAVING OR RESTORATION OF VEGETATIVE COVER.
- 5.2. ALL SEDIMENT CONTROL FENCING TO BE INSTALLED PRIOR TO ANY AREA GRADING, EXCAVATING OR DEMOLITION COMMENCING.
- 5.3. EROSION CONTROL FENCING TO BE INSTALLED AROUND BASE OF ALL STOCKPILES. ALL STOCKPILES TO BE KEPT 2.5m MINIMUM FROM PROPERTY LINE.
- 5.4. EROSION PROTECTION TO BE PROVIDED AROUND ALL STORM AND SANITARY MHS AND CBS.
- 5.5. CONSTRUCTION ACCESS (MUD MAT) TO BE PROVIDED ON-SITE AT ALL LOCATIONS WHERE CONSTRUCTION VEHICLES EXIT THE SITE. CONSTRUCTION ACCESS (MUD MAT) SHALL BE A MINIMUM OF 3.0m WIDE, 15.0m LONG (LENGTH MAY VARY DEPENDING ON SITE LAYOUT) AND 0.3m DEEP AND SHALL CONSIST OF 200mm CLEAR STONE MATERIAL OR APPROVED EQUIVALENT. PROPOSED EROSION FENCING TO BE TIED INTO MUD MAT. CONTRACTOR TO ENSURE ALL VEHICLES LEAVE THE SITE VIA THE MUD MAT AND THAT THE MAT IS MAINTAINED IN A MANNER TO MAXIMIZE EFFECTIVENESS AT ALL TIMES.
- 5.6. ADDITIONAL EROSION CONTROL MEASURES MAY BE REQUIRED AS SITE DEVELOPMENT PROGRESSES. CONTRACTOR TO PROVIDE ALL ADDITIONAL EROSION CONTROL STRUCTURES.

- 5.7. EROSION CONTROL STRUCTURES TO REMAIN IN PLACE UNTIL ALL DISTURBED GROUND SURFACES HAVE BEEN RESTABILIZED.
- 5.8. NO ALTERNATE METHODS OF EROSION PROTECTION SHALL BE PERMITTED UNLESS APPROVED BY THE ENGINEER AND THE LOCAL MUNICIPALITY.
- 5.9. CONTRACTOR TO CLEAN ROADWAY AND SIDEWALKS OF SEDIMENTS RESULTING FROM CONSTRUCTION TRAFFIC FROM THE SITE EACH DAY.

- 5.10. CONTRACTOR MUST REMOVE EROSION AND SEDIMENTATION FENCING PRIOR TO COMPLETION OF PROJECT. CONTRACTOR TO HAVE EROSION AND SEDIMENTATION FENCE INSPECTED WHEN VEGETATION HAS ESTABLISHED, BUT PRIOR TO FENCE BECOMING OVERGROWN. ENGINEER'S REPRESENTATIVE TO DETERMINE IF VEGETATION HAS REACHED THE CRITICAL POINT AND WILL THEN INSTRUCT CONTRACTOR TO REMOVE FENCE.






6. MAINTENANCE RECOMMENDATIONS

- 6.1. EROSION CONTROL STRUCTURES TO BE MONITORED REGULARLY AND ANY DAMAGE REPAIRED IMMEDIATELY. SEDIMENTS TO BE REMOVED WHEN ACCUMULATIONS REACH A MAXIMUM OF 1/3 THE HEIGHT OF THE FENCE.
- 6.2. OWNER'S REPRESENTATIVE TO MONITOR EROSION CONTROL STRUCTURES TO ENSURE FENCING IS INSTALLED AND MAINTENANCE IS PERFORMED TO CITY REQUIREMENTS.
- 6.3. THE PROPOSED STORMCATCHER(STC) WILL REQUIRE REGULAR ANNUAL MAINTENANCE. OWNER TO ENTER INTO A MAINTENANCE AGREEMENT WITH A SUITABLE CONTRACTOR TO COMPLETE THIS WORK.

PAVEMENT STRUCTURE



MATERIAL	RECOMMENDED THICKNESS
ASPHALTIC	HL3
CONCRETE	HL4 OR HL8
GRANULAR 'A' BASE	150mm
GRANULAR 'B' SUBBASE	300mm

BASED ON GEOTECHNICAL INVESTIGATION PREPARED BY: TORONTO INSPECTION INC. - MARCH 6, 2019

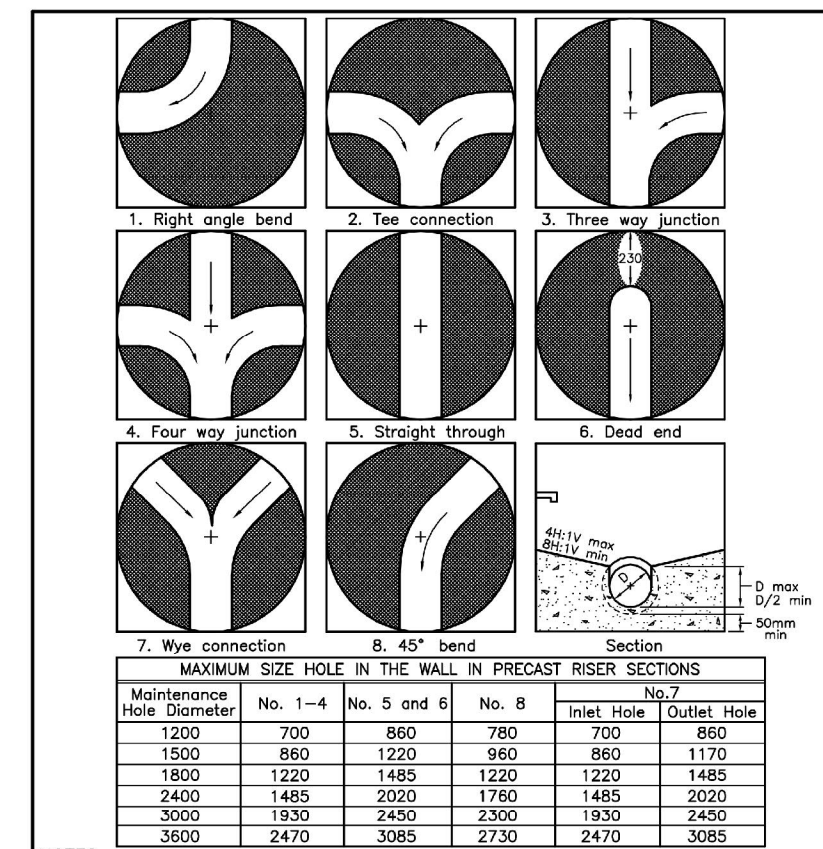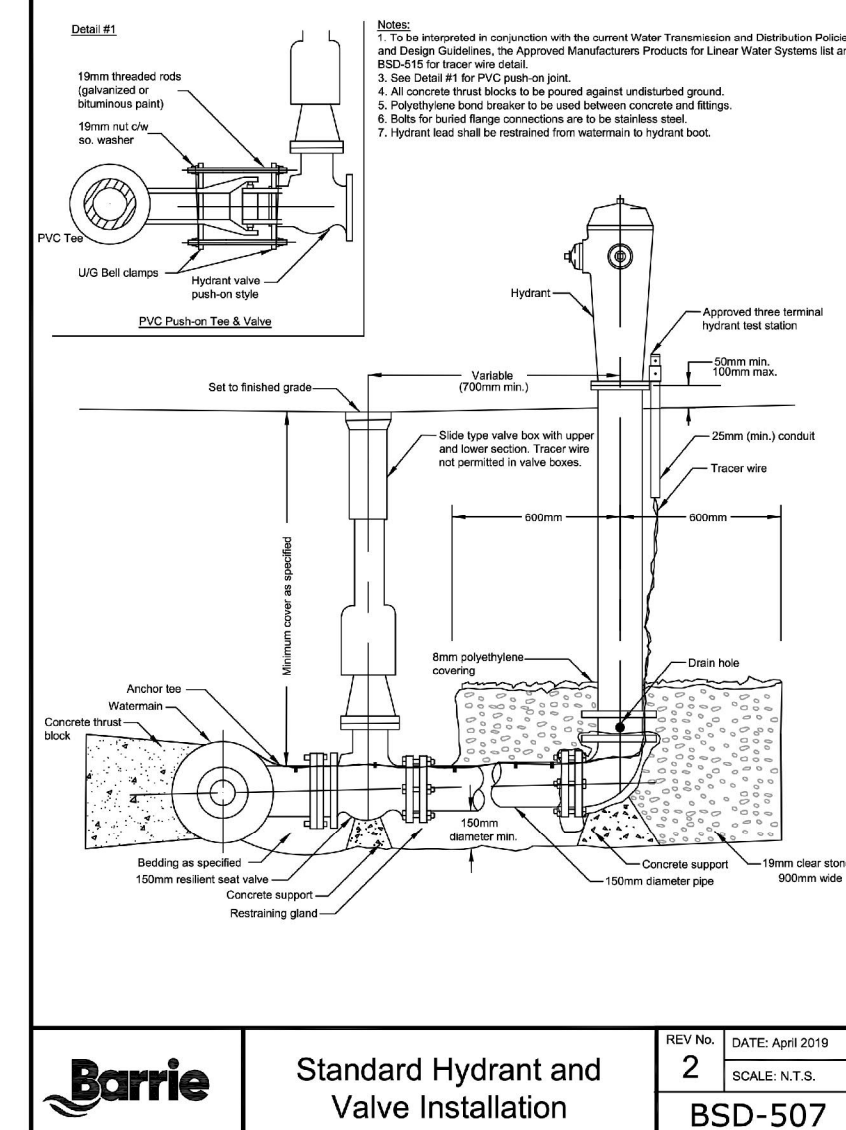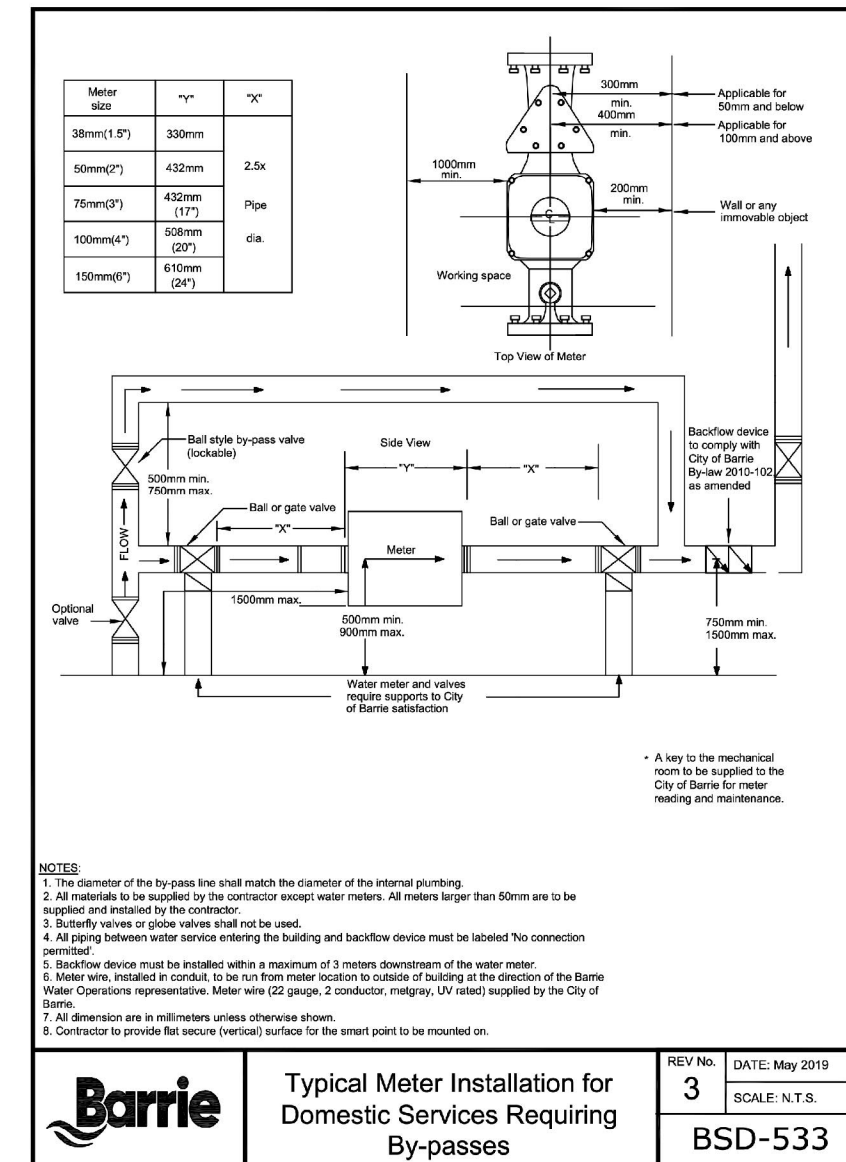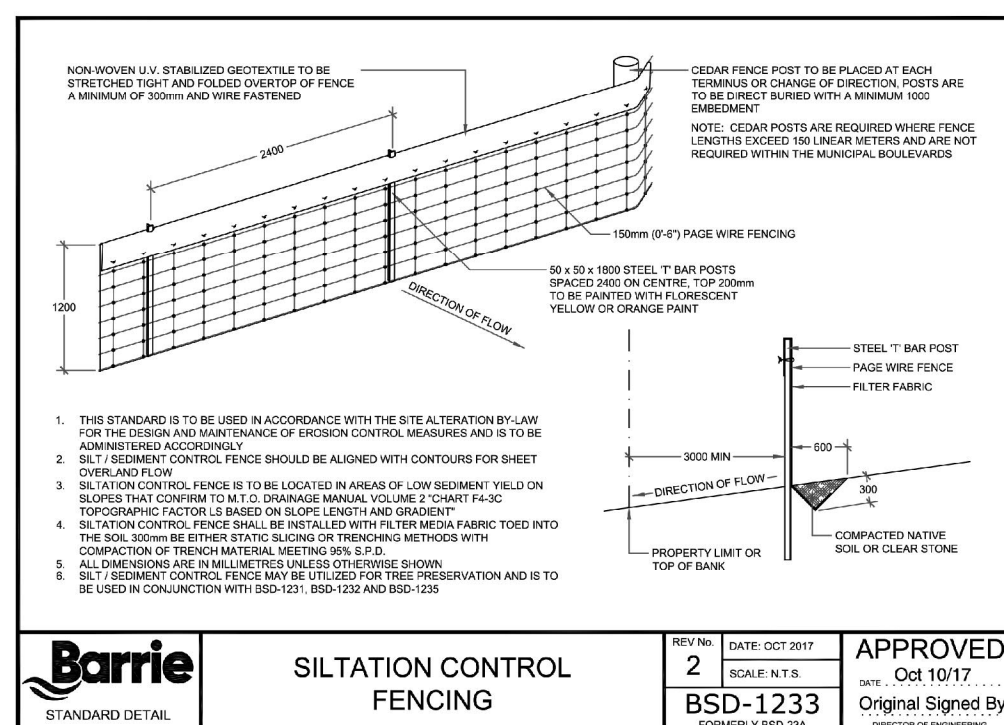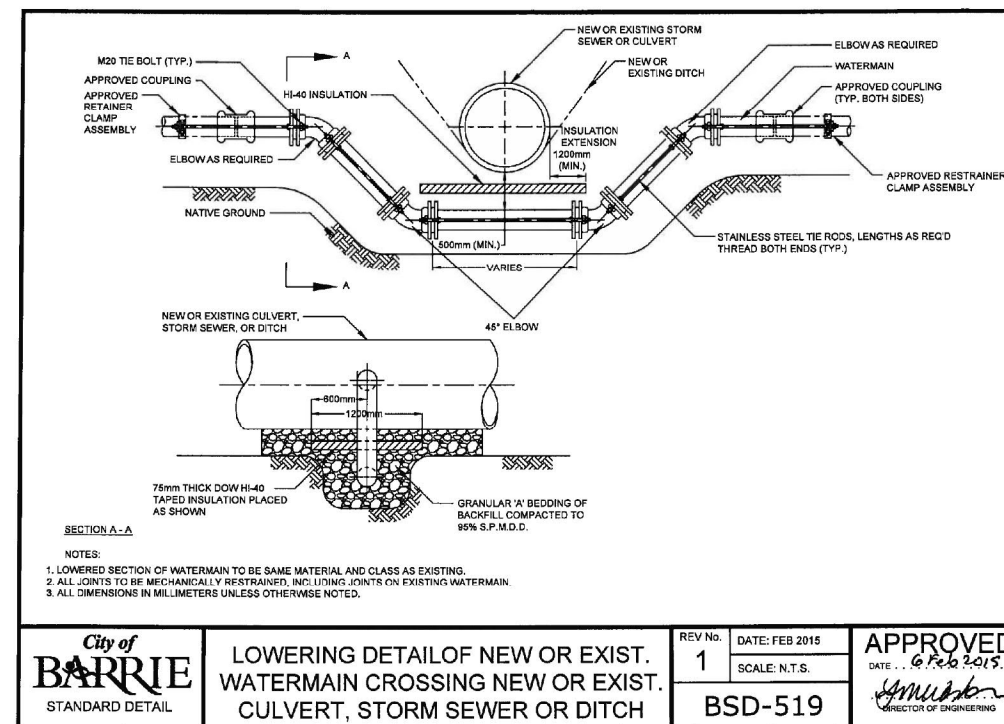

MAXIMUM SIZE HOLE IN THE WALL IN PRECAST RISER SECTIONS	No. 1-4	No. 5 and 6	No. 8	No. 10
Maintenance Hole Diameter	1200	700	850	780
	1500	850	1220	850
	1800	1220	1485	1220
	2400	1485	2020	1780
	3000	2300	2400	2400
	3600	2470	3085	2730
				2470
				3085

CONCRETE BARRIER CURB	Nov 2012 Rev 2
OPSS 600.110	

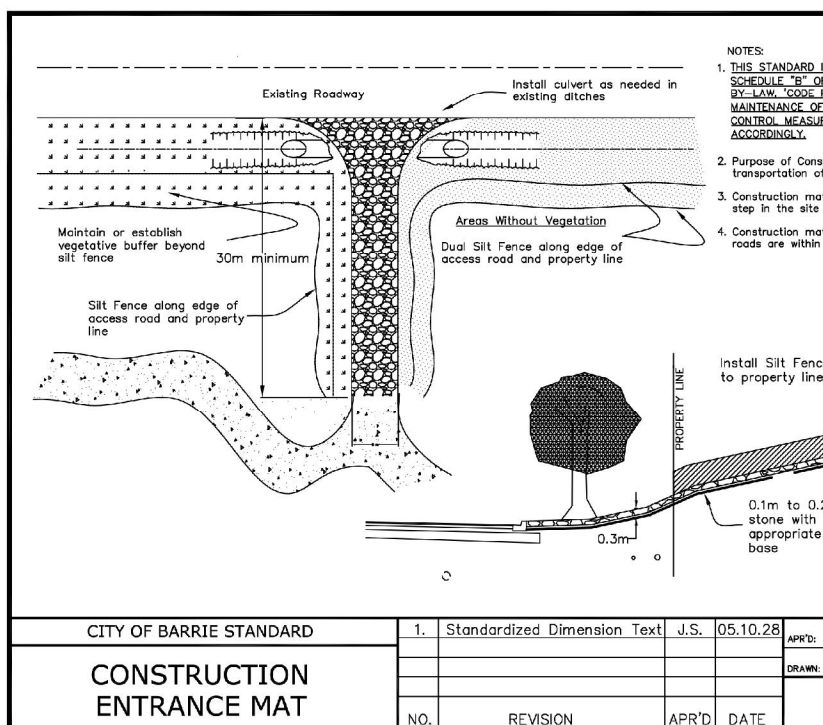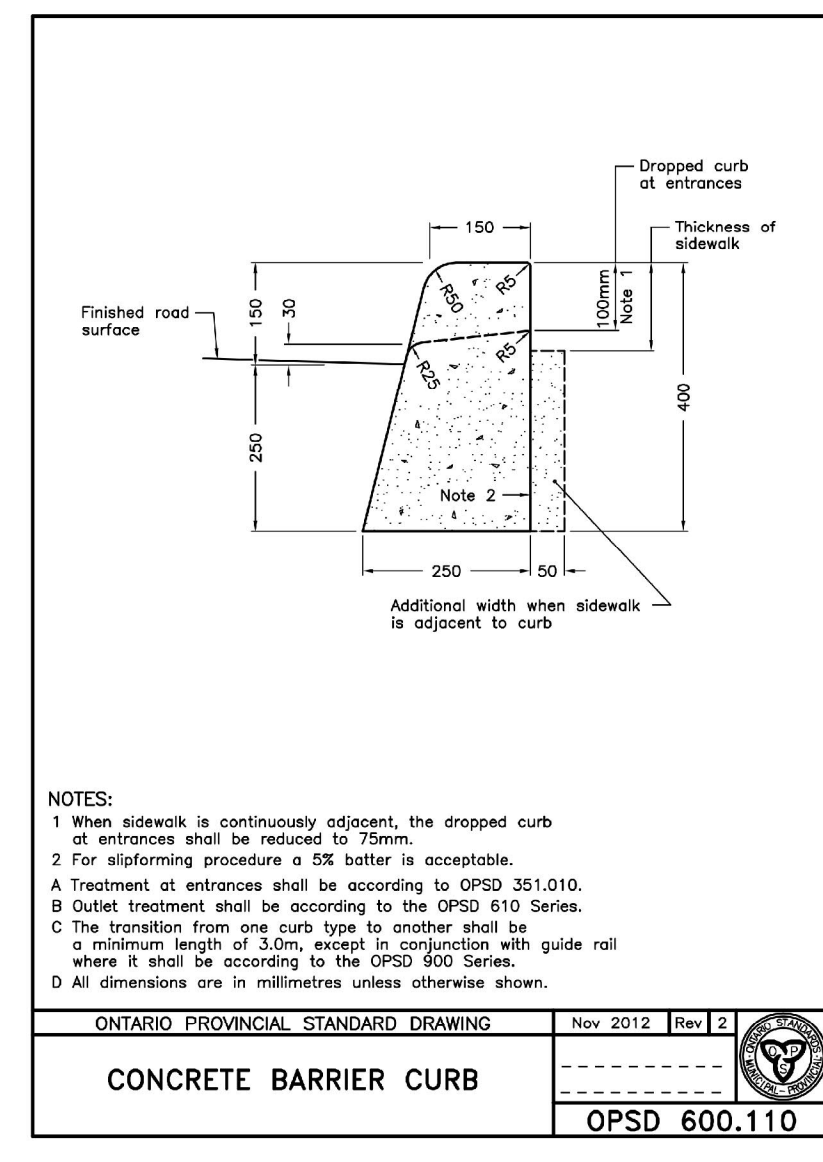

- NOTE:**
1. PROPERTY-LINE IS APPROXIMATE ONLY AND IS TAKEN FROM PLAN PREPARED BY EPLETT & WOROBEC SURVEYING LTD. DATED OCTOBER 23, 1995 AND FEBRUARY 24, 2010.
 2. INVERTS DENOTED WITH "±" ARE TAKEN FROM AS-RECORDED PLAN AND PROFILE DRAWINGS COMPLETED BY SKELTON BRUNWELL & ASSOCIATES INC. DATED OCTOBER, 1995 AND ARE CONSIDERED APPROXIMATE ONLY. CONTRACTOR TO FIELD VERIFY AND REPORT ANY DISCREPANCIES TO ENGINEER.
 4. THIS PLAN IS PART OF A SET OF PLANS WHICH COMPRISE OF THE FOLLOWING: C1.1, C2.1, C2.2, C2.3, C2.4 AND THE SWM REPORT.

CITY OF BARRIE CONTROL MONUMENTS:

- (1) MONUMENT # 03120080046
TYPE: BRASS TABLET
ELEVATION: 303.551
- (2) MONUMENT # 03120080048
TYPE: BRASS TABLET
ELEVATION: 302.523


NOTE TO CONTRACTOR :

DO NOT SCALE DRAWINGS.

CONTRACTORS MUST CHECK AND VERIFY ALL DIMENSIONS AND REPORT ANY DISCREPANCIES TO THE ENGINEER BEFORE PROCEEDING WITH THE WORK.

ALL DRAWINGS REMAIN THE PROPERTY OF THE ENGINEER AND SHALL NOT BE REPRODUCED OR REUSED WITHOUT THE ENGINEER'S WRITTEN PERMISSION.

THE OWNER/ARCHITECT/CONTRACTOR IS ADVISED THAT M.T.E. CONSULTANTS INC. CANNOT CERTIFY ANY COMPONENT OF THE SITE WORKS NOT INSPECTED DURING CONSTRUCTION. IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO NOTIFY M.T.E. CONSULTANTS INC. PRIOR TO COMMENCEMENT OF CONSTRUCTION TO ARRANGE FOR INSPECTION.

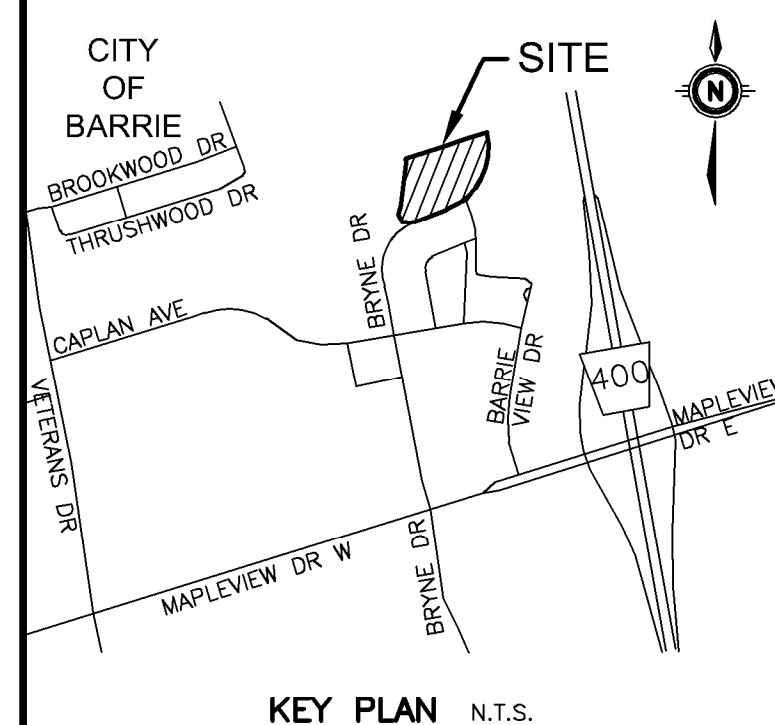

NO.	REVISION	DATE
8.		
7.		
6.		
5.		
4.		
3.	Revised per City Comments	JPL JUL 23/20
2.	Revised per City comments	JPL MAR 31/20
1.	ISSUED FOR APPROVAL	JPL DEC 12/19
NO.	REVISION	DATE

GEODETIC BM ELEV. =303.551 m
BRASS TABLET LOCATED ON EAST LANE, BRYNE DRIVE ON SOUTH SIDE OF ENTRANCE TO #311 BRYNE DRIVE. NOTE: A PROTECTIVE WATER VALVE COVER HAS BEEN PLACED OVER A MONUMENT CAP.

SITE BENCHMARK ELEV. = m
SEE ABOVE.

CLIENT

2599974 ONTARIO INC.

204 COOKS MILL CRESCENT

PROJECT

VAUGHAN

BARRIE

326 BRYNE DRIVE

DRAWING

HOLIDAY INN EXPRESS

BARRIE

Project Manager J.LERCH

Design By CAH

Drawn By DDK

Surveyed By MTE

Date Jan.25/19

Scale 1:300

Sheet 4 of 5

C2.3

DETAILS AND NOTES PLAN 1

MTE
Engineers, Scientists, Surveyors

(519) 743-6500

www.mte85.com

Project Manager J.LERCH

Design By CAH

Drawn By DDK

Surveyed By MTE

Date Jan.25/19

Scale 1:300

Sheet 4 of 5

C2.3

DETAILS AND NOTES PLAN 1