

# CORIX®

## Water Services

10 Estate Drive, Toronto, Ontario M1H 2Z1

Phone: 416.282.1665 Fax: 416.282.7702 Toll Free: 1.888.349.2493

[www.corix.com](http://www.corix.com)

SITE NAME: Valdor Engineering DATE: May 22/19

LOCATION: 681 Yonge St, Barrie

TEST DATA TIME OF TEST: 9:15am


LOCATION OF TEST: (FLOW) Ashford Dr @ Yonge St - CV 3P

(RESIDUAL) Madeleine Dr @ Yonge St - CV 3P

MAIN SIZE: 300mm

STATIC PRESSURE: 70psi

	NUMBER OF OUTLETS & ORIFICE SIZE	PITOT PRESSURE	FLOW (U.S. G.P.M.)	RESIDUAL PRESSURE
# 1	1 x 1 1/8"	72psi	318	78psi
# 2	1 x 1 3/4"	64psi	727	70psi
# 3	1 x 2 1/2"	60psi	1297	72psi
# 4	2 x 2 1/2"	40psi	2118	68psi

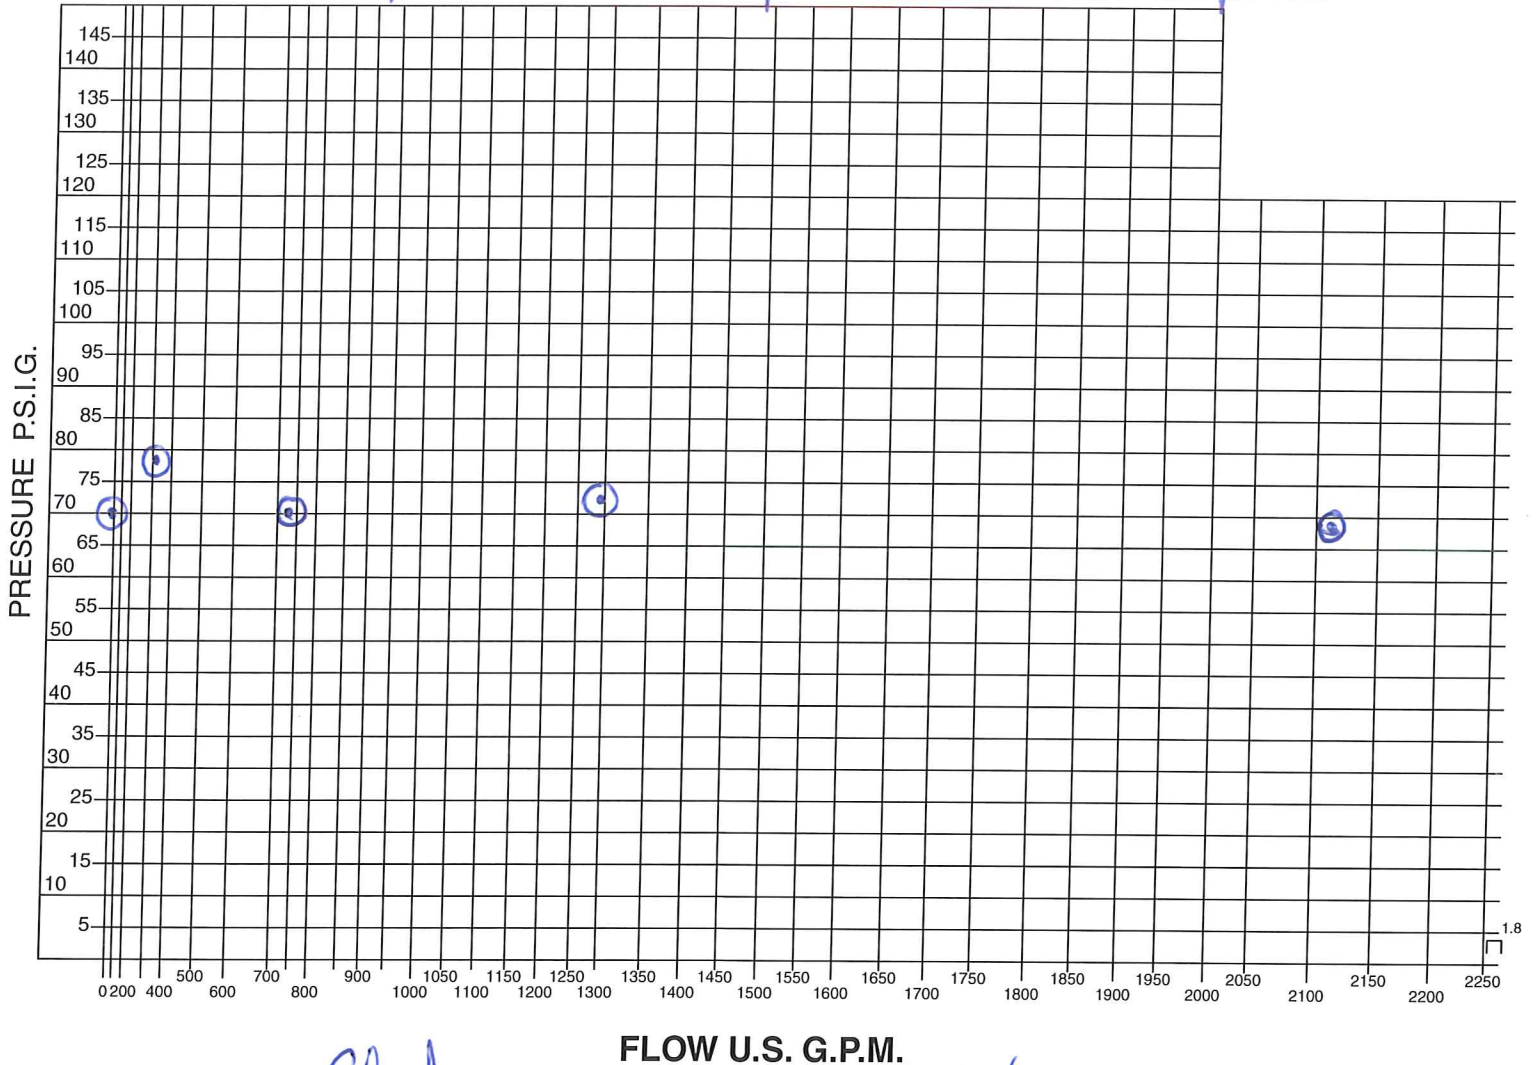

**FLOW U.S. G.P.M.**

COMMENTS: Performed one complete NFPA 291 flow test as required.

Authorized Signature \_\_\_\_\_ Corix Water Services Signature [Signature]