







NOTES FOR SEDIMENT & EROSION CONTROL

- DISTURBED AREAS THAT HAVE FAILED TO HAVE STABLE GROUND COVER ESTABLISHED BY OCTOBER 30TH SHALL BE PROTECTED WITH A SILTATION CONTROL FENCE OR STRAW MULCH ETC. AND MAINTAINED BY THE CONTRACTOR UNTIL VEGETATION BECOMES ESTABLISHED IN THE SUBSEQUENT GROWING SEASON.
- ANY DEWATERING WASTE SHALL BE DISCHARGED TO A VEGETATED AREA AT LEAST 30 M FROM ANY WATERCOURSE AND FILTERED. FILTERING METHODS MUST BE APPROVED BY THE SITE ADMINISTRATOR.
- SILT FENCE SHALL BE PUT IN PLACE PRIOR TO AND MAINTAINED DURING ALL GRADING. SILT FENCE SHALL COMPLY WITH OPSD 219.110 FOR LIGHT DUTY AND / OR OPSD 219.130 FOR HEAVY DUTY, UNLESS NOTED OTHERWISE. SILT FENCE TO BE INSPECTED PRIOR TO COMMENCEMENT OF EARTH GRADING ACTIVITIES. SILT FENCE TO BE INSPECTED AND REPAIRED OR REPLACED IF DAMAGED AS DIRECTED BY THE SITE ADMINISTRATOR. SILT CONTROLS TO BE INSPECTED ON A REGULAR BASIS AND AFTER EVERY RAIN EVENT. INSTALLATION SHALL BE TO THE MANUFACTURER'S SUGGESTED SPECIFICATIONS.
- THE CONTRACTOR SHALL BE PREPARED FOR UNEXPECTED CONDITIONS AND ACCORDINGLY HAVE STOCKPILED MATERIALS ON SITE FOR NECESSARY REPAIRS AS A RESULT OF FAILED OR INADEQUATE CONTROL MEASURES. ALL SEDIMENT AND EROSION CONTROL MEASURES SHALL BE INSPECTED AT LEAST ONCE A WEEK, AND AFTER EVERY RAINFALL EVENT.
- MUD MATS WHERE CONSTRUCTION TRAFFIC ENTERS OR LEAVES THE SITE SHALL BE USED. MUD MATS TO BE 300mm IN DEPTH, 6.0m WIDE BY 20.0m LONG, FIRST 10.0m TO 150mm# CLEAR STONE WITH THE REMAINING 10.0m CONSISTING OF 50mm# CLEAR STONE, OR MEET MUNICIPAL STANDARDS WHERE IDENTIFIED.
- CONTRACTOR SHALL OBTAIN A CURRENT COPY AND BECOME FAMILIAR WITH OPSS 805, CONSTRUCTION SPECIFICATION FOR TEMPORARY EROSION AND SEDIMENT CONTROL MEASURES AS WELL AS ALL APPLICABLE MUNICIPAL STANDARDS.
- THE CONTRACTOR MAY CONSIDER ALTERNATIVE SEDIMENT AND EROSION CONTROL MEASURES. SUCH MEASURES SHOULD BE PRESENTED IN WRITING FOR APPROVAL OF THE SITE ADMINISTRATOR AND MUST BE APPROVED IN WRITING BY THE CONSERVATION AUTHORITY.
- THE TOPS OF ALL FILTER FABRIC MUST BE A MINIMUM OF 1.0 METRE ABOVE THE GROUND LEVEL AND ATTACHED TO THE FENCE WITH A CONTINUOUS STEEL WIRE. ALTERNATIVELY, THE FILTER FABRIC MUST BE FOLDED OVER THE TOP OF THE FENCE AND ATTACHED TO THE FENCE WITH WIRE LOOPED THROUGH THE FABRIC ON BOTH SIDES OF THE FENCE. FILTER FABRIC IS TO BE TERRAFIX 270R OR EQUIVALENT.
- ALL DISTURBED GROUND LEFT INACTIVE SHALL BE STABILIZED BY SEEDING, SODDING, MULCHING, OR COVERING OR OTHER EQUIVALENT CONTROL MEASURES. THIS PERIOD OF INACTIVITY SHALL BE AT THE DISCRETION OF THE MUNICIPAL DIRECTOR OF ENGINEERING BUT SHALL NOT EXCEED (30) DAYS OR SUCH LONGER PERIOD DEEMED ADVISABLE BY THE MUNICIPAL DIRECTOR OF ENGINEERING.
- CONTRACTOR SHALL INSTALL AND MAINTAIN CATCHBASIN SEDIMENT BARRIERS THROUGHOUT THE SITE DURING ALL CONSTRUCTION ACTIVITIES IN ORDER TO MITIGATE SEDIMENT ENTERING THE STORM SEWERS.
- NO FUEL TO BE STORED ON SITE. IN CASE OF A SPILL PLEASE CONTACT MOECC SPILLS ACTION CENTER 1-800-268-6060.
- SEDIMENT CONTROLS ARE TO REMAIN IN PLACE UNTIL WRITTEN DIRECTION IS RECEIVED FROM THE ENGINEER REGARDING THEIR REMOVAL.
- EROSION AND SEDIMENT CONTROLS WILL BE INSPECTED ON AS PER MUNICIPAL REQUIREMENTS OR AFTER SIGNIFICANT RAINFALL EVENTS.
- CONTRACTOR TO MONITOR LOCAL ROAD FOR SEDIMENT BUILT UP, CONTRACTOR TO CLEAN LOCAL ROAD AS NEEDED.

SEQUENCE OF CONSTRUCTION

- ENGINEER TO BE NOTIFIED PRIOR TO INITIATION OF ANY ON SITE WORKS.
- SILT FENCE AND CONSTRUCTION ACCESS MATS TO BE INSTALLED PRIOR TO THE COMMENCEMENT OF ANY WORKS ON SITE.
- VEGETATION REMOVAL MAY COMMENCE AFTER ALL SILT FENCE IS INSTALLED AND APPROVED BY THE ENGINEER.
- COMMENCE WITH EARTH EXCAVATION AND SITE SERVICING (TO BE REMOVED FROM SITE - NO STOCKPILE).
- EROSION CONTROL MEASURES TO BE MAINTAINED AS DIRECTED BY THE ENGINEER DURING THE CONSTRUCTION PERIOD. ADDITIONAL CONTROL MEASURES MAY BE REQUIRED AT THE DISCRETION OF THE ENGINEER.
- ALL DISTURBED GROUND LEFT INACTIVE FOR MORE THAN 30 DAYS SHALL BE STABILIZED WITH SEED, SOD, MULCH OR OTHER ADEQUATE COVERING, AS INSTRUCTED BY THE ENGINEER.

LEGEND

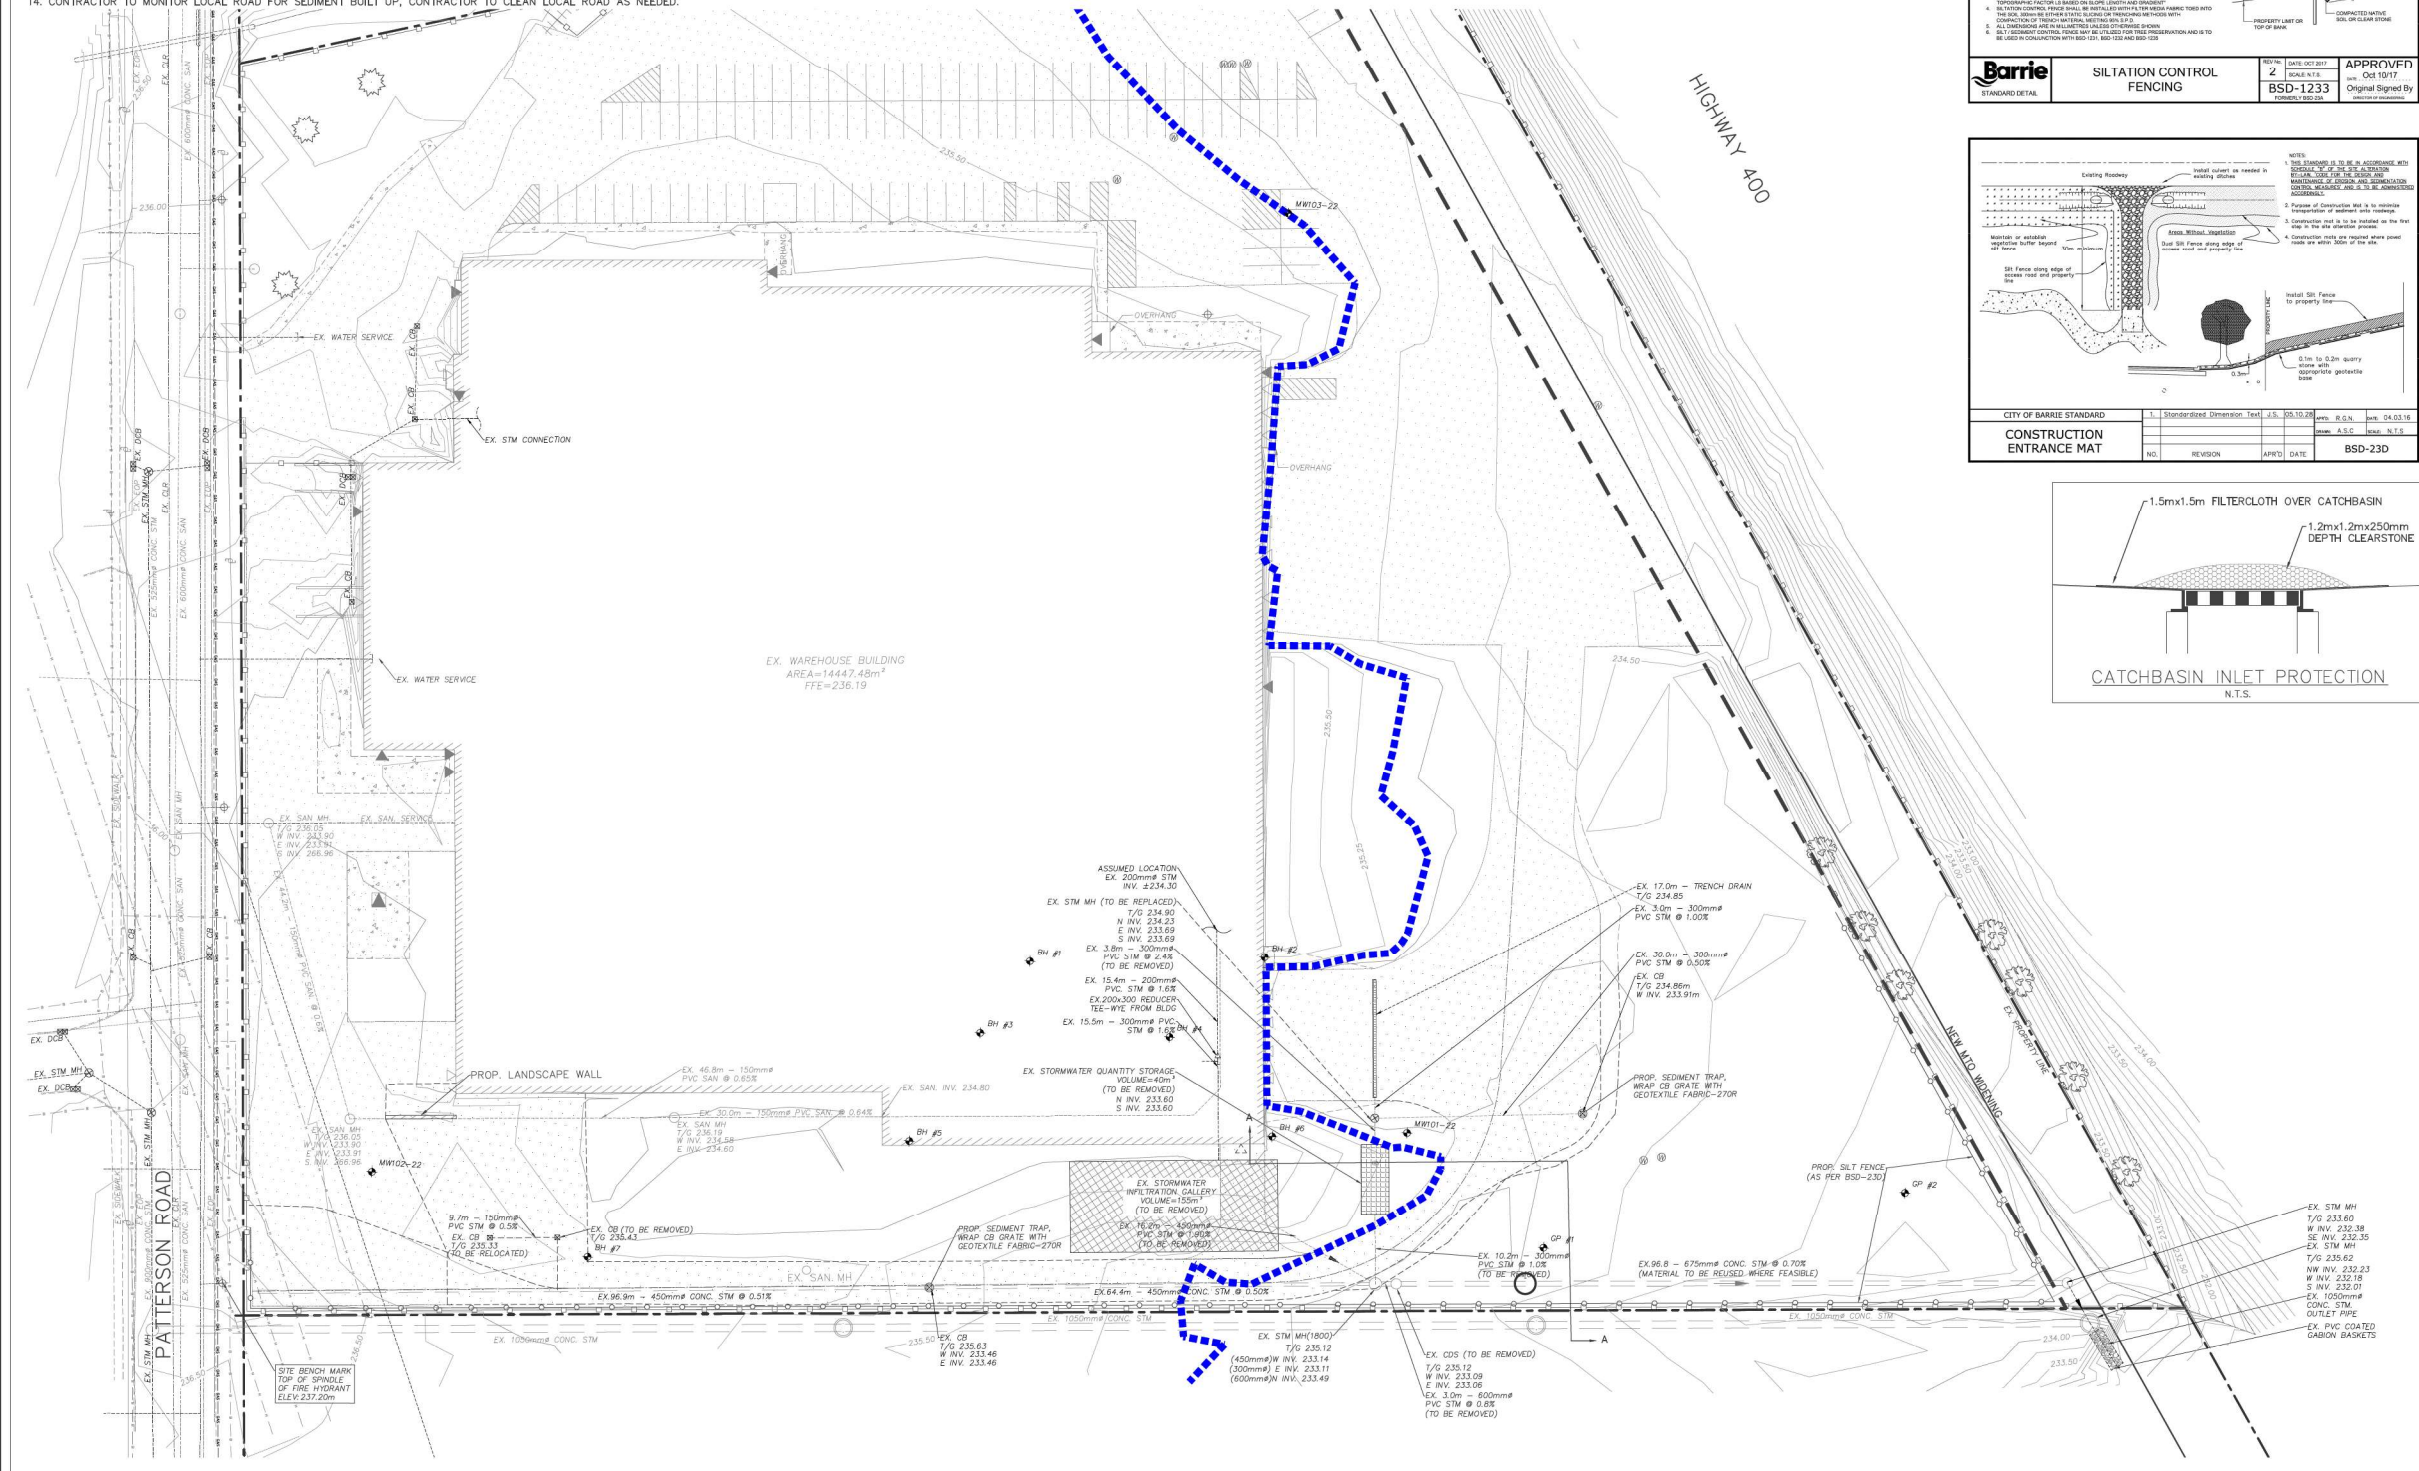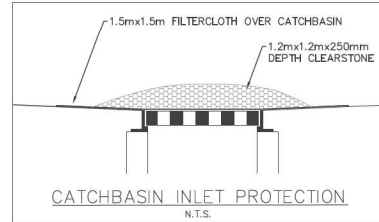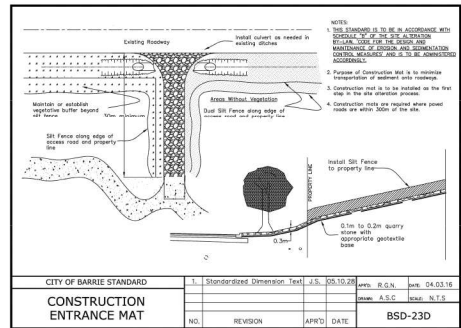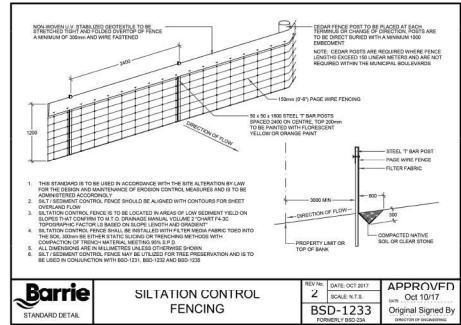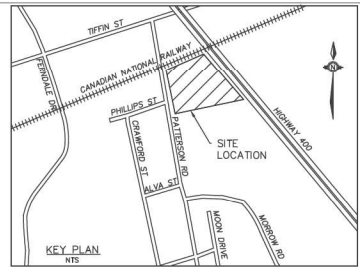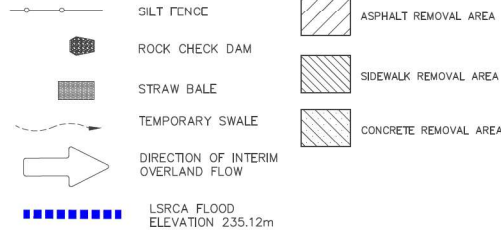

Gerrits
ENGINEERING

222 Mapleview Drive West, Suite 300
Barrie, ON L4N 9E7 Canada
Tel: 705.737.3303
Fax: 705.737.1772
www.gerritseng.com

This drawing has been revised electronically.
Handwritten or manual revisions to the drawing are only valid when accompanied by the design engineer's initials.

Do not scale drawings.
Check and verify all dimensions and information on the drawings and report all errors or omissions to the Consultant before proceeding with the work.
This drawing shall not be reproduced in any manner, in part or in whole, for any project other than that for which it was prepared.
This drawing, and all design concepts it contains, are an instrument of professional service and remain the property of Gerrits Engineering.

This drawing may have been reduced.

No.	Issuance Description	YYMMDD
1.	SITE PLAN APPROVAL	22/05/10
2.	SITE PLAN APPROVAL REV-1	22/11/03
3.	LSRCA SPA COMMENTS	23/01/06
4.	SITE PLAN APPROVAL REV-2	23/02/14

SITE PLAN APPROVAL REV-2

Client
canplas
INDUSTRIES LTD.

Project
**CANPLAS WAREHOUSE
ADDITION**
31 Patterson Rd., Barrie, ON L4N 3V9

Drawing:
**EROSION & SEDIMENT
CONTROL PLAN
& REMOVALS PLAN**

Project No. 873-009 Designed by: KF Checked by: KF
Scale: 1:500 Drawn by: RM Approved by: JDM
Orientation: Stamp



Drawing No.
ESC& RM-1

1. THE NOTES ON THIS SHEET APPLY TO ALL WORKS UNDER THIS CONTRACT UNLESS OTHERWISE NOTED ON THE SPECIFIC DETAIL DWGS.
2. THE STANDARD DRAWINGS OF THE LOCAL MUNICIPALITY , ONTARIO PROVINCIAL STANDARDS AND SPECIFICATIONS (OPSS) AND THE ONTARIO PROVINCIAL STANDARD DRAWINGS (OPSD) CONSTITUTE PART OF THE PLANS OF THIS CONTRACT.

1. ALL DIMENSIONS ARE IN METRES, EXCEPT PIPE DIAMETERS, WHICH ARE IN MILLIMETRES, UNLESS SPECIFIED OTHERWISE.
2. ALL DIMENSIONS SHALL BE CHECKED AND VERIFIED IN THE FIELD BY THE CONTRACTOR PRIOR TO ANY CONSTRUCTION, AND ANY DISCREPANCIES SHALL BE REPORTED IMMEDIATELY TO THE ENGINEER.

1. EXISTING SERVICES AND UTILITIES SHOWN ON THESE CONTRACT DRAWINGS ARE BASED ON THE BEST INFORMATION AVAILABLE, AND THEIR LOCATIONS ARE NOT GUARANTEED. THE CONTRACTOR SHALL INTERPRET THIS INFORMATION AS THEY WISH WITH THE UNDERSTANDING THAT THE OWNER DISCLAIMS ALL RESPONSIBILITY FOR ITS ACCURACY AND/OR SUFFICIENCY. THE CONTRACTOR IS REQUIRED TO NOTIFY THE VARIOUS UTILITY COMPANIES 48 HOURS PRIOR TO THE COMMENCEMENT OF ANY WORK.

2. NATIVE MATERIAL, SUITABLE FOR BACKFILL, SHALL BE COMPACTED TO 95% STANDARD PROCTOR MAXIMUM DRY DENSITY.
3. GRANULAR MATERIAL, USED FOR BACKFILL, SHALL BE PLACED IN LAYERS 150mm DEPTH MAXIMUM AND COMPACTED TO 100% STANDARD PROCTOR MAXIMUM DRY DENSITY.
4. ALL DISTURBED AREAS ARE TO BE REINSTATED TO THEIR ORIGINAL CONDITION OR BETTER, AS DETERMINED BY THE ENGINEER. ALL GRASS AND VEGETATION COVERED AREAS SHALL BE RESTORED BY PLACING 200mm OF APPROVED TOPSOIL AND NURSERY SOD UNLESS NOTED OTHERWISE.

1. NATIVE SUBGRADE TO BE COMPACTED TO MINIMUM 98% STANDARD PROCTOR MAXIMUM DRY DENSITY.

2. PAVEMENT STRUCTURE TO BE CONFIRMED BY GEOTECHNICAL ENGINEER PRIOR TO START OF CONSTRUCTION
3. THE PARKING LOT PAVEMENT STRUCTURE SHALL CONSIST OF THE FOLLOWING:











HEAVY DUTY
 - 120mm ASPHALT
 - 150mm GRANULAR "A"
 - 600mm GRANULAR "B"

1. INTERNAL SANITARY SEWERS AND LATERALS TO BE MINIMUM 150mm DIAMETER PVC DR 28 WITH JOINTS CONFORMING TO CSA STANDARD A257.3.

2. SEWERS SHALL BE CONSTRUCTED WITH BEDDING AS PER OPSD 802.010 (GRANULAR 'A' EMBEDMENT MATERIAL), UNLESS APPROVED OTHERWISE BY THE ENGINEER.
3. PRECAST MANHOLES SHALL BE 1200mm DIAMETER UNLESS OTHERWISE SPECIFIED, AND SHALL BE IN ACCORDANCE WITH OPSD 701.010. FRAME AND GRATE TO BE WATERTIGHT AND TO CONFORM TO OPSD 401.030.
4. MANHOLE TOPS ARE TO BE SET TO FINAL GRADE.

1. THE MINIMUM HORIZONTAL SEPARATION BETWEEN THE WATERMAIN AND THE SANITARY/STORM SEWER IS TO BE 2.5 METERS.

4. A MINIMUM OF 0.5m VERTICAL CLEARANCE BETWEEN THE WATERMAIN AND ALL UTILITIES MUST BE KEPT, WHILE STILL MAINTAINING A MINIMUM DEPTH OF COVER AT ALL TIMES. WHERE WATERMAIN CONFLICTS WITH SEWER PIPE, DEFLECT WATERMAIN HORIZONTALLY OR VERTICALLY TO OBTAIN MINIMUM COVER AND VERTICAL CLEARANCE.
3. WATERMAINS SHALL BE PVC DR 18 AND INSTALLED WITH A MINIMUM COVER OF 1.7m OVER THE WATERMAIN. MINIMUM COVER CAN NOT BE ACHIEVED, INSULATION AS PER DETAIL (THIS SHEET) WILL BE REQUIRED.
4. WATERMAIN SHALL BE CONSTRUCTED WITH BEDDING AS PER OPSD 802.010 (GRANULAR "A" EMBEDMENT MATERIAL) FOR FLEXIBLE PIPES.
3. COPPER WATER SERVICES 25mm DIA. SHALL BE EMBEDDED IN SAND 100mm ABOVE AND BELOW TO CONFORM TO OPSD 1104.010.
6. WATERMAIN BEDDING SHALL CONSIST OF WINTER SAND, 150mm BELOW AND 300mm ABOVE THE WATERMAIN.
7. CONCRETE THRUST BLOCKS ARE TO BE INSTALLED AT ALL TEES, BENDS, HYDRANTS, ENDS OF MAINS AND CONNECTIONS 100mm AND LARGER AS PER STANDARD DRAWINGS. ALL BENDS TO BE RESTRAINED.
6. ALL JOINTS MUST BE RESTRAINED AND THRUST BLOCKED.
9. ANY EXISTING, ON SITE, WATER WELLS MUST BE DECOMMISSIONED.
10. WHERE A COPPER SERVICE MUST BE JOINED UNDER THE FLOOR, THE COPPER SHALL BE JOINED BY SILVER SOLDER CONNECTION ONLY.
11. ALL SERVICE PIPE MATERIAL MUST BE DUCTILE IRON FROM THE RESTRAINING FLANGE TO A MINIMUM OF 3 METERS OUTSIDE THE FOUNDATION. REFER TO BSD-61. ALL DUCTILE SHALL BE POLY WRAPPED FOR ADDED PROTECTION.
12. OPERATION OF FIRE HYDRANTS AND VALVES ON POTABLE WATER BY OTHER THAN WATER OPERATIONS DEPARTMENT IS PROHIBITED.
13. THE CITY WILL SWAB, CHLORINATE AND FLUSH ALL NEW SERVICES. THE CONTRACTOR SHALL PERFORM PRESSURE TEST WITH WATER FIELD COORDINATOR WITNESSING.
14. EXTERNAL CONTRACTOR TO COORDINATE WITH INTERNAL CONTRACTOR ON ALL INSTALLATION, SWABBING, CHLORINATING AND TESTING WITNESSED BY WATER FIELD SERVICES COORDINATOR.
15. RESTRAINING WILL BE REQUIRED ON ALL HYDRANTS A MINIMUM OF THREE LENGTHS OF PIPE. HYDRANTS TO BE PAINTED RED.
16. TRACING WIRE (#12 TWO STRANDED COPPER) TO BE INSTALLED ON THE TOTAL LENGTH OF ALL PVC WATERMAINS AND BROUGHT UP AT EACH HYDRANT AND CONNECTED TO FLANGE BOLT.
17. SERVICE TAPINGS SHALL BE PLACED AT A MINIMUM SEPARATION OF 1.0m AND A MINIMUM OF 0.6m FROM JOINTS.
18. CONTRACTOR TO PROVIDE PLAN FOR REMOVING CHLORINATED WATER FROM SITE.
19. A CHLORINATION TAIL SHALL BE INSTALLED JUST BEHIND TAPPING VALVE TO FACILITATE CHLORINATING SERVICE, TO BE REMOVED AFTER TESTING.

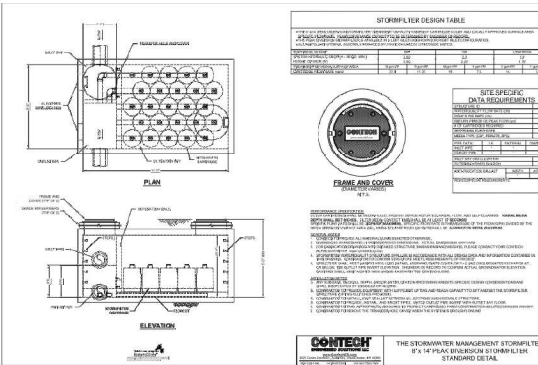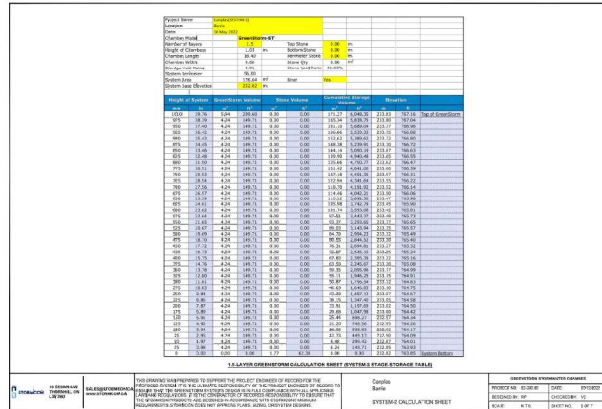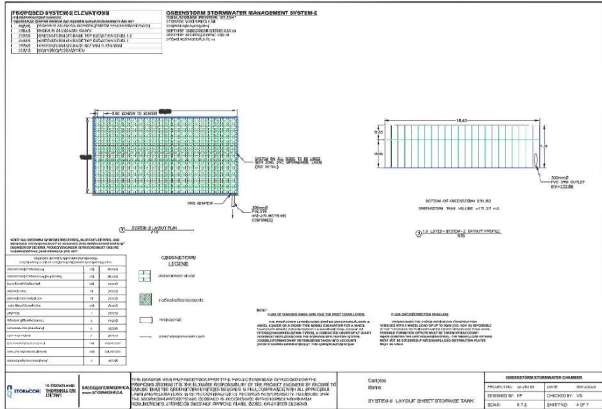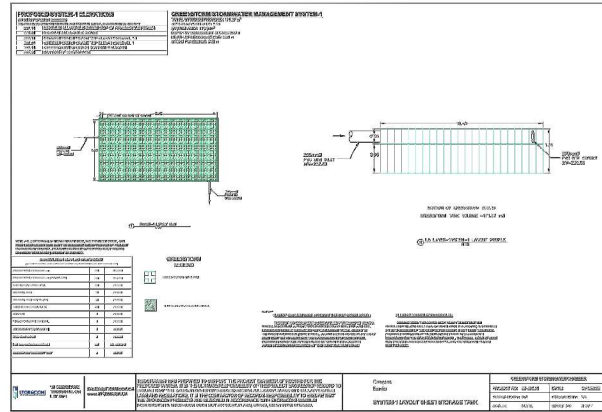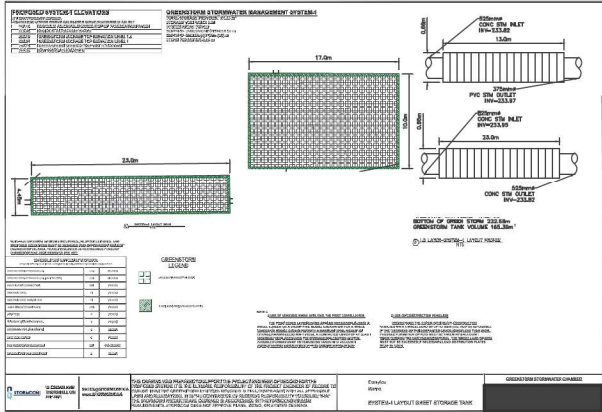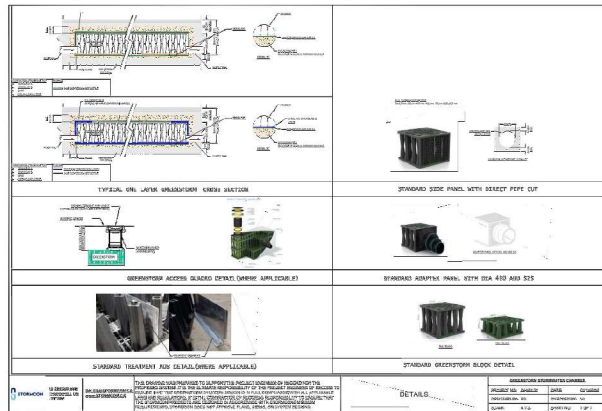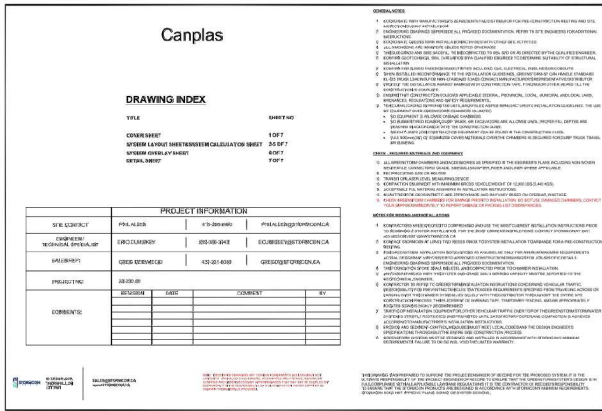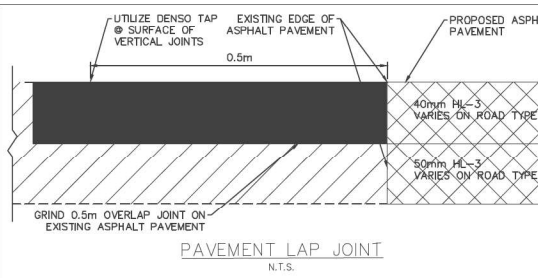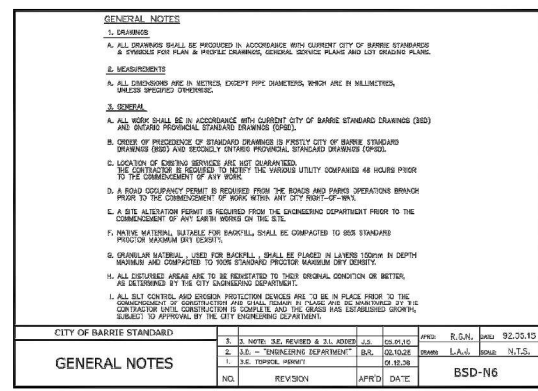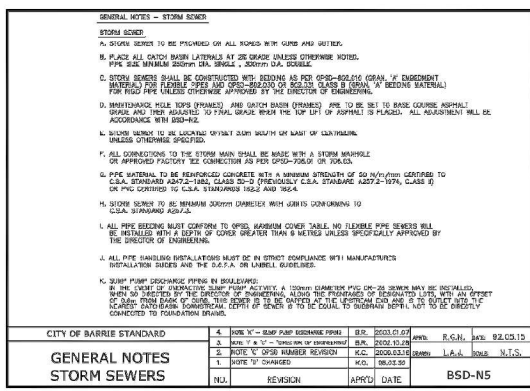

222 Mapleview Drive West, Suite 300
Barrie, ON L4N 9E7 Canada
Tel.: 705.737.3303
Fax: 705.737.1772
www.gerreng.com

Handwritten or manual revisions to the drawing are only valid when accompanied by the design engineer's initials.

Do not scale drawings.
Check and verify all dimensions and information on the drawings and report all errors or omissions to the Consultant before proceeding with the work.
This drawing shall not be reproduced in any manner, in part or in whole, for any project other than that for which it was prepared.
This drawing, and all design concepts it contains, are an instrument of professional service and remain the property of Gerrits Engineering.

This drawing may have been reduced.

A horizontal scale bar with two rows of markings. The top row is in millimeters, with major ticks at 0, 5, 10, 20, 30, 40, and 50mm. The bottom row is in inches, with major ticks at 0", 1/4", 1/2", 1", 1 1/2", and 2".

No.	Issuance Description	YY/MM/DD
1.	SITE PLAN APPROVAL	22/05/10
2.	SITE PLAN APPROVAL REV-1	22/11/03
3.	LSRCA SPA COMMENTS	23/01/06
4.	SITE PLAN APPROVAL REV-2	23/02/14

Issued For:

SITE PLAN APPROVAL
REV-2

Client

Project

**CANPLAS WAREHOUSE
ADDITION**

31 Patterson Rd., Barrie, ON L4N 3V9

Drawing:



NOTES & DETAILS

Project No.	873-009	Designed by:	KF	Checked by:	KF
Scale:		Drawn by:	RM	Approved by:	JDM
Orientation	Stamp				



Drawing No.

ND-1

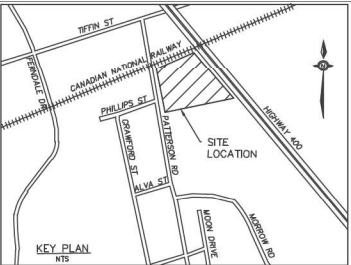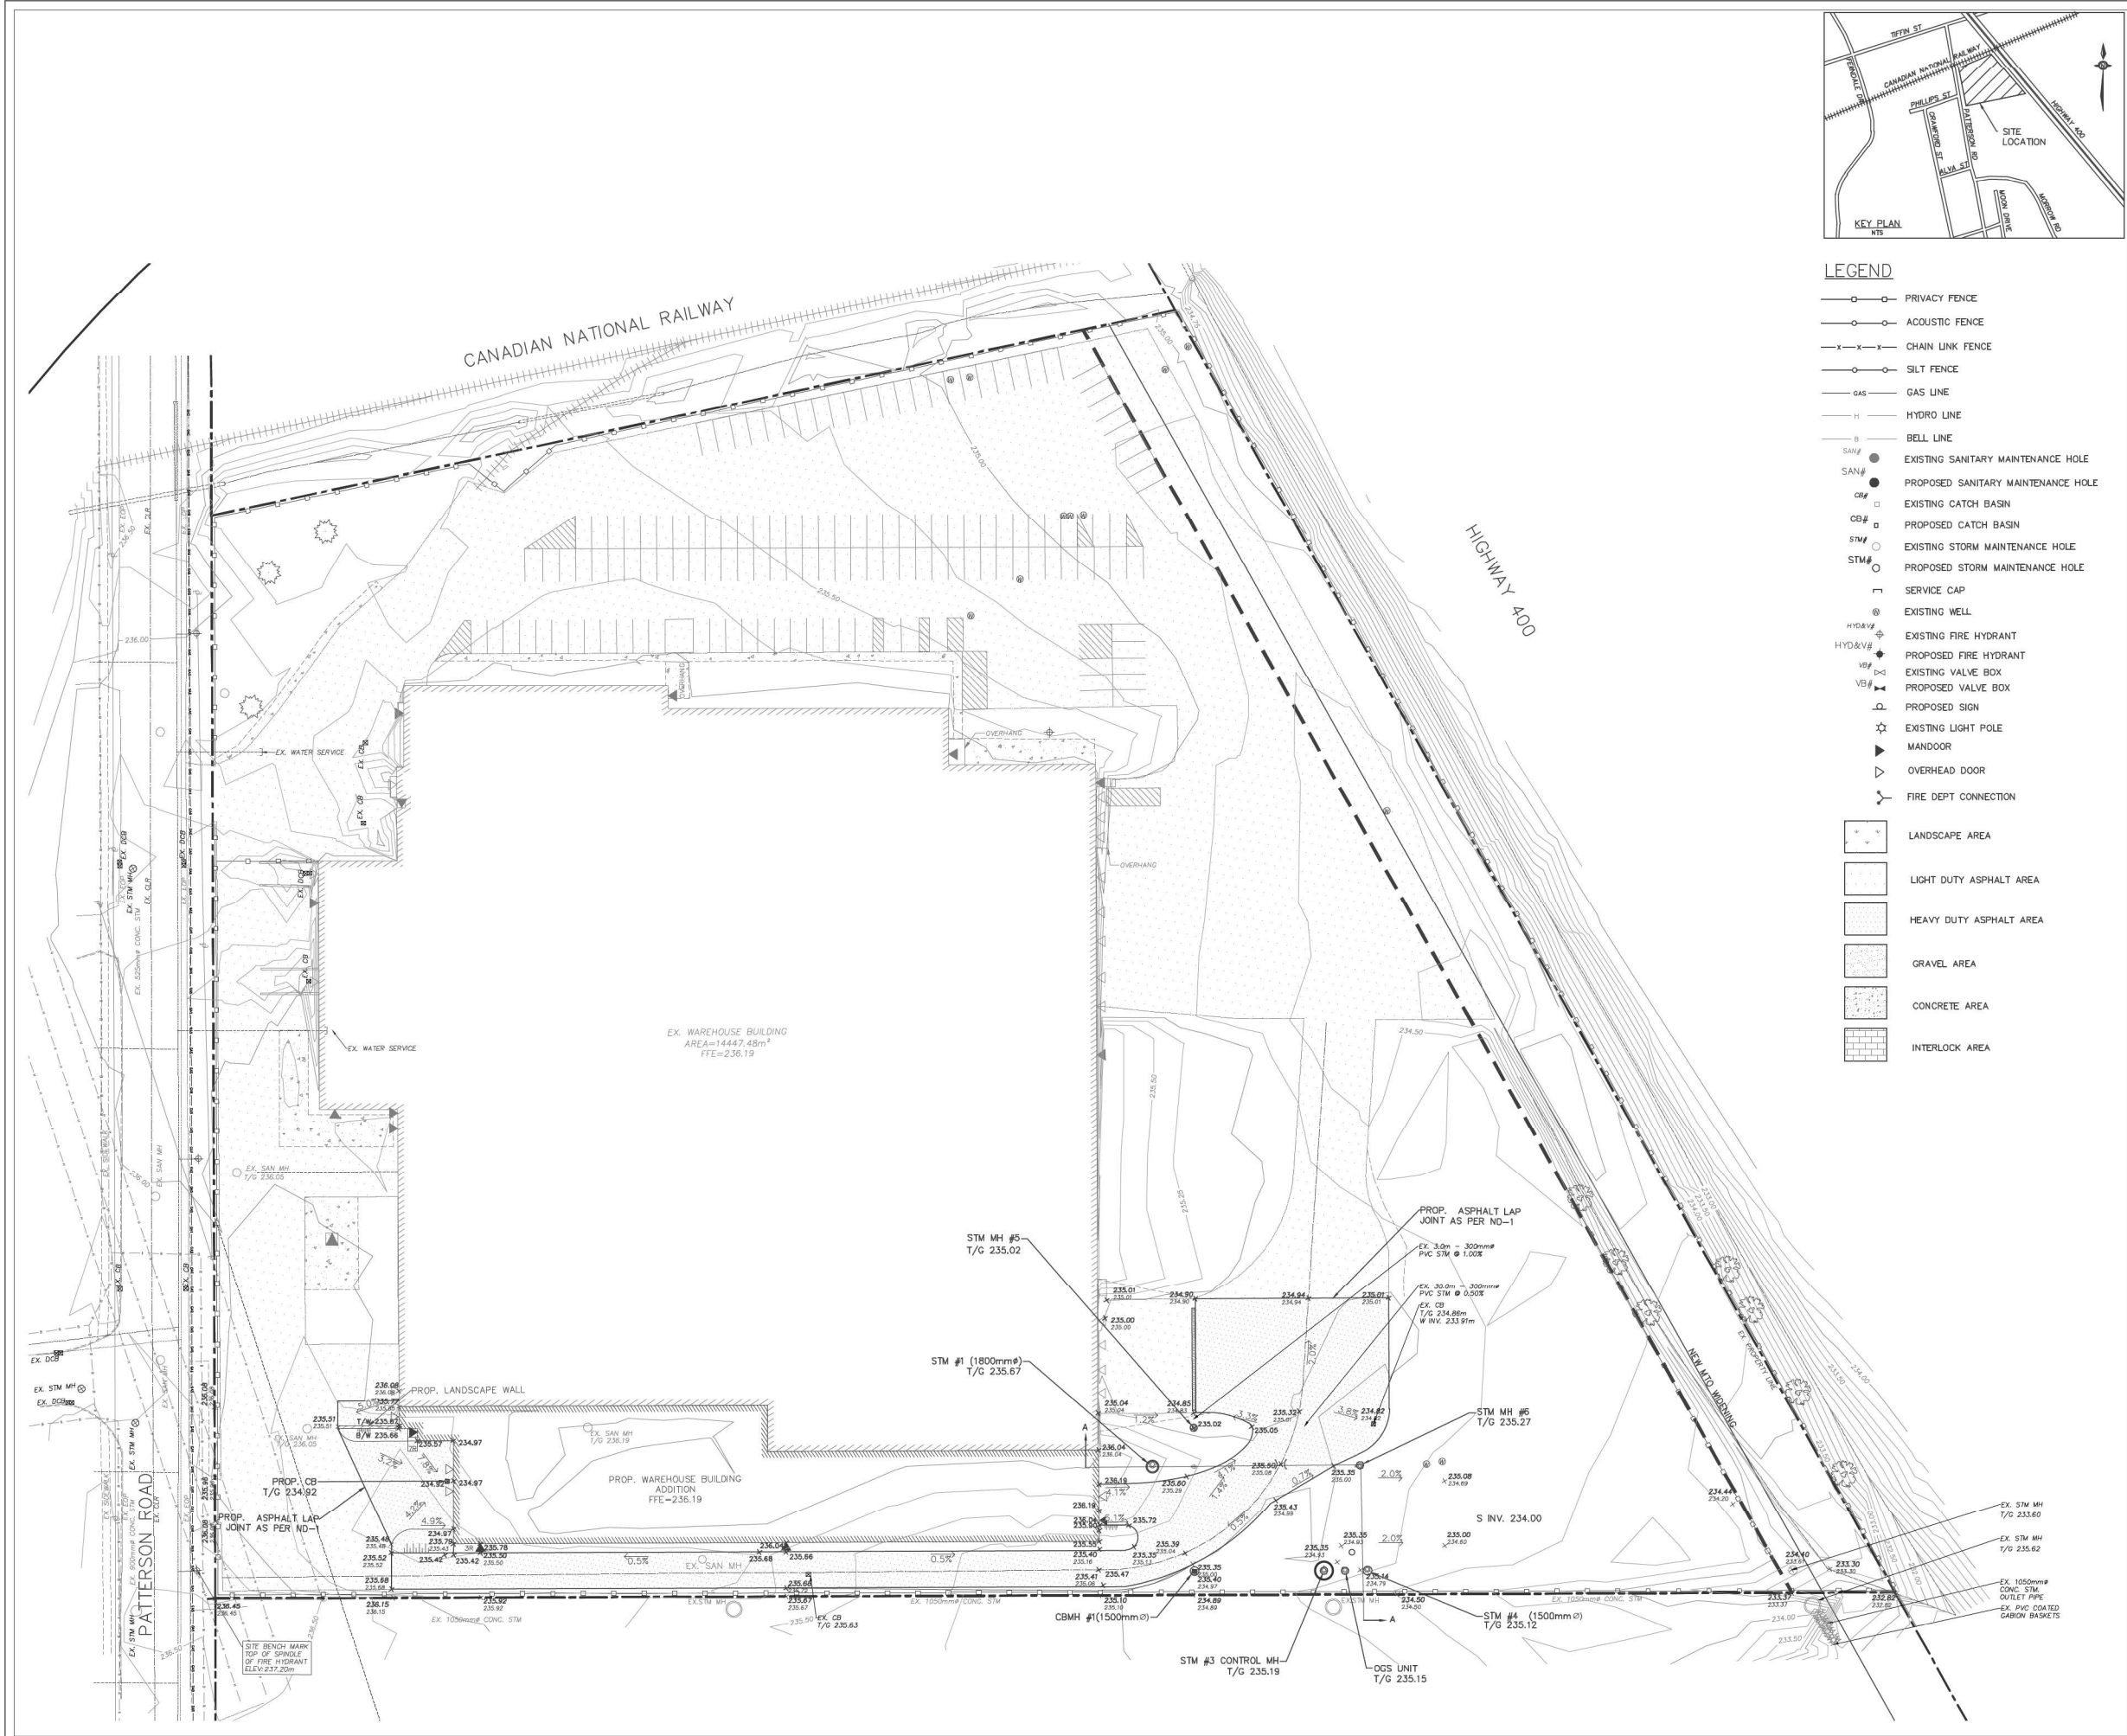

- LEGEND**
- PRIVACY FENCE
 - ACOUSTIC FENCE
 - CHAIN LINK FENCE
 - SILT FENCE
 - GAS LINE
 - HYDRO LINE
 - BELL LINE
 - EXISTING SANITARY MAINTENANCE HOLE
 - PROPOSED SANITARY MAINTENANCE HOLE
 - EXISTING CATCH BASIN
 - PROPOSED CATCH BASIN
 - EXISTING STORM MAINTENANCE HOLE
 - PROPOSED STORM MAINTENANCE HOLE
 - SERVICE CAP
 - EXISTING WELL
 - EXISTING FIRE HYDRANT
 - PROPOSED FIRE HYDRANT
 - EXISTING VALVE BOX
 - PROPOSED VALVE BOX
 - PROPOSED SIGN
 - EXISTING LIGHT POLE
 - MANDOOR
 - OVERHEAD DOOR
 - FIRE DEPT CONNECTION

- LANDSCAPE AREA
- LIGHT DUTY ASPHALT AREA
- HEAVY DUTY ASPHALT AREA
- GRAVEL AREA
- CONCRETE AREA
- INTERLOCK AREA

Gerrits
ENGINEERING

222 Mapleview Drive West, Suite 300
Barrie, ON L4N 5E7 Canada
Tel: 705.737.3303
Fax: 705.737.1772
www.gerriteng.com

This drawing has been created electronically.
Handwritten or manual revisions to the drawing are only valid when accompanied by the design engineer's initials.
Do not scale drawings.
Check and verify all dimensions and information on the drawings and report all errors or omissions to the Consultant before proceeding with the work.
This drawing shall not be reproduced in any manner, in part or in whole, for any project other than that for which it was prepared.
This drawing, and all design concepts it contains, are an instrument of professional service and remain the property of Gerrits Engineering.

No.	Issuance Description	YYMMDD
1.	SITE PLAN APPROVAL	22/05/10
2.	SITE PLAN APPROVAL REV-1	22/11/03
3.	LSRCA SPA COMMENTS	23/01/06
4.	SITE PLAN APPROVAL REV-2	23/02/14

Issued For:

SITE PLAN APPROVAL REV-2

Client:

canplas
INDUSTRIES LTD.

Project:

CANPLAS WAREHOUSE ADDITION
31 Patterson Rd., Barrie, ON L4N 3V9




Drawing:

SITE GRADING PLAN

Project No. 873-009 Designed by: KF Checked by: KF
Scale: 1:500 Drawn by: RM Approved by: JDM
Orientation: Stamp:


Licensed Professional Engineer
J.D.M. McQuinn
14064895
2023/02/13
PROVINCE OF ONTARIO

Drawing No. **SG-1**

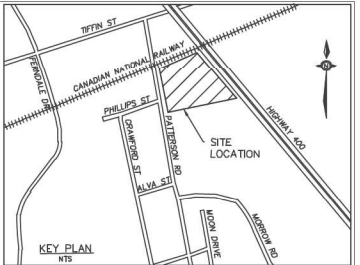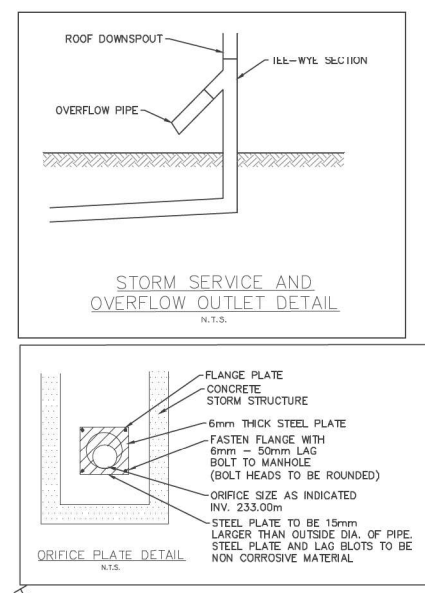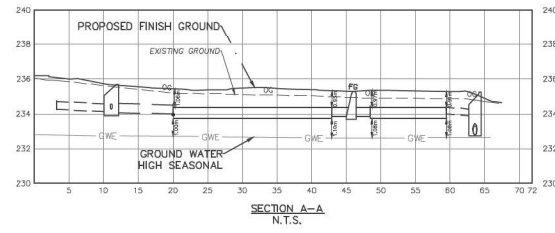

- LEGEND
- PRIVACY FENCE
 - ACOUSTIC FENCE
 - CHAIN LINK FENCE
 - SILT FENCE
 - GAS LINE
 - HYDRO LINE
 - BELL LINE
 - EXISTING SANITARY MAINTENANCE HOLE
 - PROPOSED SANITARY MAINTENANCE HOLE
 - EXISTING CATCH BASIN
 - PROPOSED CATCH BASIN
 - EXISTING STORM MAINTENANCE HOLE
 - PROPOSED STORM MAINTENANCE HOLE
 - SERVICE CAP
 - EXISTING WELL
 - EXISTING FIRE HYDRANT
 - PROPOSED FIRE HYDRANT
 - EXISTING VALVE BOX
 - PROPOSED VALVE BOX
 - PROPOSED SIGN
 - EXISTING LIGHT POLE
 - MANDOOR
 - OVERHEAD DOOR
 - FIRE DEPT CONNECTION
 - LANDSCAPE AREA
 - LIGHT DUTY ASPHALT AREA
 - HEAVY DUTY ASPHALT AREA
 - GRAVEL AREA
 - CONCRETE AREA
 - INTERLOCK AREA

ALL EXISTING INVERTS TO BE VERIFIED
BY CONTRACTOR BEFORE CONSTRUCTION

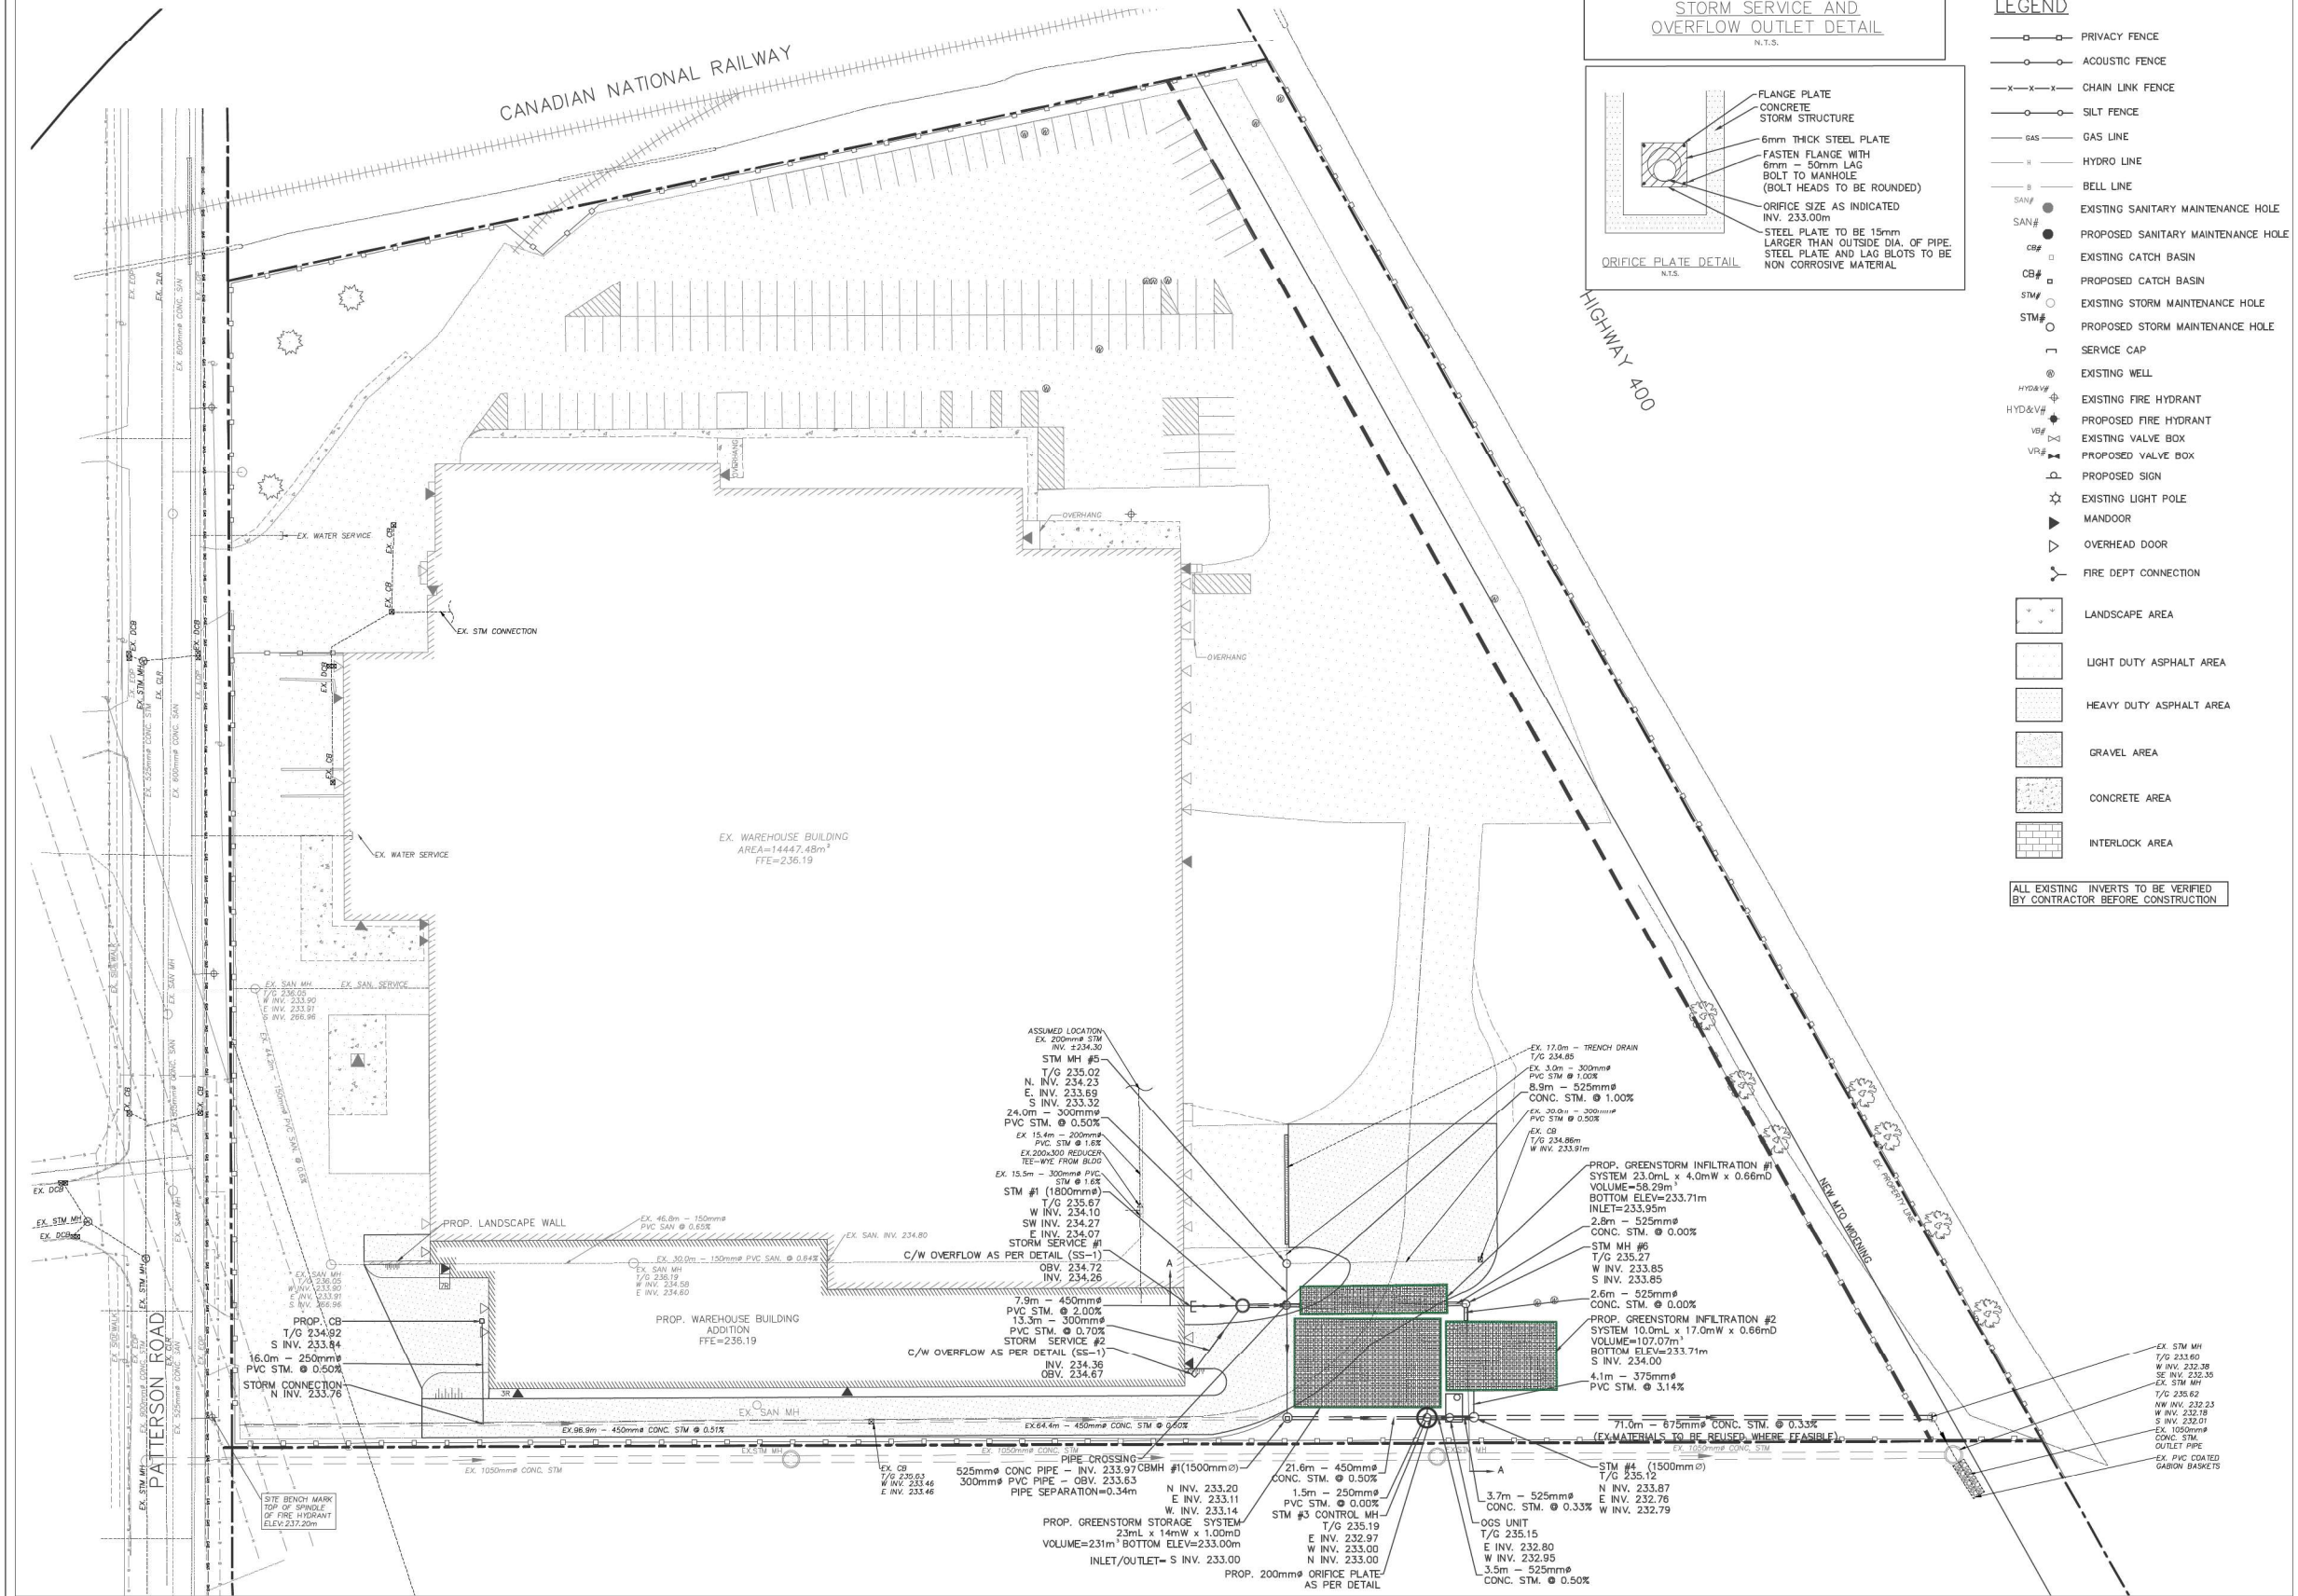

Gerrits
ENGINEERING

222 Mapleview Drive West, Suite 300
Barrie, ON L4N 5E7 Canada
Tel: 705.737.3303
Fax: 705.737.1772
www.gerritseng.com

This drawing has been created electronically.
Handwritten or manual revisions to the drawing are only valid when accompanied by the design engineer's initials.
Do not scale drawings.
Check and verify all dimensions and information on the drawings and report all errors or omissions to the Consultant before proceeding with the work.
This drawing shall not be reproduced in any manner, in part or in whole, for any project other than that for which it was prepared.
This drawing, and all design concepts it contains, are an instrument of professional service and remain the property of Gerrits Engineering.

This drawing may have been reduced.

No.	Issuance Description	YYMMDD
1.	SITE PLAN APPROVAL	22/05/10
2.	SITE PLAN APPROVAL REV-1	22/11/03
3.	LSRCA SPA COMMENTS	23/01/06
4.	SITE PLAN APPROVAL REV-2	23/02/14

Issued For:

**SITE PLAN APPROVAL
REV-2**

Client

canplas
INDUSTRIES LTD.

Project

**CANPLAS WAREHOUSE
ADDITION**
31 Patterson Rd., Barrie, ON L4N 3V9



Drawing:

SITE SERVICING PLAN


Project No.	873-009	Designed by:	KF	Checked by:	KF
Scale:	1:500	Drawn by:	RM	Approved by:	JDM
Orientation	Stamp				

Drawing No.

SS-1

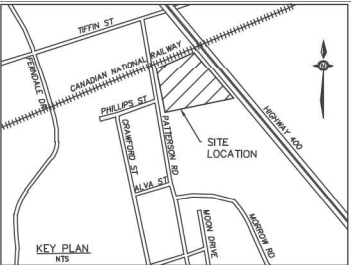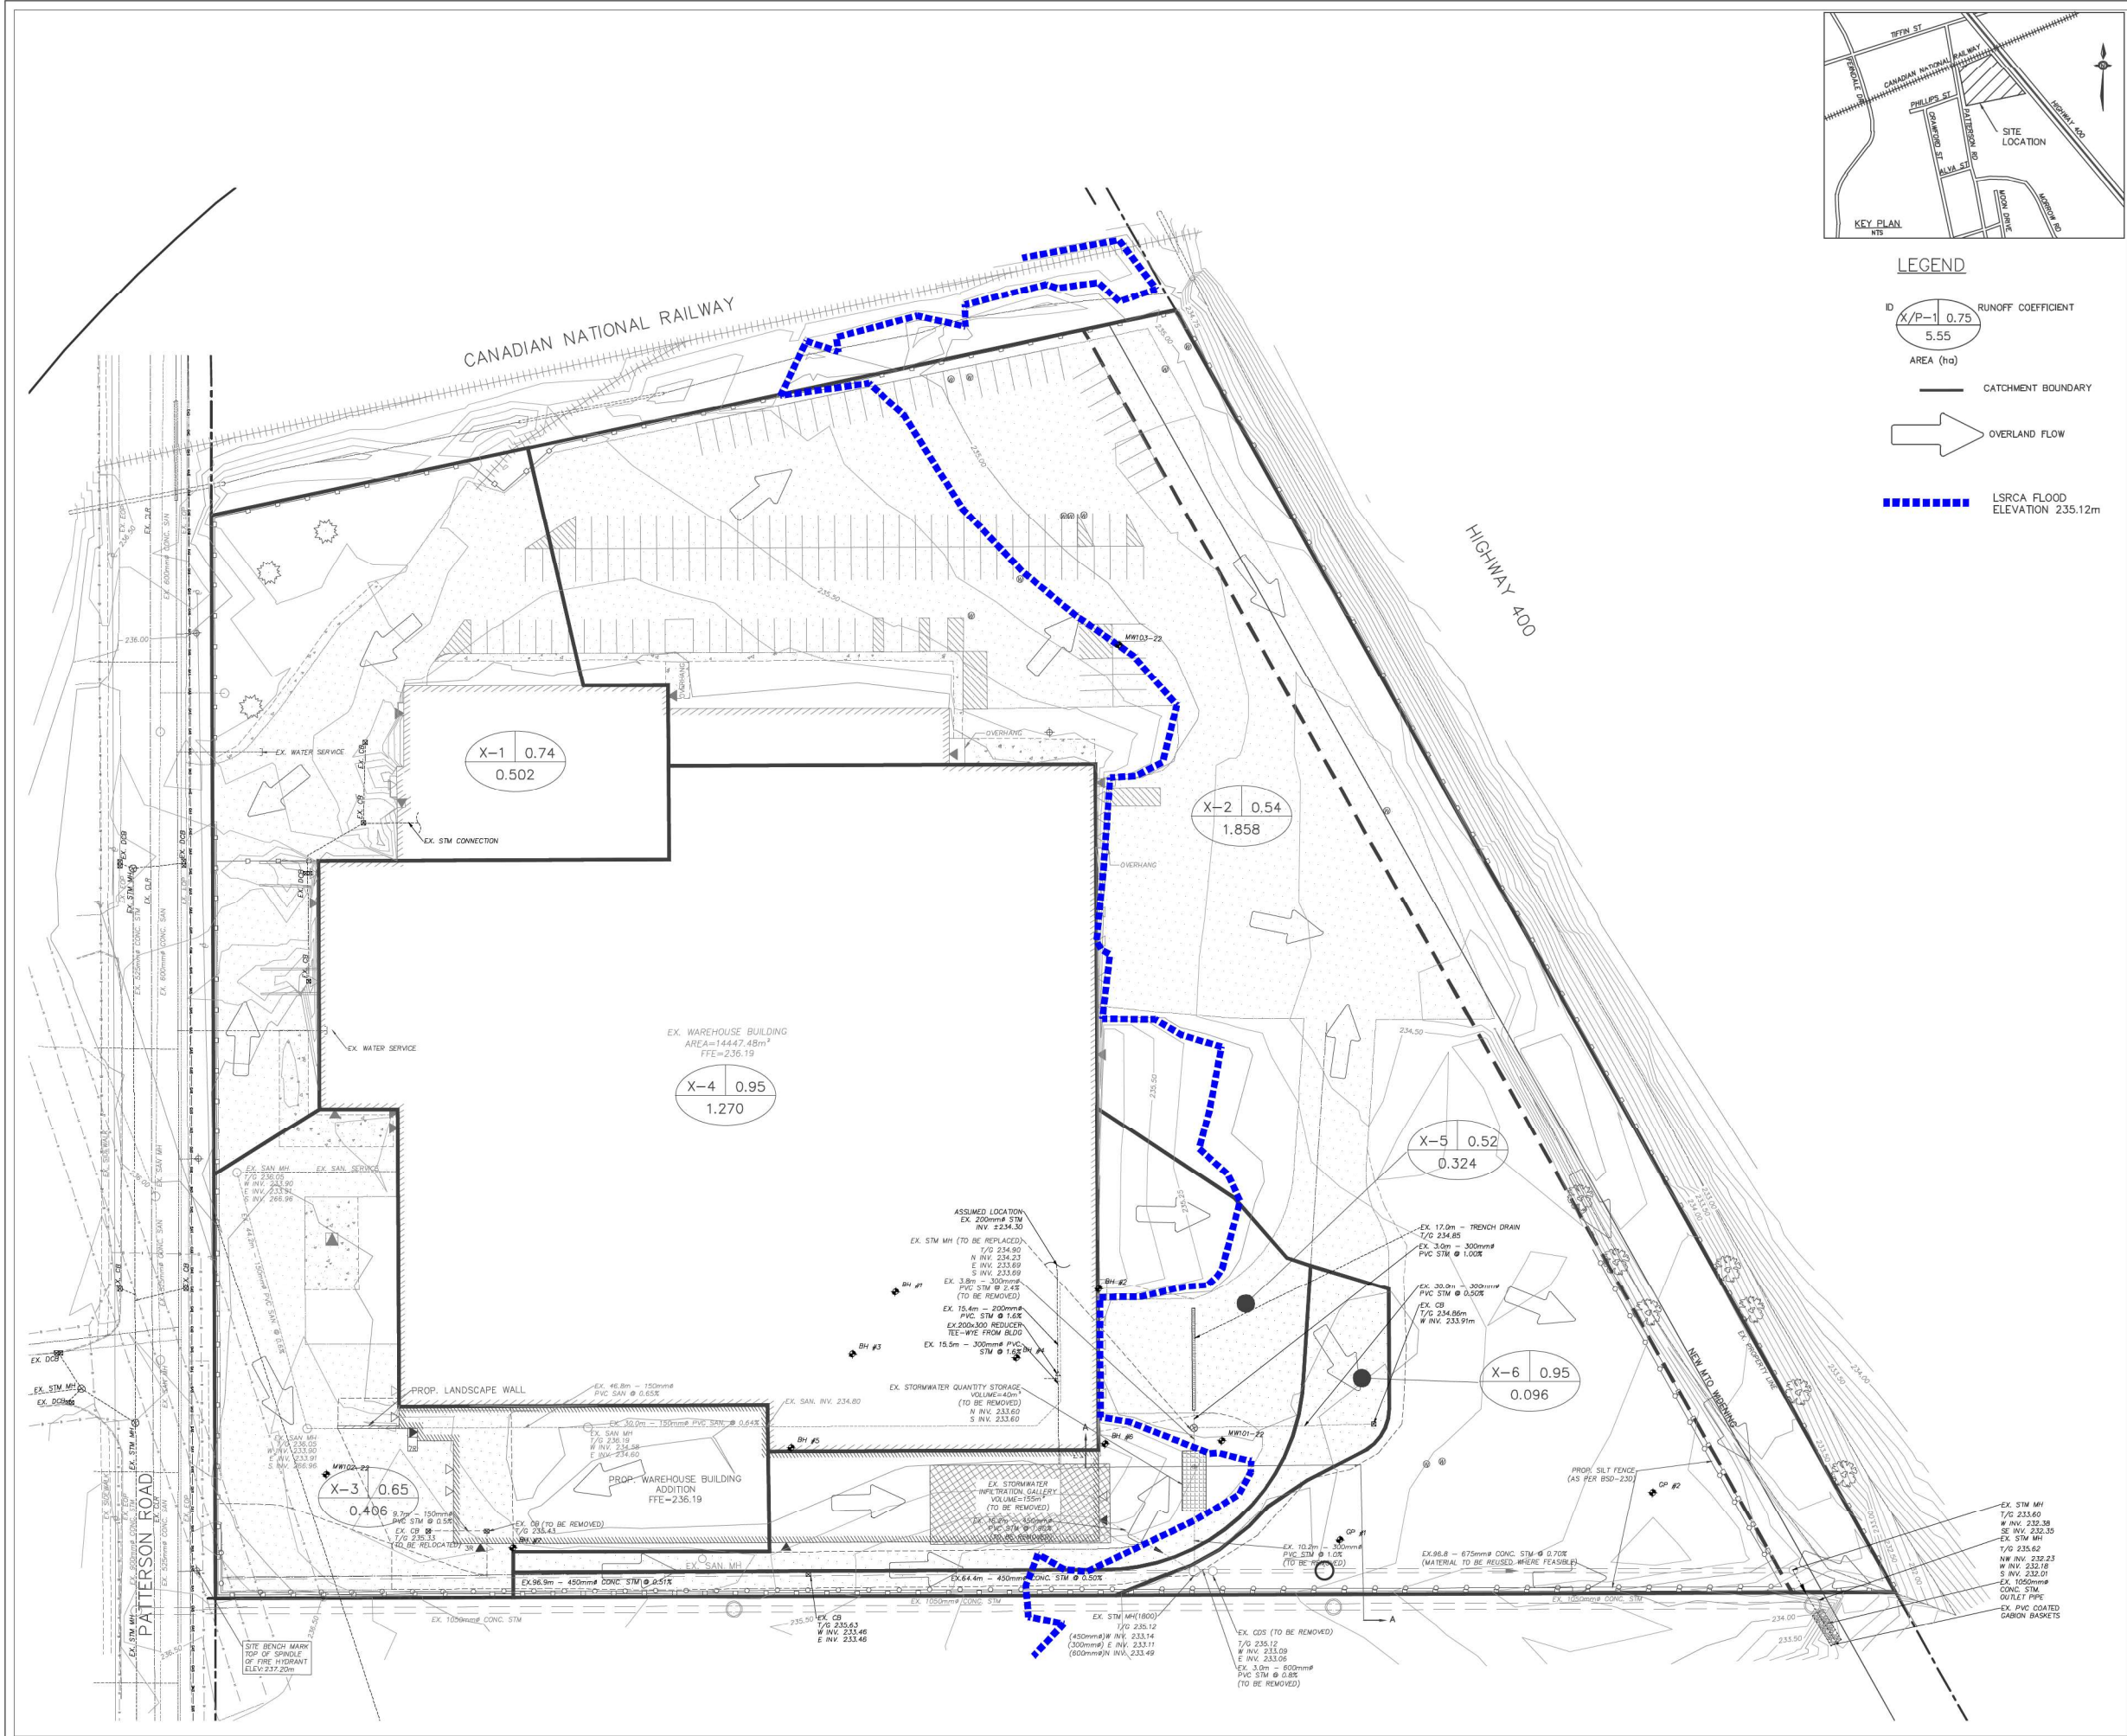

LEGEND



Gerrits
ENGINEERING


222 Mapleview Drive West, Suite 300
Barrie, ON L4N 5E7 Canada
Tel: 705.737.3303
Fax: 705.737.1772
www.gerriteng.com

This drawing has been created electronically.

Handwritten or manual revisions to the drawing are only valid when accompanied by the design engineer's initials.

Do not scale drawings. Check and verify all dimensions and information on the drawings and report all errors or omissions to the Consultant before proceeding with the work. This drawing shall not be reproduced in any manner, in part or in whole, for any project other than that for which it was prepared.

This drawing, and all design concepts it contains, are an instrument of professional service and remain the property of Gerrits Engineering.



No.	Issuance Description	YYMMDD
1.	SITE PLAN APPROVAL	22/05/10
2.	SITE PLAN APPROVAL REV-1	22/11/03
3.	LSRCA SPA COMMENTS	23/01/06
4.	SITE PLAN APPROVAL REV-2	23/02/14

Issued For:

**SITE PLAN APPROVAL
REV-2**

Client

canplas
INDUSTRIES LTD.

Project

**CANPLAS WAREHOUSE
ADDITION**
31 Patterson Rd., Barrie, ON L4N 3V9

Drawing:

**PRE-DEVELOPMENT
STORMWATER
DRAINAGE PLAN**

Project No. 873-009 Designed by: KF Checked by: KF



Scale: 1:500 Drawn by: RM Approved by: JDM

Orientation: Stamp



Drawing No.

STM-1

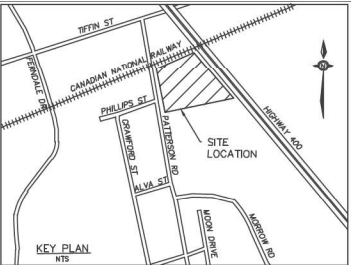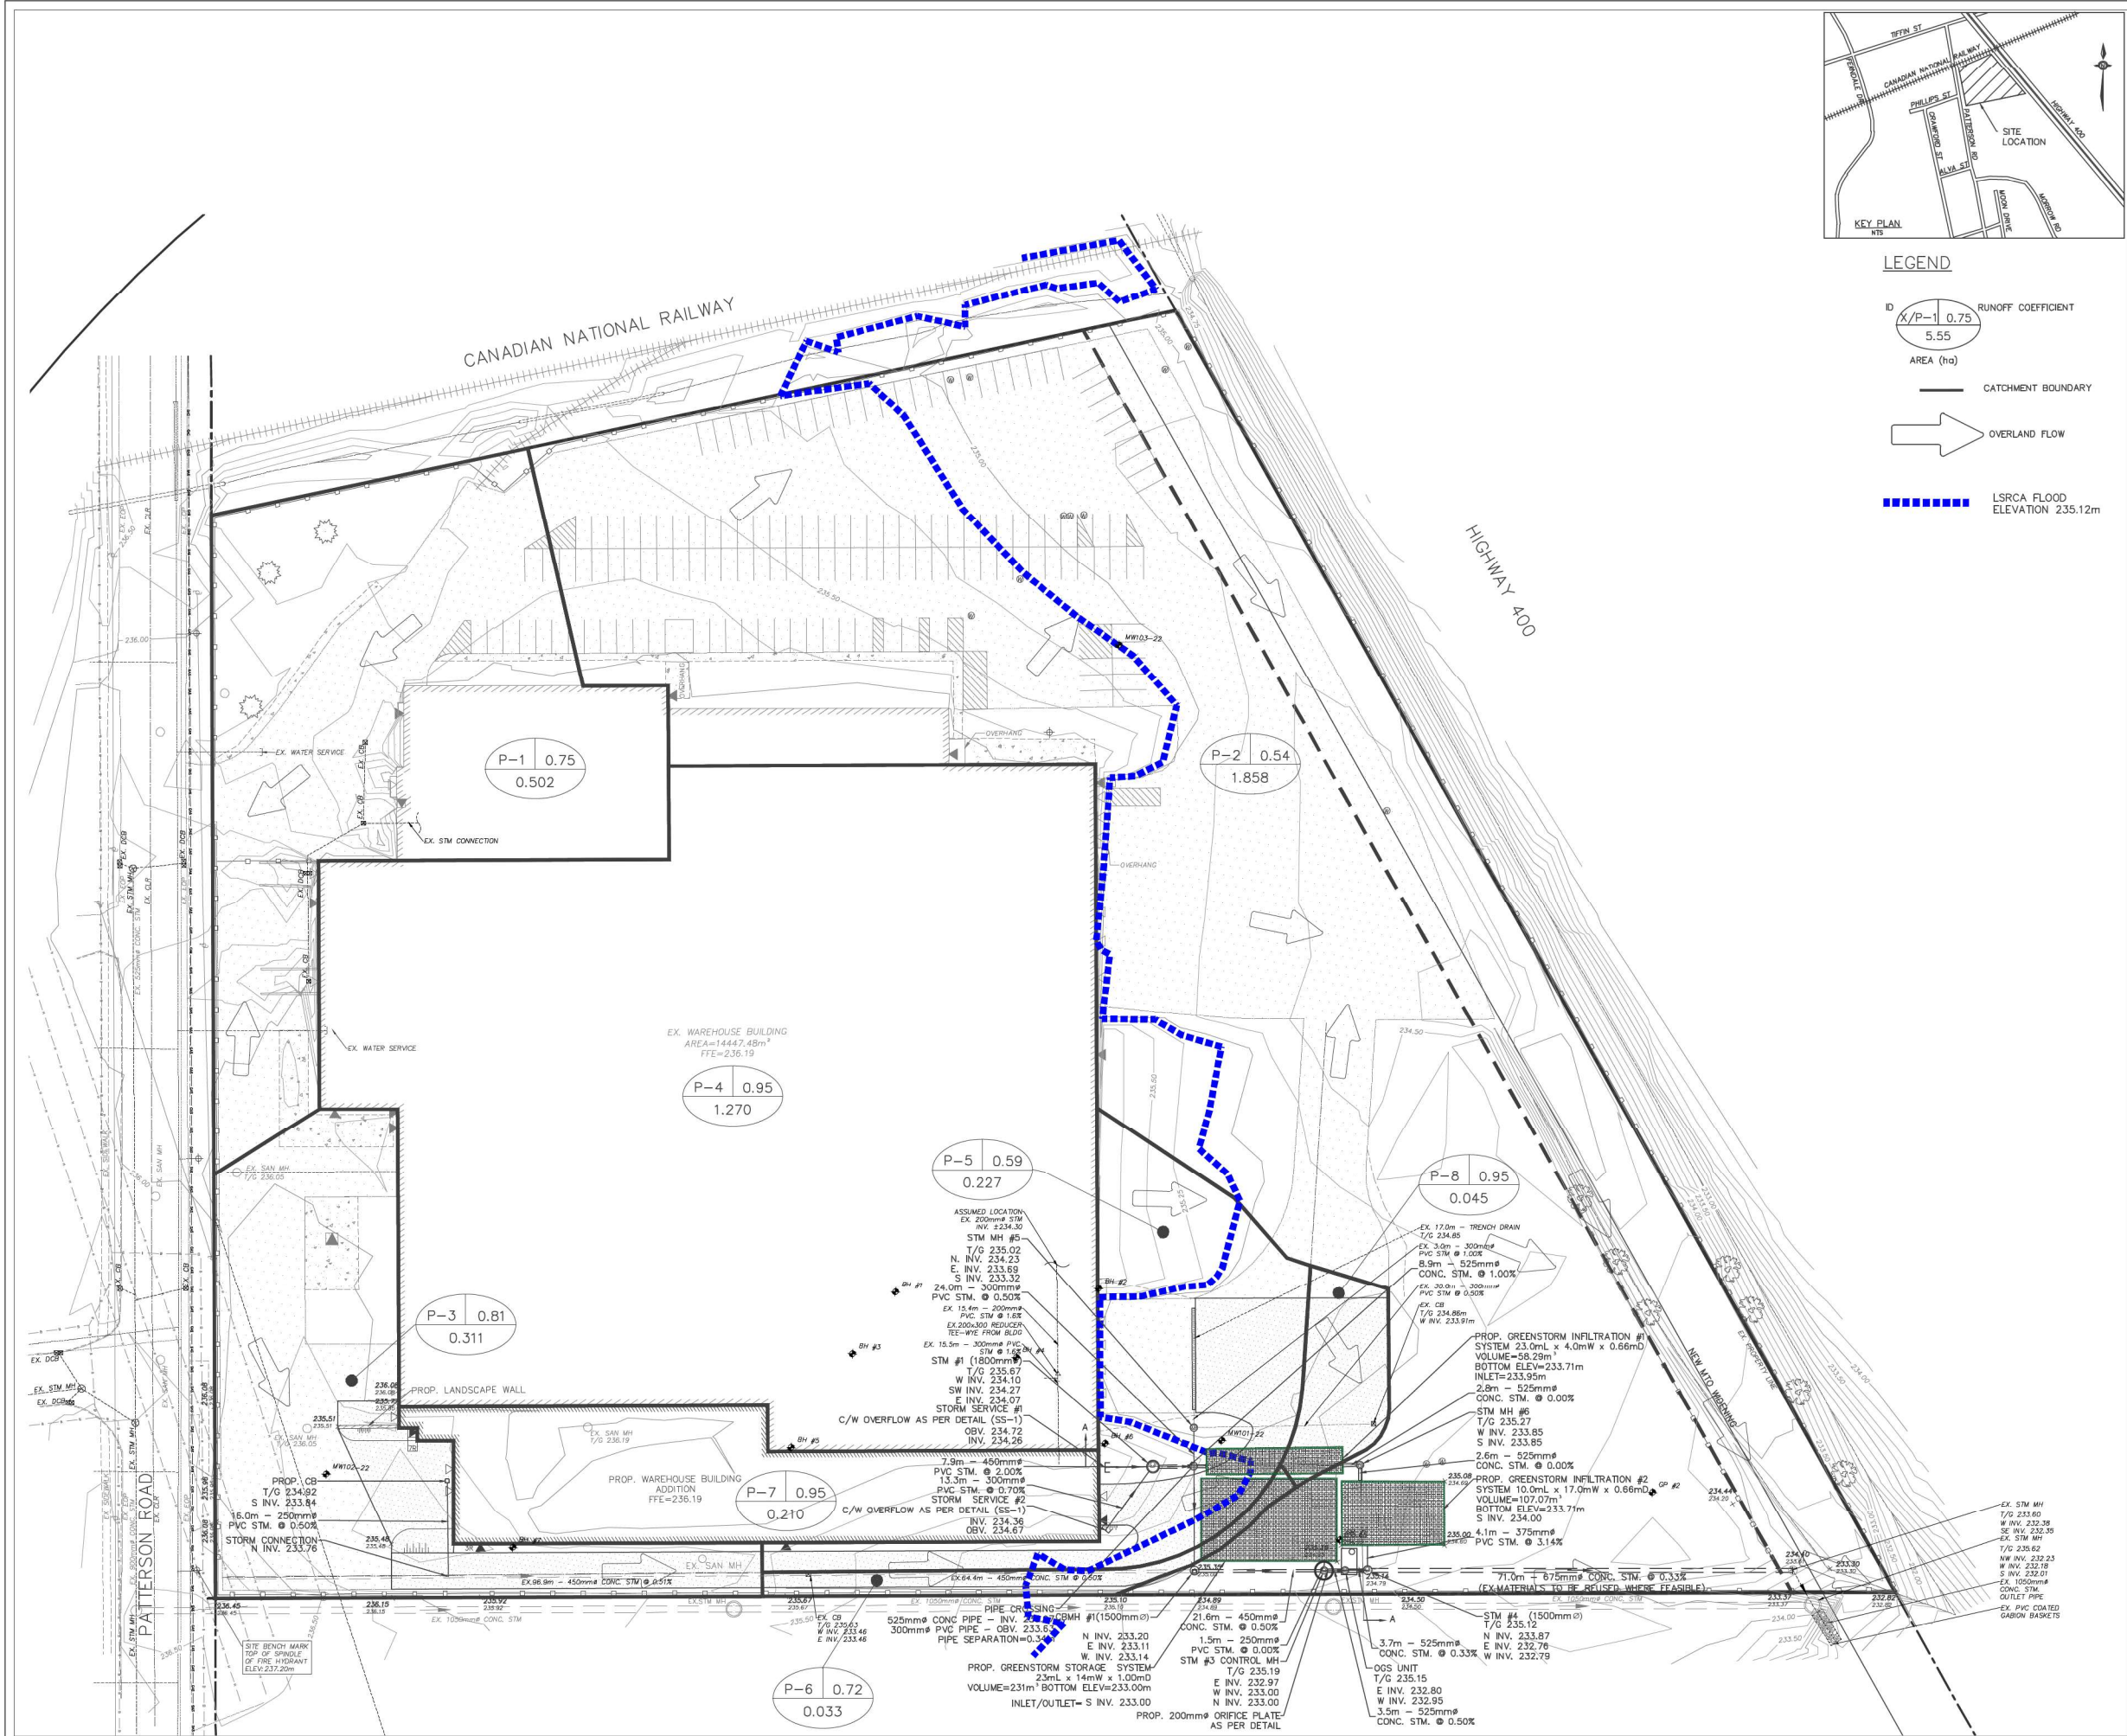

- LEGEND**
- $\frac{X}{P-1} \frac{0.75}{5.55}$ RUNOFF COEFFICIENT
AREA (ha)
 - CATCHMENT BOUNDARY
 - OVERLAND FLOW
 - LSRCA FLOOD ELEVATION 235.12m

Gerrits
ENGINEERING

222 Mapleview Drive West, Suite 300
Barrie, ON L4N 5E7 Canada
Tel: 705.737.3303
Fax: 705.737.1772
www.gerriteng.com

This drawing has been created electronically.
Handwritten or manual revisions to the drawing are only valid when accompanied by the design engineer's initials.

Do not scale drawings.
Check and verify all dimensions and information on the drawings and report all errors or omissions to the Consultant before proceeding with the work.
This drawing shall not be reproduced in any manner, in part or in whole, for any project other than that for which it was prepared.

This drawing, and all design concepts it contains, are an instrument of professional service and remain the property of Gerrits Engineering.
This drawing may have been reduced.

No.	Issuance Description	YYMMDD
1.	SITE PLAN APPROVAL	22/05/10
2.	SITE PLAN APPROVAL REV-1	22/11/03
3.	LSRCA SPA COMMENTS	23/01/06
4.	SITE PLAN APPROVAL REV-2	23/02/14

Issued For:
**SITE PLAN APPROVAL
REV-2**

Client
canplas
INDUSTRIES LTD.

Project
**CANPLAS WAREHOUSE
ADDITION**
31 Patterson Rd., Barrie, ON L4N 3V9

Drawing:
**POST DEVELOPMENT
STORMWATER
DRAINAGE PLAN**

Project No.	873-009	Designed by:	KF	Checked by:	KF
Scale:	1:500	Drawn by:	RM	Approved by:	JDM
Orientation	Stamp				



Drawing No.
STM-2